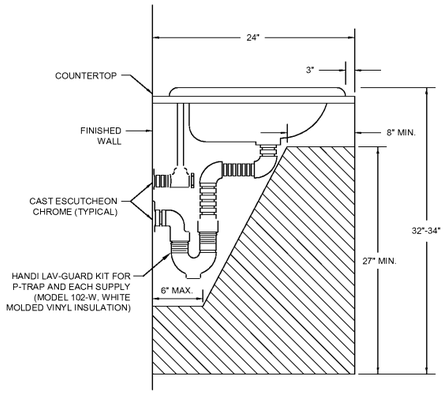

NOTE:

CABINETS AND / OR COUNTERTOP INSTALLATIONS WITH SKIRTED FACES MAY OMIT INSULATION KITS IF ADA CLEARANCES SHOWN ARE MET.

1 P002 P-TRAP INSULATION DETAIL
NOT TO SCALE

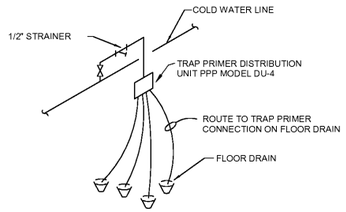

NOTE:

INSTALL TRAP PRIMER DISTRIBUTION UNIT IN CHASE WALL PROVIDE POSITIVE SLOPE TO TRAP CONNECTION.

2 P002 TRAP PRIMER DETAIL
NOT TO SCALE

3 P002 WATER HAMMER ARRESTOR DETAIL
NOT TO SCALE

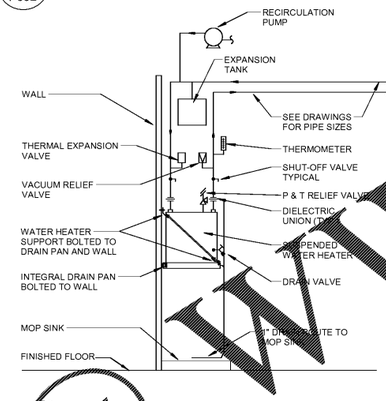

4 P002 WATER HEATER INSTALLATION DETAIL
NOT TO SCALE

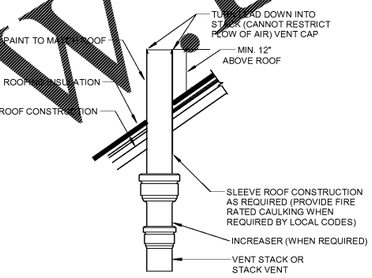

5 P002 VTR DETAIL
NOT TO SCALE

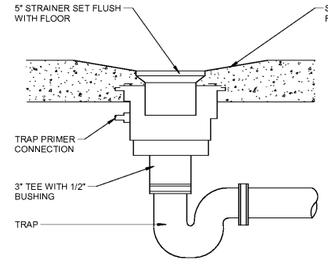

6 P002 FLOOR DRAIN INSTALLATION DETAIL
NOT TO SCALE

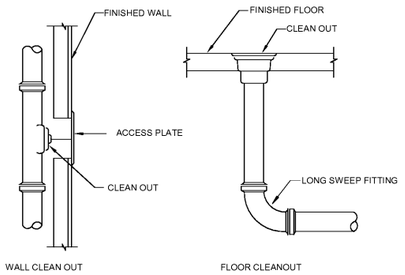

7 P002 CLEANOUT DETAIL
NOT TO SCALE

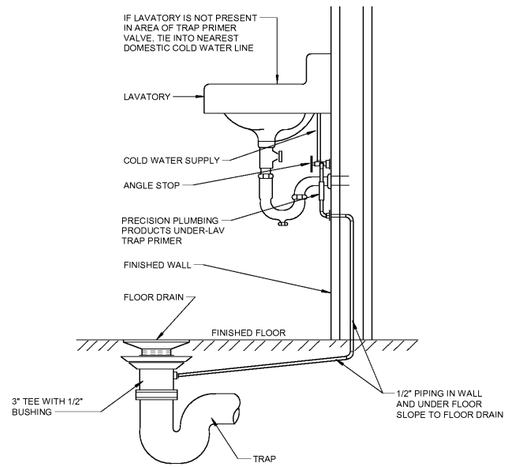

8 P002 TRAP PRIMER VALVE DETAIL
NOT TO SCALE

Order Plans @ WWW.LDILine.com

liollio architecture
147 Wappoo Creek Drive Suite 400
Charleston, SC 29412
P 843.762.2222

DWG CONSULTING ENGINEERS
1088 Houston Northcutt Blvd., Suite 202 · Mount Pleasant, SC 29464
Phone: (843) 849-7141 · Fax: (843) 849-7176
www.dwgsc.com

SOUTH CAROLINA CERTIFICATE OF AUTHORIZATION DWG, INC. CONSULTING ENGINEERS No.C003649

SOUTH CAROLINA REGISTERED No.27045 PROFESSIONAL ENGINEER 04/03/17 MARK A. UYAK

△	Revision Date	Description

Town of James Island

James Island Town Hall

1122/1126 Dills Bluff Road
Charleston, SC.

Project Number:	15169-00
Checked By:	MAU
Drawn By:	EAG
Date:	4/3/2017
Scale:	NOT TO SCALE

P002

PLUMBING DETAILS

© Copyright 2016. All Rights Reserved. Reproduction, copying, or use of this drawing and designs shown thereon without written consent of Liollio Architecture, Inc. is prohibited and any infringement is subject to legal action.