

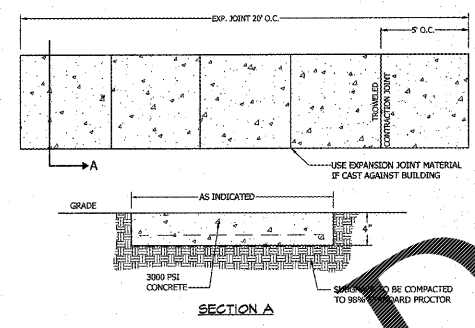


UTILITY NOTES:

1. WATER SERVICE TO BE PROVIDED ONSITE BEHIND MASTER METERS. COORDINATION WITH FAYETTE COUNTY WATER SYSTEM NOT REQUIRED.
2. SEWER SERVICE TO BE PROVIDED BY CONNECTION TO ON-SITE SEPTIC TREATMENT SYSTEM. CONSTRUCTION OF THIS FACILITY IS AN ANCILLARY STRUCTURE TO THE MAIN SCHOOL. NO NEW STUDENTS ARE ADDED BY CONSTRUCTION OF THIS STRUCTURE. AS SUCH, EXISTING SEPTIC SYSTEM DESIGNED FOR TOTAL STUDENT POPULATION IS SUITABLE.
3. LOCAL JURISDICTION STANDARD SPECIFICATIONS AND DETAILS SHALL GOVERN ALL WATER AND SEWER CONSTRUCTION CONSTRUCTION ACTIVITIES.
4. EXISTING UTILITY LOCATIONS ARE APPROXIMATE AND SHOULD BE VERIFIED FOR LOCATION AND NUMBER BY THE CONTRACTOR.
5. CONTRACTOR IS RESPONSIBLE FOR LOCATION AND PROTECTION OF ALL EXISTING UTILITIES. ACCIDENTAL BREAKS OR INTERRUPTIONS IN SERVICE TO EXISTING UTILITIES, WHETHER DETECTED ON THESE DRAWINGS OR NOT, SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR IS RESPONSIBLE FOR WORKING AROUND ALL UTILITIES. NOTIFYING ENGINEER OF ANY CONFLICTS BETWEEN NEW AND EXISTING UTILITIES PRIOR TO INSTALLATION.
6. ALL WATER AND SEWER LINES ARE TO BE LOCATED BY USE OF WIRE OR LANTERN TAPES.
7. SANITARY SEWER PIPE SHALL BE PVC SDR 26 ASTM 3034 OR PIPES LESS THAN 16" DEEP AND GREATER THAN 4" DEEP UNLESS OTHERWISE NOTED. PVC PIPE SHALL BE BELL AND SPIGOT TYPE WITH INTEGRAL BELL AND RUBBER GASKETS. OTHER PIPE SHALL BE DUCTILE IRON CLASS 50 AWA C155, ANS1 A21.51 WITH 150 PSI OR MECHANICAL JOINTS.
8. ALL SANITARY SEWER LATERALS SHALL BE PVC SDR 26 AND INSTALLED AT 4-INCH MINIMUM. LATERALS SHALL BE INSTALLED AT MINIMUM 1% SLOPE. SEE PLUMBING PLANS FOR CONTINUATION AT BUILDING.
9. ALL CONNECTIONS TO STRUCTURES REQUIRE KOR-N-SEAL OR EQUAL RUBBER BOOTS.
10. ALL WATER PIPE 3" AND SMALLER SHALL BE PVC SCH 80 OR TYPE K COPPER. CONTRACTOR SHALL MAINTAIN A MINIMUM OF 4" COVER OVER ALL SEWER AND WATER LINES. THE MINIMUM HORIZONTAL SEPARATION BETWEEN THE CLOSEST TWO POINTS OF WATER AND SEWER LINE IS TEN FEET (10'). THE MINIMUM VERTICAL SEPARATION BETWEEN THE CLOSEST TWO POINTS OF WATER AND SEWER LINES IS EIGHTEEN INCHES (18").
11. ELECTRIC, TELEPHONE AND GAS LINES, INCLUDING SERVICE LINES, SHALL BE CONNECTED AND INSTALLED BY THE CONTRACTOR. THIS INCLUDES ANY PERMITTING OR CONNECTION FEES THAT MAY BE REQUIRED. ALL UTILITIES TO BE CONSTRUCTED IN ACCORDANCE WITH THE APPROPRIATE UTILITY COMPANIES SPECIFICATIONS.
12. THE BUILDING CONTRACTOR IS RESPONSIBLE FOR LOCATION, SIZE AND SPECIFICATIONS OF ALL ELECTRICAL PADS FROM THE LOCAL POWER COMPANY AND PROVIDING SERVICE FROM THE TRANSFORMER OR LOCAL UTILITY TO THE BUILDING.

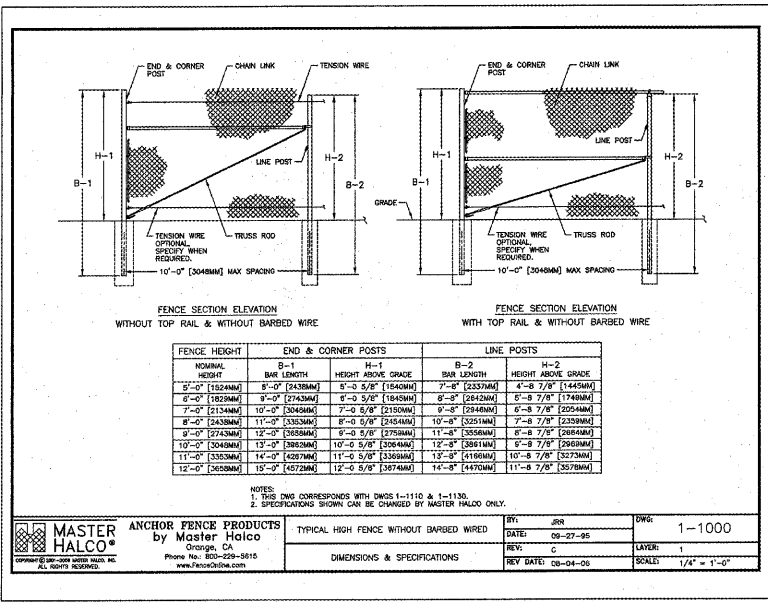

CONCRETE SIDEWALK DETAIL
SCALE: N.T.S.

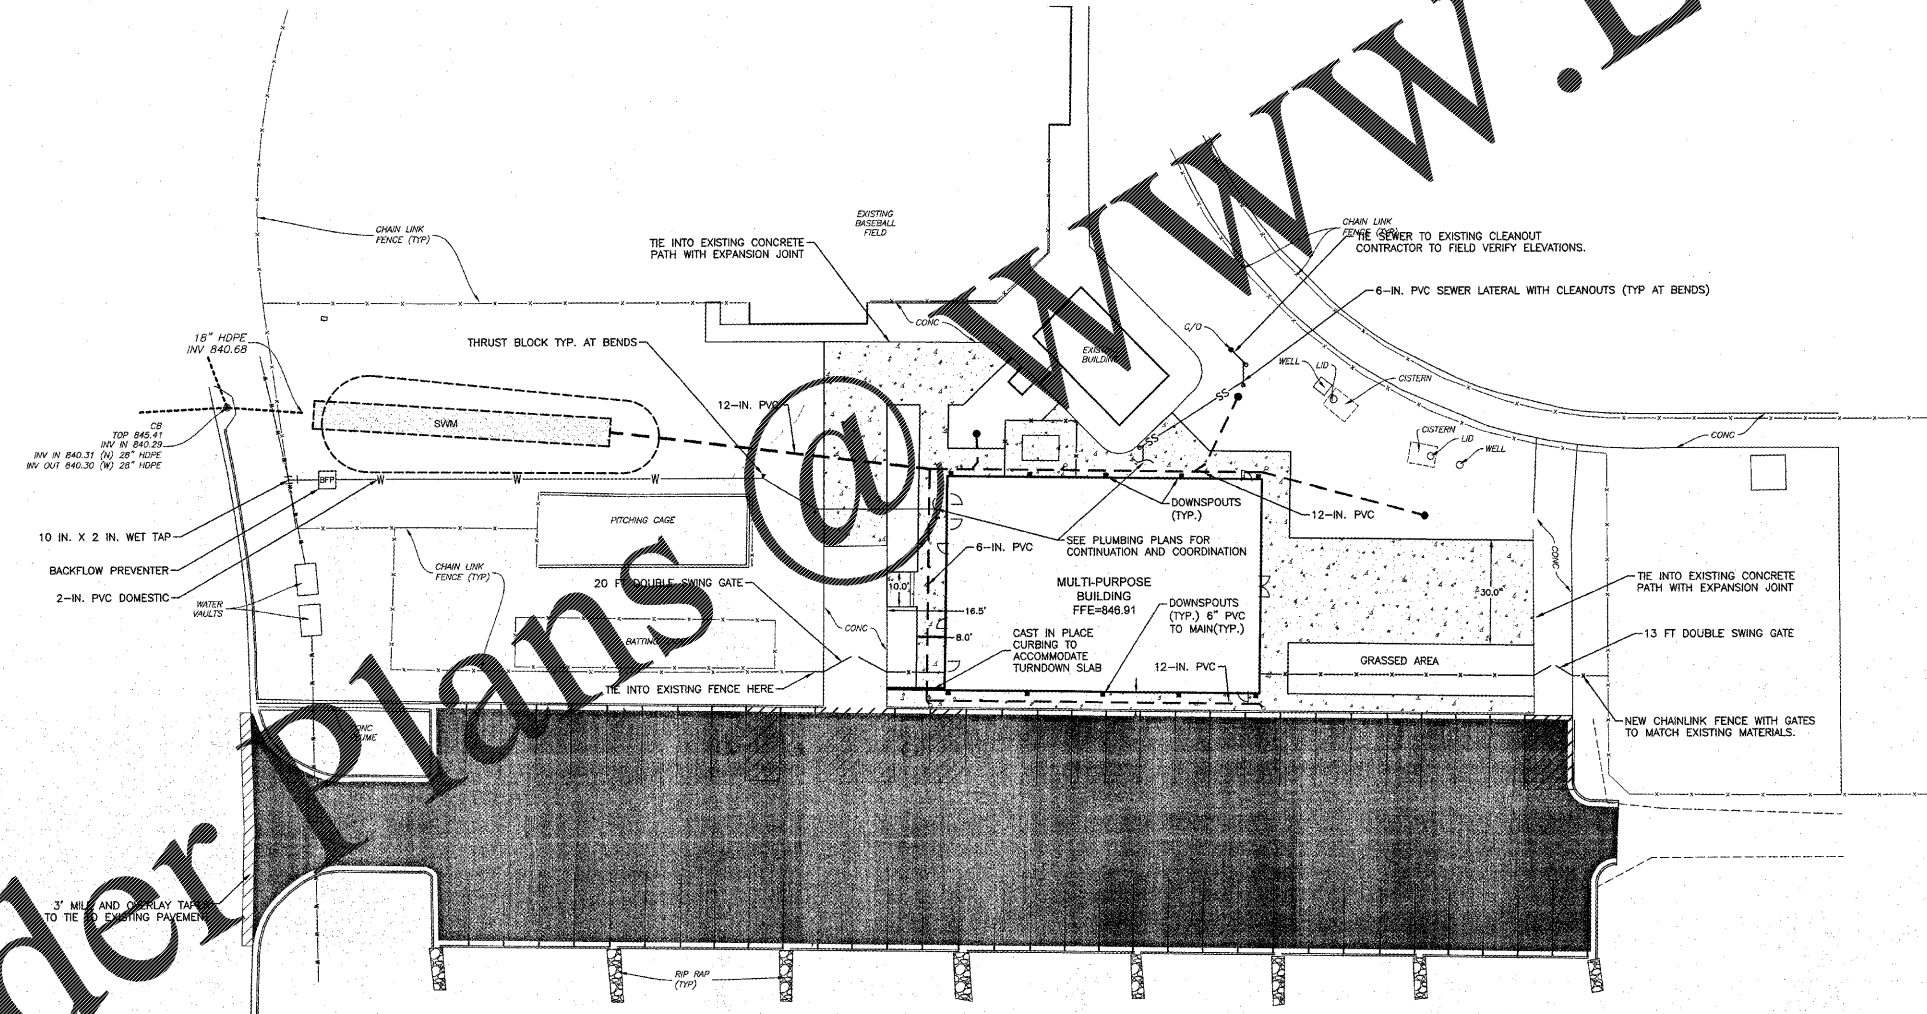

PAVING NOTES:
 1. PAVE EXISTING GAB WITH 2-IN. TOPPING SURFACE
 2. CONTRACTOR SHALL RECOMPACT EXISTING GAB (AND ADD IF NECESSARY) PRIOR TO PAVING.

Order Plans

CONSTRUCTION PLANS
 FOR
 WHITEWATER HIGH SCHOOL
 MULTI-PURPOSE BUILDING

SITE & UTILITY PLAN



Know what's below.
 Call before you dig.

DRAWING NO.
 C2.00
 SHEET 3 OF 5