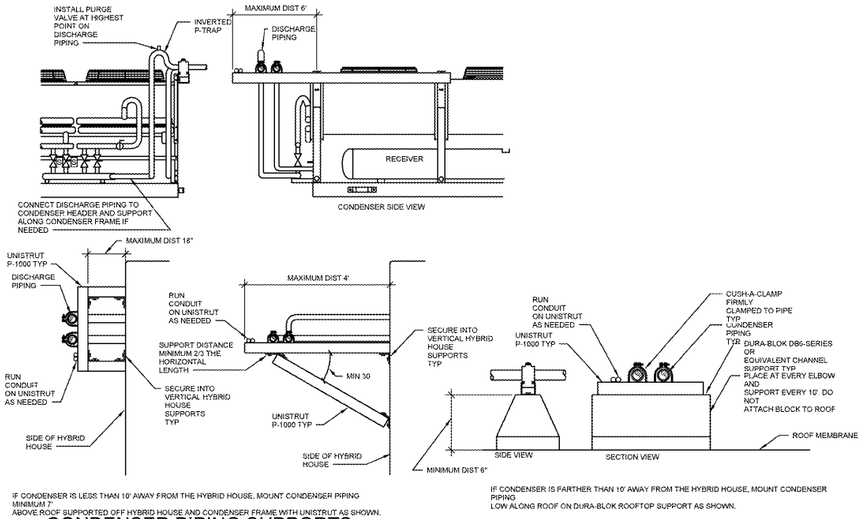

11 CONDENSER PIPING SUPPORTS
NTS

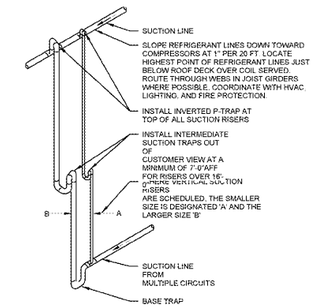

10 VERTICAL SUCTION DOUBLE RISER
NTS



REFRIGERATION ISOLATION VALVES
9 NTS

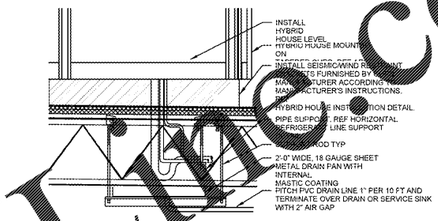

8 ROOF MOUNTED HYBRID HOUSE

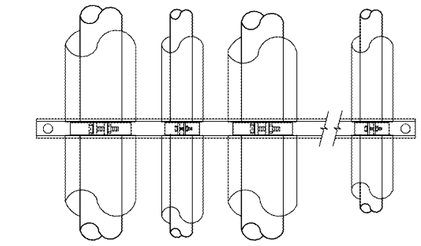

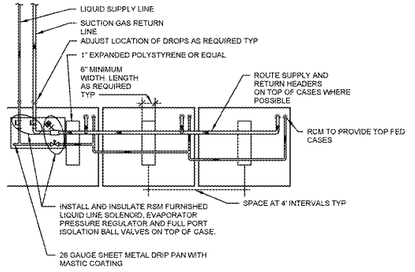

7 DX CASE PIPING
NTS

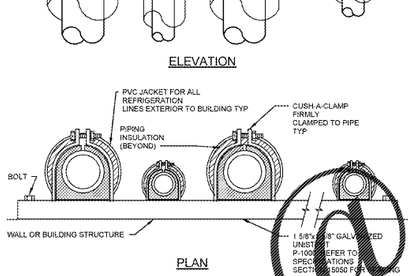

6 VERTICAL REFRIGERANT LINE SUPPORT
NTS

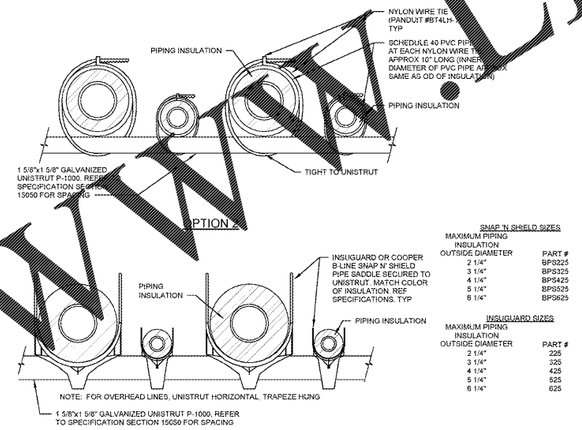

SNAP 'N SHIELD SIZES

MAXIMUM PIPING INSULATION OUTSIDE DIAMETER	PART #
2 1/4"	BPS225
3 1/4"	BPS325
4 1/4"	BPS425
5 1/4"	BPS525
6 1/4"	BPS625

INSULGUARD SIZES

MAXIMUM PIPING INSULATION OUTSIDE DIAMETER	PART #
2 1/4"	225
3 1/4"	325
4 1/4"	425
5 1/4"	525
6 1/4"	625

5 HORIZONTAL REFRIGERANT LINE SUPPORT
NTS



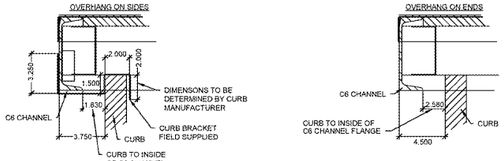

RESTRAINT BRACKETS ARE FURNISHED WITH ROOF CURBS. GASKET (PIRES-ON P8600 SERIES VINYL NITRILE FOAM MOUNTING TAPE, 0.25" THICKNESS, 1.5" WIDTH, OR EQUAL) FURNISHED BY CURB SUPPLIER, INSTALLED BY CONTRACTOR BETWEEN CURB AND HYBRID HOUSE. INSTALL BRACKETS THEN GASKET BEFORE PLACEMENT OF HYBRID HOUSE. BRACKET CONSTRUCTION, QUANTITIES, AND SPACING SHOWN ON THIS DETAIL ARE FOR GENERAL COORDINATION ONLY. INSTALL BRACKETS ACCORDING TO CURB MANUFACTURER'S INSTALLATION INSTRUCTIONS. COORDINATE FINAL BRACKET LOCATIONS WITH EQUIPMENT MANUFACTURER. DO NOT OBSTRUCT OPENINGS OR UTILITY CONNECTIONS.

4 HYBRID HOUSE INSTALLATION
NTS

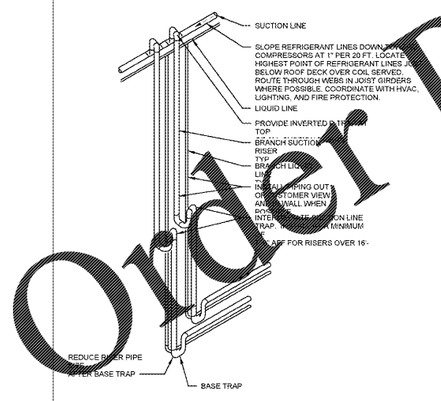

3 INTERMEDIATE SUCTION LINE TRAP
NTS

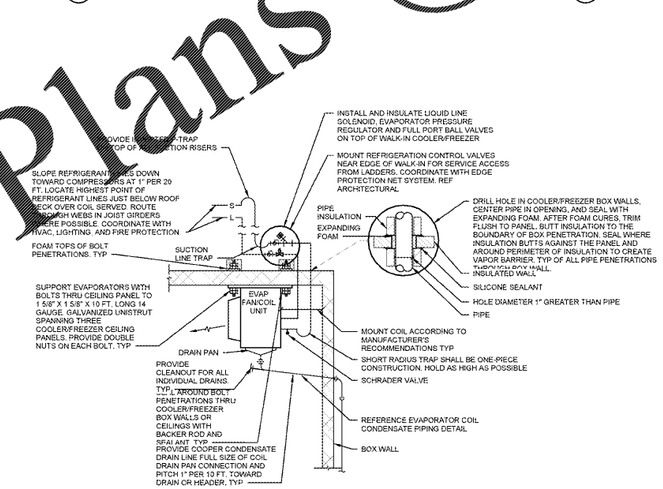

2 EVAPORATOR COIL PIPING
NTS

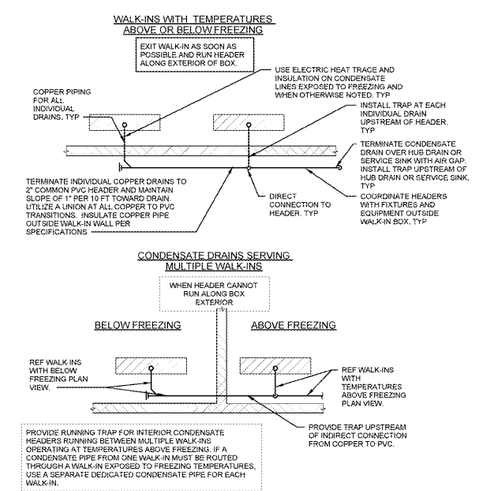

1 EVAPORATOR COIL CONDENSATE PIPING
NTS

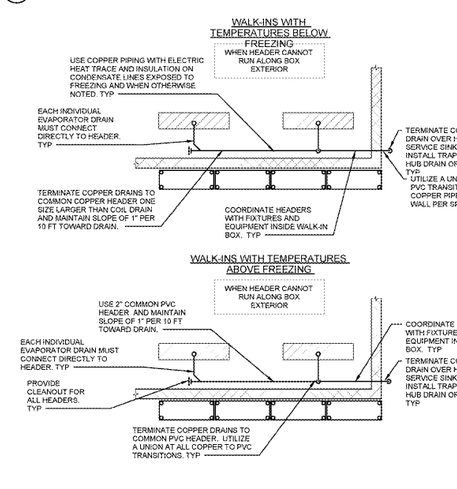

Order Plans @ WWW.LDI.INC.com

STIPULATION FOR REUSE

ANY DRAWING(S) AND/OR SPECIFICATION(S) PREPARED BY MPW ENGINEERING, LLC ("MPW") ARE SUBJECT TO COPYRIGHT PROTECTION AS AN "ARCHITECTURAL WORK" UNDER SECTIONS 102 AND 120 OF THE COPYRIGHT ACT, 17 U.S.C. AS AMENDED DECEMBER 1990. ALL RIGHTS RESERVED. USE OF THESE DRAWINGS AND/OR SPECIFICATIONS FOR ANY PROJECT OTHER THAN THE PROJECT FOR WHICH THEY WERE PREPARED BY MPW, AND ANY REPRODUCTION OF THESE DRAWINGS AND/OR SPECIFICATIONS WITHOUT THE WRITTEN PERMISSION OF MPW, IS STRICTLY PROHIBITED. VISUAL CONTACT WITH THESE DRAWINGS AND/OR SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.

CONSULTANTS

MPW
MPW ENGINEERING, LLC
1475 ZOO CREW LANE, SUITE 100, WINTER PARK, FL 32789
(407) 647-1900 | WWW.MPWENGINEERING.COM

Walmart

APOPKA, FL
STORE NO. 6894
097-16 (05) PROTO
JOB NUMBER: 411.2

ISSUE BLOCK

CHECKED BY:	MMM
DRAWN BY:	PMD
FILE NAME:	R3
PROTO CYCLE:	10/28/16
DOCUMENT DATE:	01/06/17

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT C WEBB , PE ON THE DATE AND/OR TIME STAMP SHOWN USING A DIGITAL SIGNATURE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

REFRIG DETAILS

SHEET: R3