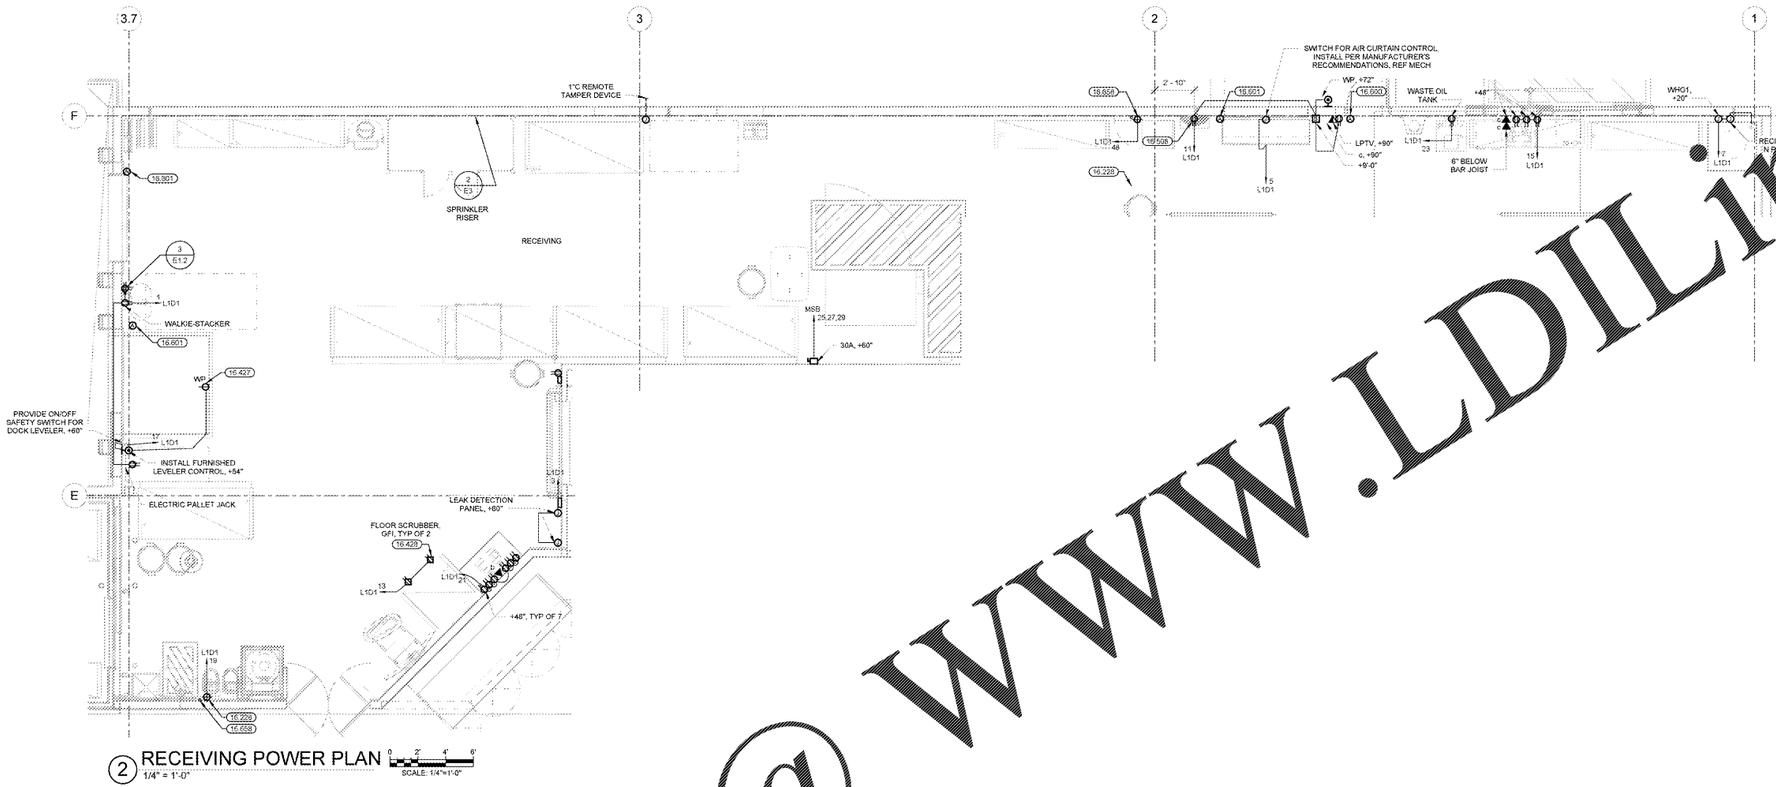

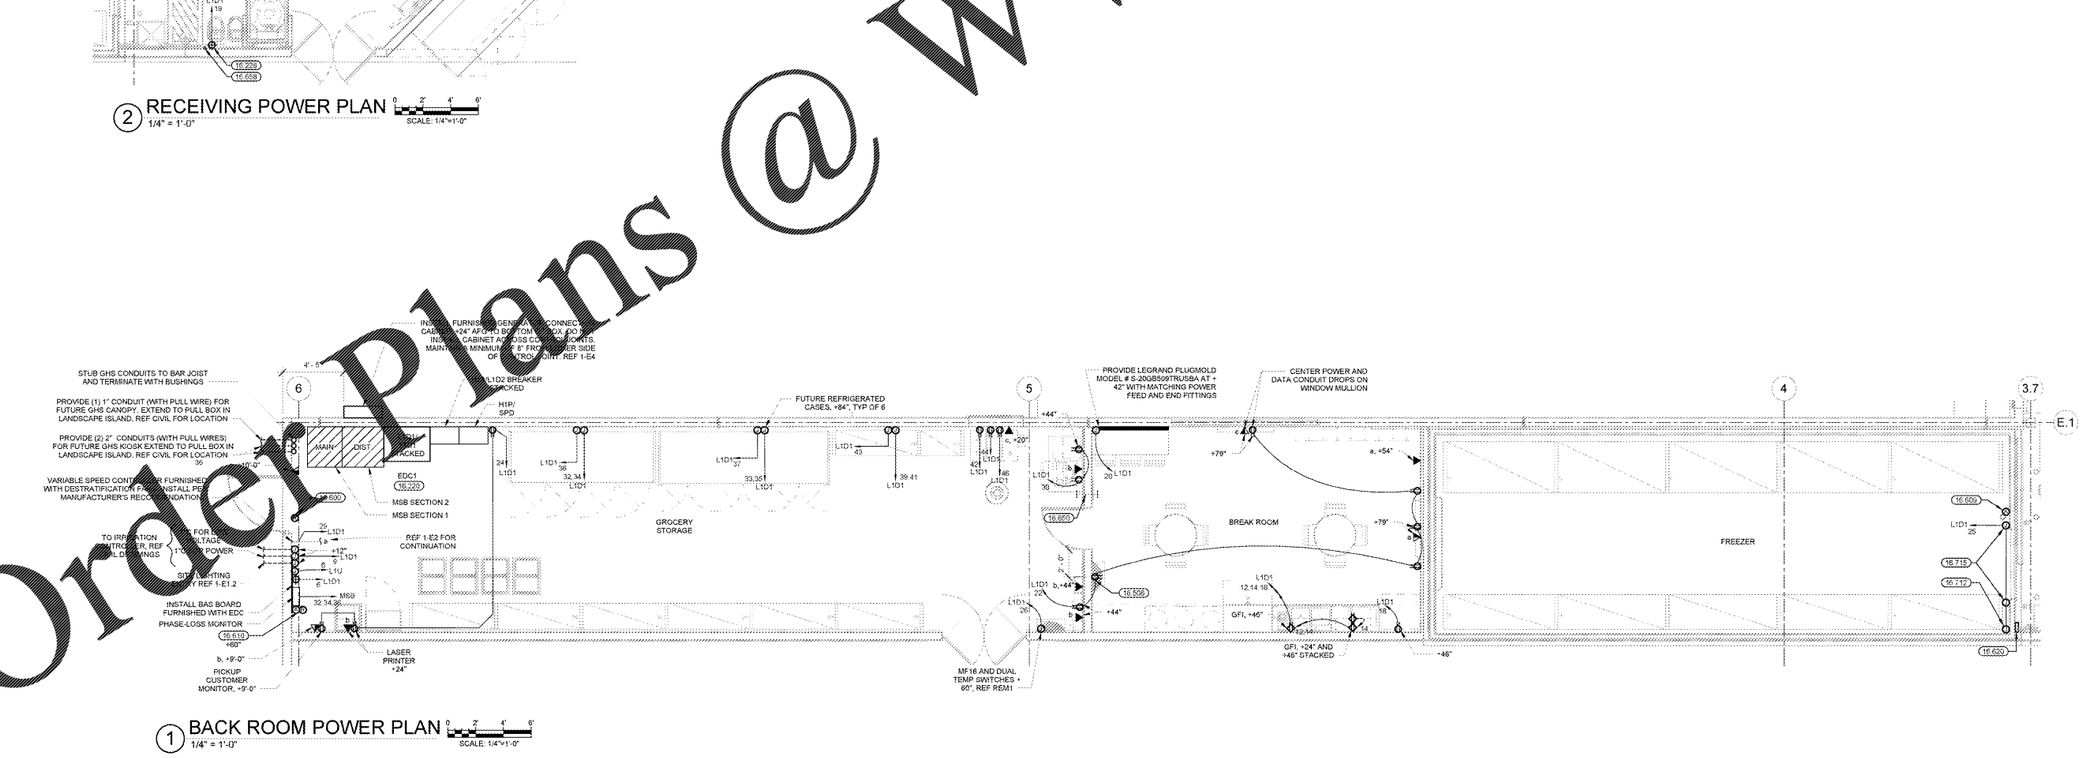

KEYNOTES

16.220	INSTALL PREFABRICATED ELECTRICAL DISTRIBUTION CENTER (EDC). EQUIPMENT AND INTERNAL WIRING ARE SHOWN FOR INFORMATION PURPOSES ONLY. THE ENTIRE ASSEMBLY WILL ARRIVE COMPLETELY PRE-WIRED AND IS CERTIFIED BY A NATIONALLY RECOGNIZED TESTING LABORATORY FOR ITS INTENDED USE
16.228	INSTALL RECEPTACLE IN PROVIDED DATA ENCLOSURE. COORDINATE LOCATION OF RECEPTACLE WITH ISD CABLE VENDOR. FINAL LOCATION TO BE DETERMINED BY CABLE AND TELECOM SERVICES.
16.427	PROVIDE RECEPTACLE AND 3/4" CONDUIT FROM FURNISHED LEVELER PUSH BUTTON CONTROLLER TO RECEPTACLE IN DOCK WELL PER MANUFACTURER'S INSTRUCTIONS
16.428	PROVIDE UNISTRUT TO MOUNT DEVICE DIRECTLY BELOW LOWEST BEAM ON RACK. UTILIZE EXISTING HOLES IN RACK POSTS. BOLT UNISTRUT TO THE BACK SIDE OF FRONT POST
16.504	INSTALL CONTROL PANEL FURNISHED WITH DESTRATIFICATION FAN. PROVIDE FACTORY-MOUNTED AND WIRED DISCONNECT SWITCH.
16.600	PROVIDE SURFACE MOUNTED 4" SQUARE JUNCTION BOX (WITH VERTICAL RACEWAY) MOUNTED 6" ABOVE BAR JOISTS AND 8" IN FROM STRIKE SIDE OF DOOR
16.601	PROVIDE SURFACE MOUNTED ALARM JUNCTION BOX (WITH VERTICAL RACEWAY) MOUNTED ADJACENT TO AND EVEN WITH TOP OF DOOR FRAME
16.605	INSTALL FURNISHED ALARM JUNCTION BOX AT +90", PENETRATE COOLER WALL, AND ROUTE VERTICAL RACEWAY UP EXTERIOR SIDE OF COOLER WALL TO STRUCTURE. MINIMIZE EXPOSED CONDUIT ROUTED INSIDE COOLER BOXES. COORDINATE EXACT LOCATION WITH FIRE ALARM INSTALLER PRIOR TO ROUGH-IN.
16.610	PROVIDE SURFACE MOUNTED ALARM JUNCTION BOX (WITH VERTICAL RACEWAY) AT +84" (UNLESS NOTED OTHERWISE)
16.620	NEMA ENCLOSURE FOR INVENTORY MANAGEMENT SYSTEM AND CONDUIT PENETRATION INTO COOLER/FREEZER WALL, PROVIDED BY OTHERS. PROVIDE 3/4" CONDUIT FROM FURNISHED ENCLOSURE TO STRUCTURE AND TERMINATE WITH BUSHINGS. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH ISD CABLE VENDOR PRIOR TO INSTALLATION
16.650	CONDUIT SLEEVE: PROVIDE 1-1/2" CONDUIT SLEEVE WITH BUSHINGS ABOVE BAR JOIST (UNLESS NOTED OTHERWISE)
16.658	CONDUIT SLEEVE: PROVIDE 2" CONDUIT (WITH PULL WIRE) FROM BAR JOIST TO PROVIDED DATA ENCLOSURE AND TERMINATE WITH COUPLER AND THREADED BUSHINGS. COORDINATE FINAL LOCATION WITH CABLE AND TELECOM SERVICES PRIOR TO INSTALLATION.
16.712	SURFACE MOUNT WP JUNCTION BOX ON WALL 24" BELOW COOLER/FREEZER BOX CEILING FOR CONDENSATE DRAIN HEAT TRACE TAPE. PROVIDE LIQUID-TIGHT FLEXIBLE METAL CONDUIT CONNECTION TO HEAT TAPE.
16.715	JUNCTION BOX PROVIDED WITH COOLER/FREEZER PANEL FOR CONNECTION TO LIGHTS AND/OR DOOR HEATERS. PROVIDE WEATHERPROOF EXTENSION AND COVERPLATE FOR RECESSED JUNCTION BOXES AS REQUIRED. FINAL TERMINATIONS BY REFRIGERATION CONTRACTOR.

ALL CONDUITS INSTALLED ON TOP OF WALK IN COOLERS AND FREEZERS SHALL BE A MINIMUM OF 6" FROM ANY EDGE TO ALLOW SPACE FOR EDGE PROTECTION NETTING. DO NOT ROUTE CONDUITS ABOVE THE CEILING GRID ACCESS UNLESS CONDUITS ARE INSTALLED IN JOIST SPACE, REF ARCH

STIPULATION FOR REDACTED PLANS

CONSULTANTS

MPW

MPW ENGINEERING, LLC
1417 ATLANTIC BOULEVARD
JACKSONVILLE BEACH, FLORIDA 32233
(904) 372-1000

Walmart

APOPKA, FL
STORE NO. 6894
JOB NUMBER: 097-15-005 PROTO: 41.2

ISSUE BLOCK

03/10/17	REV #3
04/07/17	REV #5

CHECKED BY:	ABM
DRAWN BY:	DJA
FILE NAME:	E2.2
PROTO CYCLE:	10/28/16
DOCUMENT DATE:	01/09/17

BID SET.
NOT FOR CONSTRUCTION

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY AARON MORSE , PE ON THE DATE AND/OR TIME STAMP SHOWN USING A DIGITAL SIGNATURE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

ENLARGED POWER PLANS

SHEET
E2.2

Order Plans @ WWW.LDILine.com