KEYNOTES	
11.108	SUMP SENSOR TO REST ON THE LOWEST POINT OF SUMP ENCLOSURE. SECURE SENSOR USING MANUFACTURERS UNIVERSAL MOUNTING KIT.
11.127	SET RIM OF MANHOLE 1" ABOVE SURROUNDING GRADE. SLOPE CONCRETE AWAY FROM MANHOLE AT MAXIMUM 1/4" PER FOOT.

ELECTRICAL SEAL-OFFS NOT SHOWN. EC SHALL PROVIDE SEAL-OFFS FOR ALL CONDUITS. ALL SEAL-OFFS AND J-BOXES TO BE 1" MINIMUM ABOVE PENETRATIONS. REFER TO FUEL STATION ELECTRICAL DRAWINGS

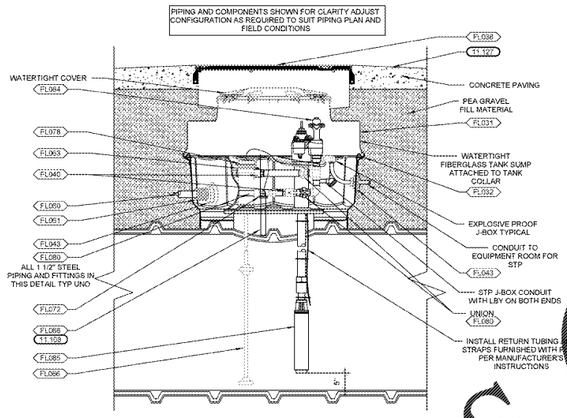

6 DIESEL STP SUMP SECTION
NTS

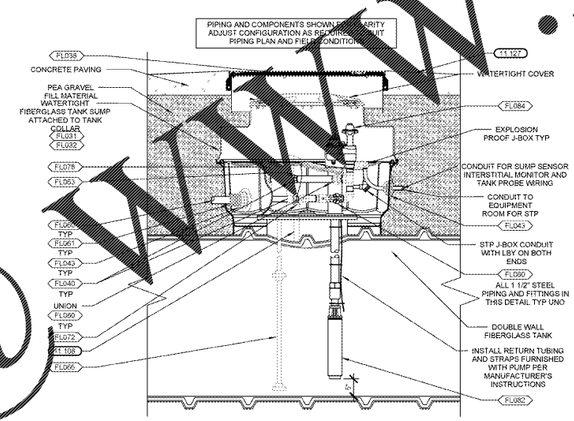

5 SUPER UNLEADED STP SUMP SECTION
NTS

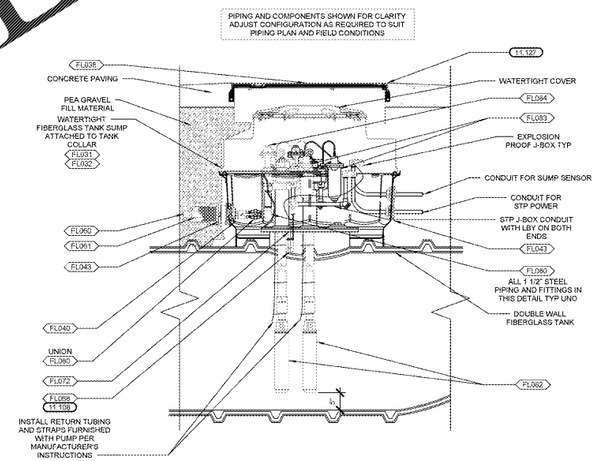

4 UNLEADED STP SUMP SECTION
NTS

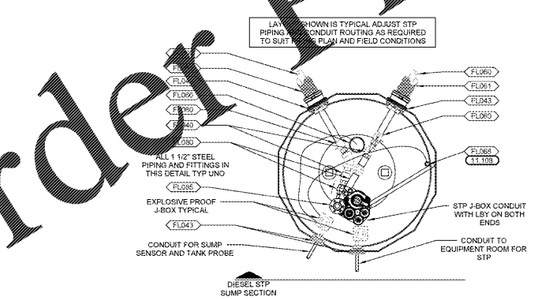

3 DIESEL STP SUMP PLAN
NTS

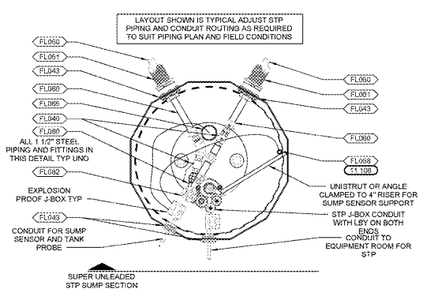

2 SUPER UNLEADED STP SUMP PLAN
NTS

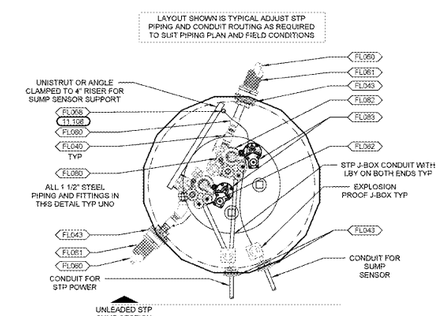

1 UNLEADED STP SUMP PLAN
NTS

Order Plans @ WWW.LDILine.com

STIPULATION FOR RELEASE

CONSULTANTS
MPW
MPW ENGINEERING, LLC
LAKE ZURICH, ILLINOIS 60047 PH: 224.293.2441
CORPORATE OFFICE: 1751 OAK TREE ROAD, SUITE 3, EDISON, NJ 08820 PH: 732.572.0700

Walmart
APOPKA, FL
STORE NO. 6994
997-15-005 PROTO
JOB NUMBER: WAMS-742

ISSUE BLOCK

CHECKED BY:	MWM
DRAWN BY:	TDT
FILE NAME:	FST3
PROTO CYCLE:	02/16/17
DOCUMENT DATE:	04/07/17

BID SET.
NOT FOR CONSTRUCTION

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT C WEBB, PE ON THE DATE AND/OR TIME STAMP SHOWN USING A DIGITAL SIGNATURE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

DISPENSER AND TANK SUMP DETAILS

SHEET
FST3