




KEYNOTES	
16.801	SEAL-OFF ALL CONDUIT THAT ENTER OR PASS THRU A CLASSIFIED AREA. REF: 2-FSE3.1
16.811	1 - 1" CONDUIT WITH SEAL-OFF INSIDE COLUMN BY CANOPY MANUFACTURER. REF TO CANOPY MANUFACTURER'S DRAWINGS FOR EXACT LOCATION OF COLUMN. SEAL AFTER CIRCUITS HAVE BEEN PULLED, TESTED, AND ARE FUNCTIONING PROPERLY.
16.840	PROVIDE 1" GRC FROM SECURITY CAMERA IN CANOPY DECK TO DATA CONDUIT WRING CABINET, WITH SEAL-OFFS AT EACH END. CONTRACTOR TO MAKE CONNECTION AT EACH COLUMN BASE AND CONTINUE CONDUIT FROM TOP OF COLUMN TO JUNCTION BOX AT DECK FAN. SECURITY CAMERA CABLING AND EQUIPMENT SUPPLIED AND INSTALLED BY OWNER. REF: 1-FSE1 FOR EXACT CANOPY COLUMN LOCATIONS.
16.842	INSTALL SITE MONITOR PANEL. FURNISHED BY OWNER. DIRECT CONNECT. PROVIDE ISOLATED GROUNDING CONDUCTOR PER MANUFACTURER'S INSTRUCTIONS. ON ALL TERMINATIONS, PROVIDE ISOLATED PER RECOMMENDATION OF MANUFACTURER. REF: 1-FSE5.

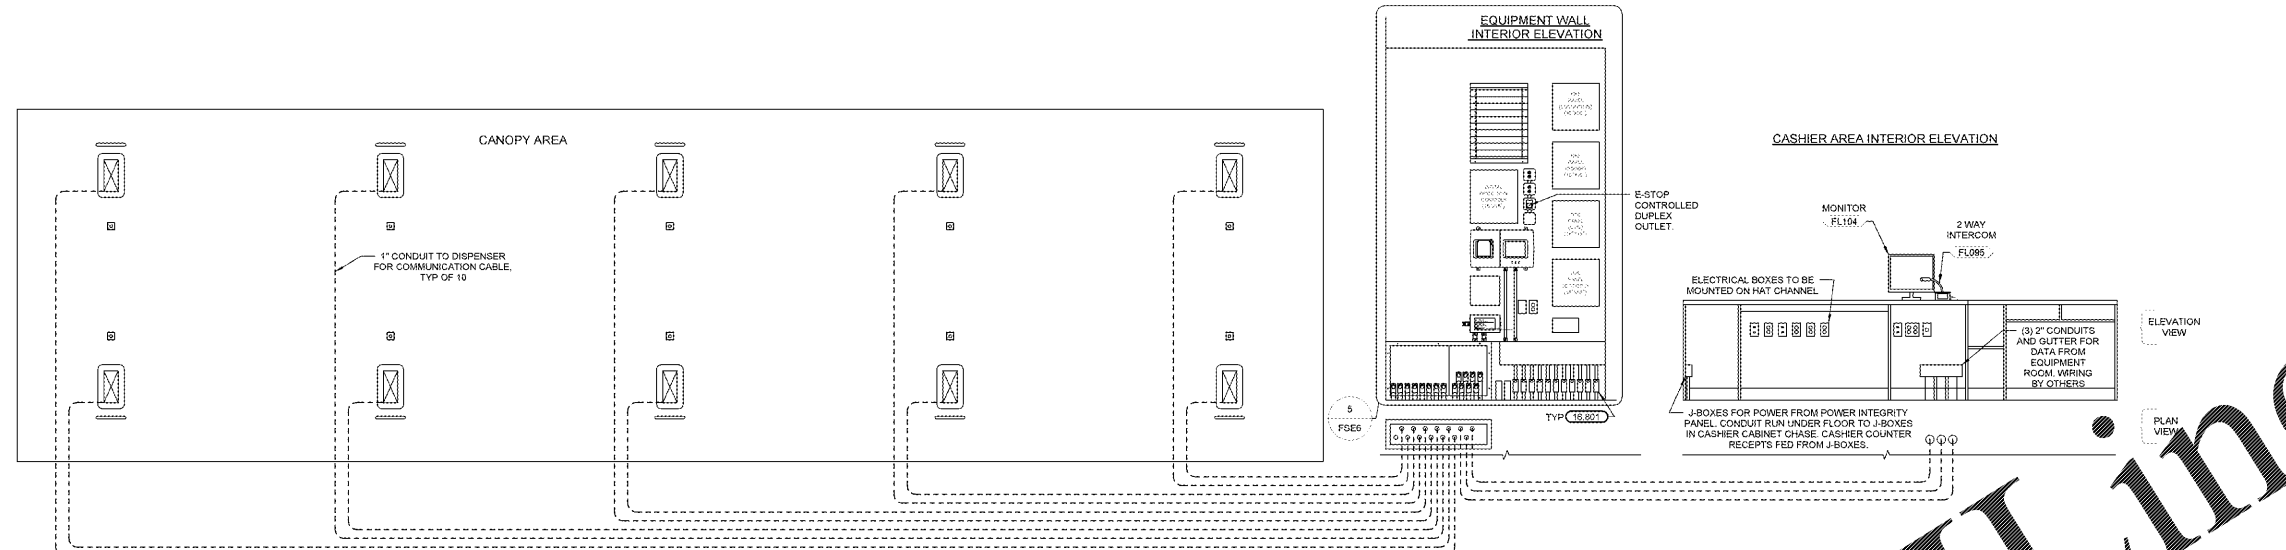

3 COMMUNICATION ONE-LINE DIAGRAM
NTS

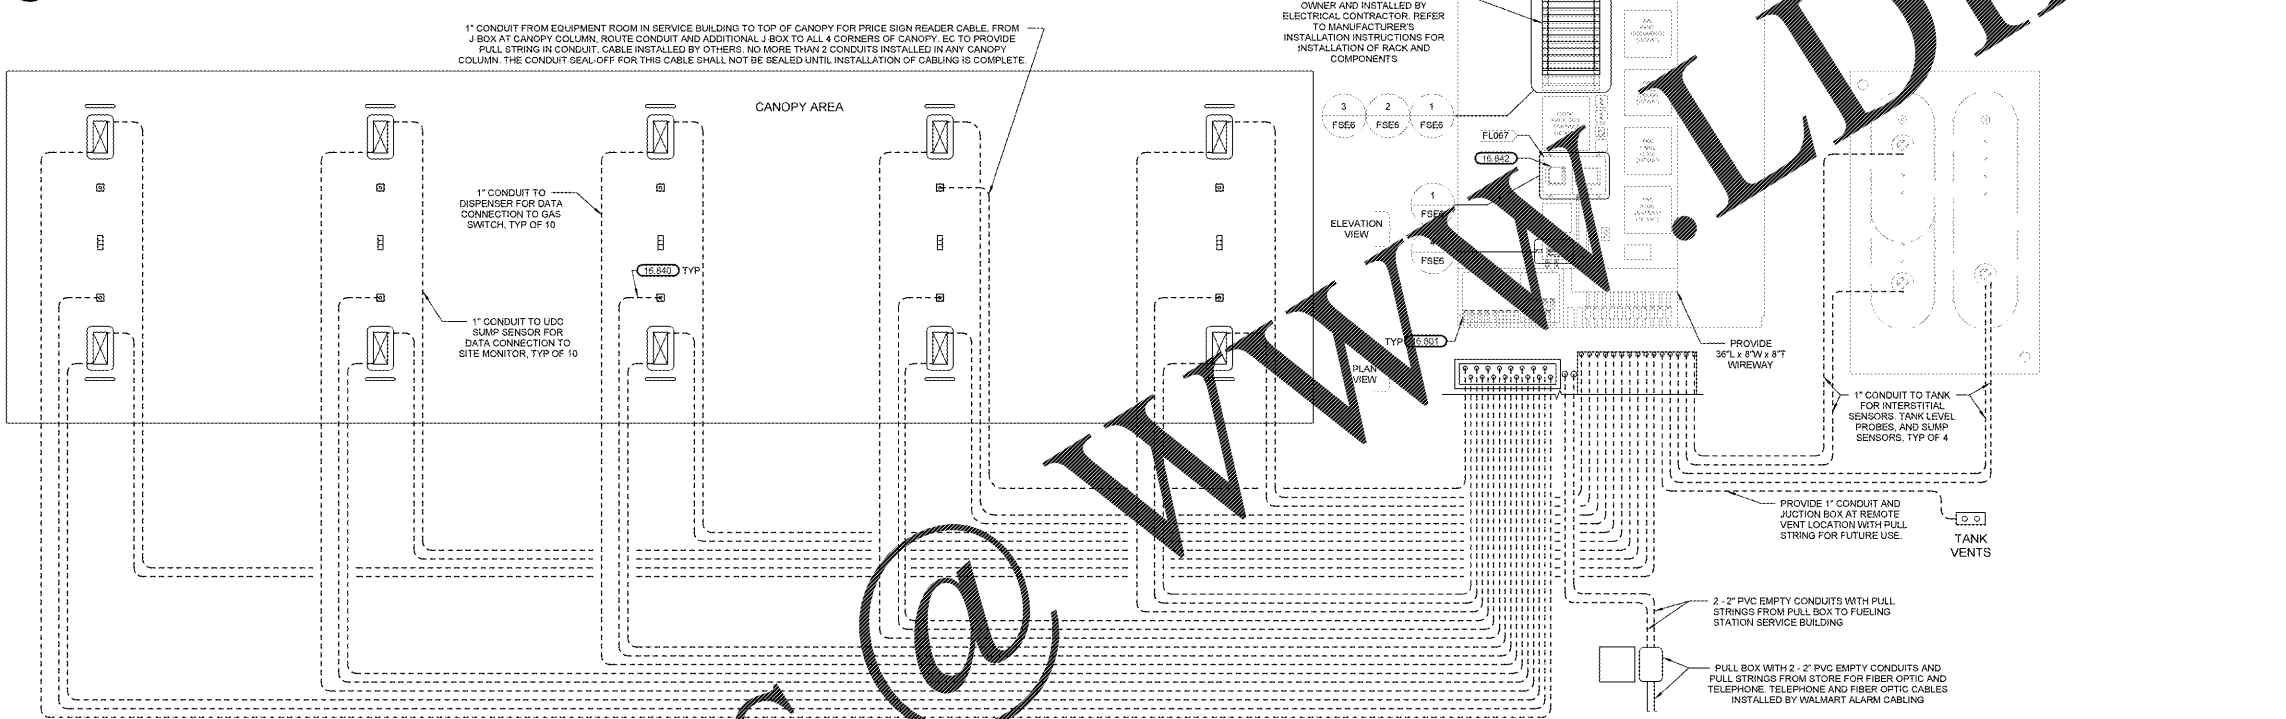

2 DATA/SITE MONITORING ONE-LINE DIAGRAM
NTS

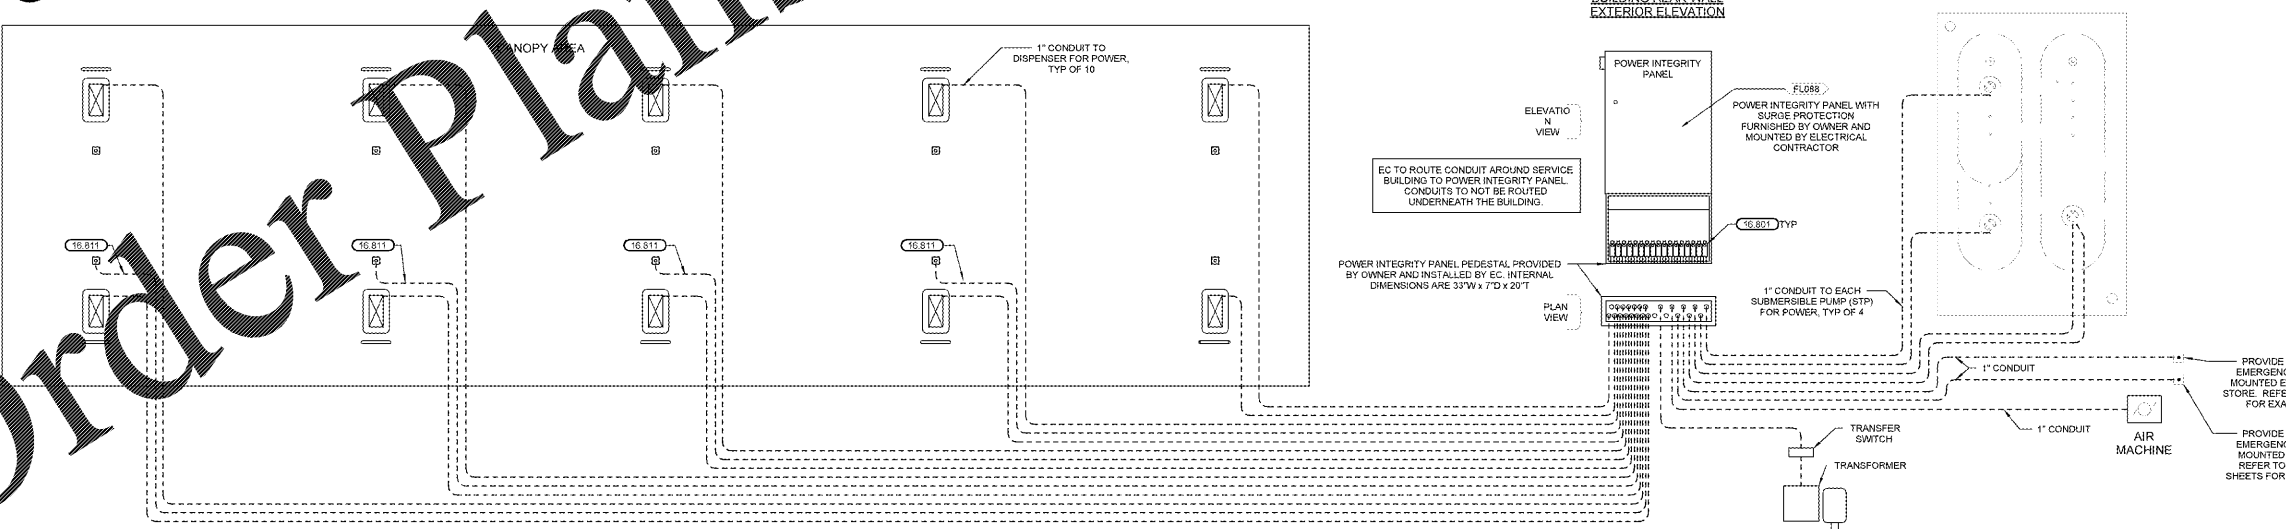

1 POWER ONE-LINE DIAGRAM
NTS

STIPULATION FOR THE...
THIS DOCUMENT IS THE PROPERTY OF...
IT IS TO BE USED ONLY FOR THE PROJECT...
IT IS NOT TO BE REPRODUCED, COPIED, OR...
DISTRIBUTED IN ANY MANNER WITHOUT THE...
WRITTEN PERMISSION OF THE...
DATE: 02/10/17

MPW
MPW ENGINEERING, LLC
1100 S. UNIVERSITY AVENUE, SUITE 100
APOKA, FL 32703
TEL: 407-881-1100
WWW.MPWENGINEERING.COM

Walmart
APOKA, FL
STORE NO. 6884
JOB NUMBER: 097-15-006 | PHOTO: WMS-740

ISSUE BLOCK	

CHECKED BY: JJA
DRAWN BY: DJA
FILE NAME: FSE4
PROTO CYCLE: 02/10/17
DOCUMENT DATE: 04/07/17

BID SET.
NOT FOR
CONSTRUCTION

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY JARON MORSE. PE ON THE DATE AND/OR TIME STAMP SHOWN USING A DIGITAL SIGNATURE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

SITE CONDUIT DIAGRAMS

SHEET: FSE4

Order Plans

@

WWW.LDILine.com

ONE-LINE DIAGRAM SHOWN FOR REPRESENTATIVE PURPOSE ONLY. FUELING CONTRACTOR SHALL COORDINATE ALL CONDUITS AND CONDUCTORS.