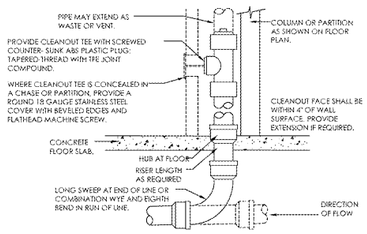

PROVIDE WCO WHERE SHOWN ON PLAN, AND ON SANITARY WASTE BRANCHES NOT SERVED WITH A FLOOR CLEANOUT; LOCATE ABOVE FIXTURE FLOOD RIM WITHIN 4' OF FLOOR. CONSULT LOCAL CODES FOR OTHER WCO REQUIREMENTS.

WALL CLEANOUT DETAIL

SCALE: N.T.S.

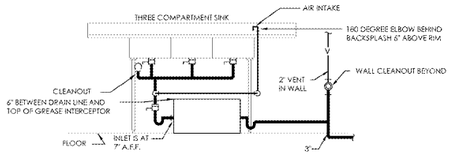

VERIFY ALL REQUIREMENTS WITH L.L. PRIOR TO INSTALL & BID.

LOCATE GREASE TRAP IN FLOOR NOT WHERE PEOPLE STAND BUT WHERE TOP CAN BE EASILY REMOVED FOR CLEANING

ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT FIELD CONDITIONS OR MEET LOCAL CODE REQUIREMENTS. UTILIZE HUBLESS CAST IRON PIPE, FITTINGS AND CONNECTIONS FOR SINK CONNECTIONS. CONNECT GREASE TRAP FROM MID POINT OF SINK; PROVIDE P-TRAP IF GREASE TRAP IS MORE THAN 4' FROM SINK.

THREE COMPARTMENT SINK DETAIL

SCALE: N.T.S.

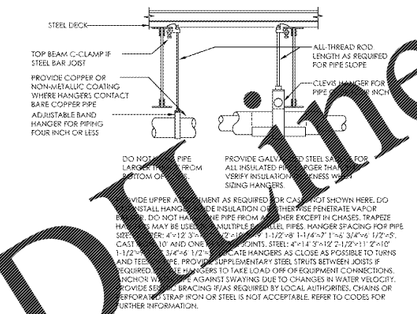

DO NOT [illegible] PIPE LARGER [illegible] FROM BOTTOM O[illegible]

PROVIDE GALVA[illegible] STEEL SADDLE FOR ALL INSULATED P[illegible] LARGER THA[illegible] VERIFY INSULATION THICKNESS W[illegible] SIZING HANGERS.

PROVIDE UPPER A[illegible]MENT AS REQUIRED FOR CASE NOT SHOWN HERE. DO NOT INSTALL HANGERS OVER INSULATION OVER THERMOSE PENETRATE VAPOR BARRIER. DO NOT HANG THE PIPE FROM ANOTHER EXCEPT IN CHASES. TRAPEZE HANGERS MAY BE USED FOR MULTIPLE PARALLEL PIPES. HANGER SPACING FOR PIPE SIZES UNDER: 4"=12' 3"=10' 2"=8' 1-1/2"=8' 1-1/4"=7' 1"=6' 3/4"=6' 1/2"=5'. CAST IRON 10' AND ONE PER JOINTS. STEEL: 4"=14' 3"=12' 2-1/2"=11' 2"=10' 1-1/2"=9' 1-1/4"=8' 1"=7' 3/4"=6' 1/2"=5'. PLACE HANGERS AS CLOSE AS POSSIBLE TO TURNS AND TEES OF PIPE. PROVIDE SUPPLEMENTARY STEEL STRUTS BETWEEN JOISTS IF REQUIRED TO USE HANGERS TO TAKE LOAD OFF OF EQUIPMENT CONNECTIONS. PROVIDE MACHINE WITH SUPPORTS AGAINST SWAYING DUE TO CHANGES IN WATER VELOCITY. PROVIDE SEISMIC BRACING IF/AS REQUIRED BY LOCAL AUTHORITIES. CHAINS OR PERFORATED STRAP IRON OR STEEL IS NOT ACCEPTABLE. REFER TO CODES FOR FURTHER INFORMATION.

PIPE HANGER DETAIL

SCALE: N.T.S.

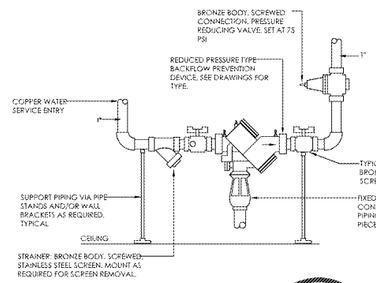

DETAIL SHOWS GENERAL SCHEMATIC REQUIREMENTS. PROVIDE BACKFLOW PREVENTER OF RPZ TYPE AND EQUAL MAKE & MODEL TO WATTS 009QT SERIES AS APPROVED BY LOCAL AUTHORITIES. PROVIDE PRESSURE REDUCING VALVE ONLY IF PRESSURE EXCEEDS 80 PSI - VERIFY. STRAINER AND REDUCING VALVE MAY BE INSTALLED IN VERTICAL PIPE IF SPACE LIMITATIONS REQUIRE IT. CLEAN STRAINER BEFORE TURNING BUILDING OVER TO OWNER. PROVIDE ANY REQUIRED CERTIFICATION OF TEST OF BACKFLOW PREVENTER TO LOCAL AUTHORITIES.

DOMESTIC WATER SERVICE ENTRY DETAIL

SCALE: N.T.S.



TRAP PRIMER DETAIL

SCALE: N.T.S.

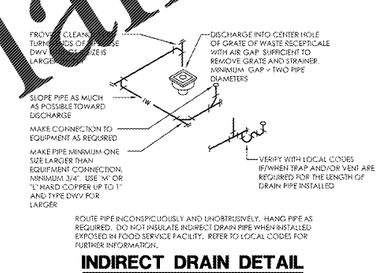

ROUTE PIPE INCONSPICUOUSLY AND UNOBTRUSIVELY. HANG PIPE AS REQUIRED. DO NOT INSULATE INDIRECT DRAIN PIPE WHEN INSTALLED EXPOSED IN FOOD SERVICE FACILITY. REFER TO LOCAL CODES FOR FURTHER INFORMATION.

INDIRECT DRAIN DETAIL

SCALE: N.T.S.

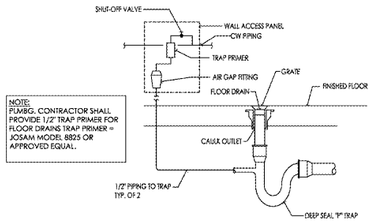

NOTE:
PLUMBG. CONTRACTOR SHALL PROVIDE 1/2" TRAP PRIMER FOR FLOOR DRAINS TRAP PRIMER = JOSAM MODEL 8825 OR APPROVED EQUAL.

FLOOR DRAIN DETAIL

SCALE: N.T.S.

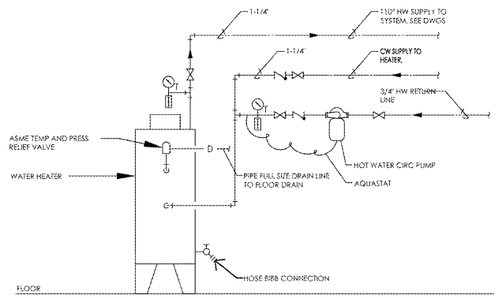

ELEC. WATER HEATER DETAIL

SCALE: N.T.S.

Order Plans @ WWW.LDLine.com

Bergmeyer
Architecture and Interiors
Bergmeyer Associates, Inc.
355 Boylston Street
Boston, MA 02116
Phone 617.357.5616
Fax 617.357.7505
www.bergmeyer.com

© Copyright Bergmeyer Associates, Inc.

dpce
DON PENN CONSULTING ENGINEER
1301 SOLANA BLVD.
BLDG. 1 | SUITE 1420
WESTLAKE, TX 76262
O 817.410.2850 | F 817.251.3411

NO.	BY	DATE	DESCRIPTION
MS		04/19/17	ISSUED FOR PERMIT
MS		03/24/17	ISSUED FOR LL REVIEW

SAVANNAH BEE ATLANTA

WESTSIDE PROVISIONS
1168 HOWELL MILL RD
ATLANTA, GA 30318

PLUMBING DETAILS PLAN

DRAWN BY:
REVIEWED BY
JOB NO.

P400