DEMOLITION NOTES:

1. REMOVE DEADLEG BACK TO MAIN. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND FIBERGLASS INSULATION.
2. CUT AND CAP DCW AND DHW PAST FEED FOR LAVATORY. ABANDON PIPES THAT CONTINUE UP THRU FLOOR SLAB ABOVE. REMOVE 1/2" DCW/DHW DEADLEGS BACK TO MAINS. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND INSULATION TO MATCH EXISTING. PATCH AND REPAIR WALL TO MATCH EXISTING.

GENERAL NOTES:

1. REFER TO THE DOMESTIC WATER DEAD LEG AND ASBESTOS ABATEMENT SCHEDULE FOR PIPING CONTAINING ASBESTOS INSULATION.

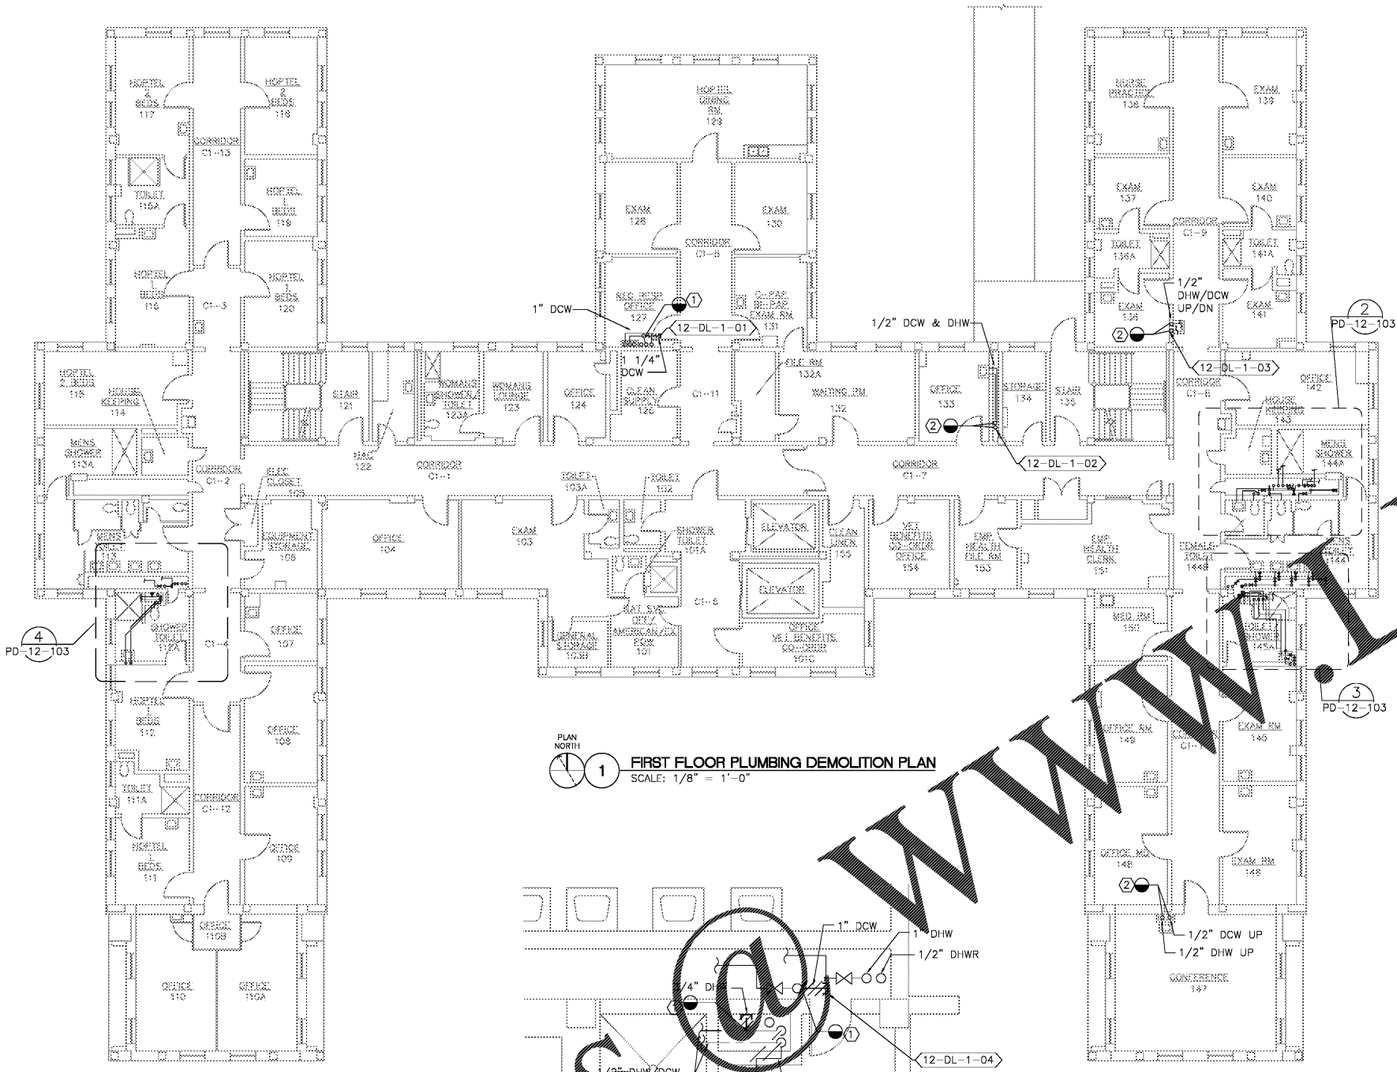

PLAN NORTH
1 FIRST FLOOR PLUMBING DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

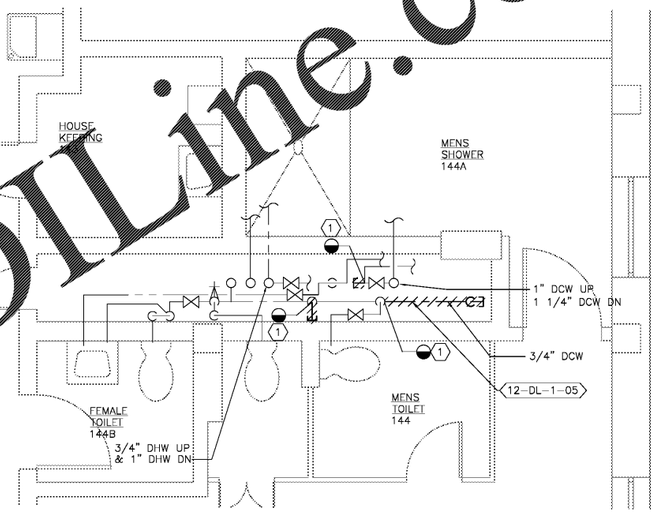

PLAN NORTH
2 FIRST FLOOR PARTIAL PLUMBING DEMOLITION PLAN
SCALE: 1/2" = 1'-0"

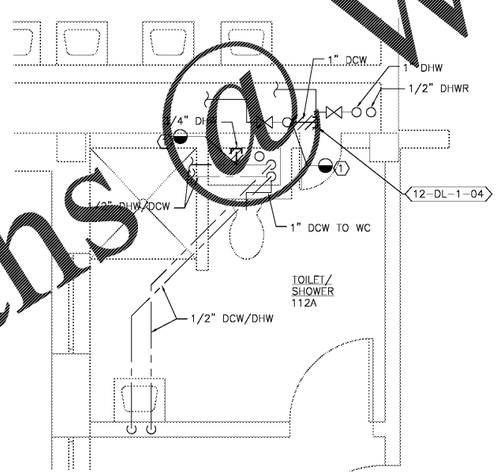

PLAN NORTH
4 FIRST FLOOR PARTIAL PLUMBING DEMOLITION PLAN
SCALE: 1/2" = 1'-0"

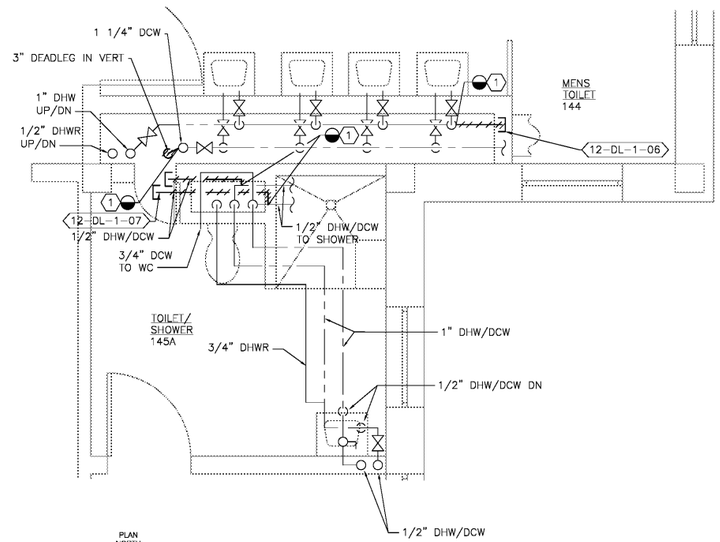

PLAN NORTH
3 FIRST FLOOR PARTIAL PLUMBING DEMOLITION PLAN
SCALE: 1/2" = 1'-0"

Order Plans @ WWW.LDLine.com

Revisions	Date
-	-

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24288
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PD-12-103 BLDG 12 FIRST FLOOR PLUMBING PLAN DEMOLITION	Project Title: RENOVATE FOR WATER QUALITY	Date: 04/ 28 / 2017
Approved: Chief of Facility Management Svc.	Building Number: 12 / Checked: MJG / Drawn: JPH	Project No.: 658-15-101
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153	DRAWING SET: 2592 Dwg. 46 Of 155

Veterans Affairs