DEMOLITION NOTES:

1. REMOVE DEADLEG BACK TO MAIN. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND FLEXIBLE ELASTOMERIC INSULATION.

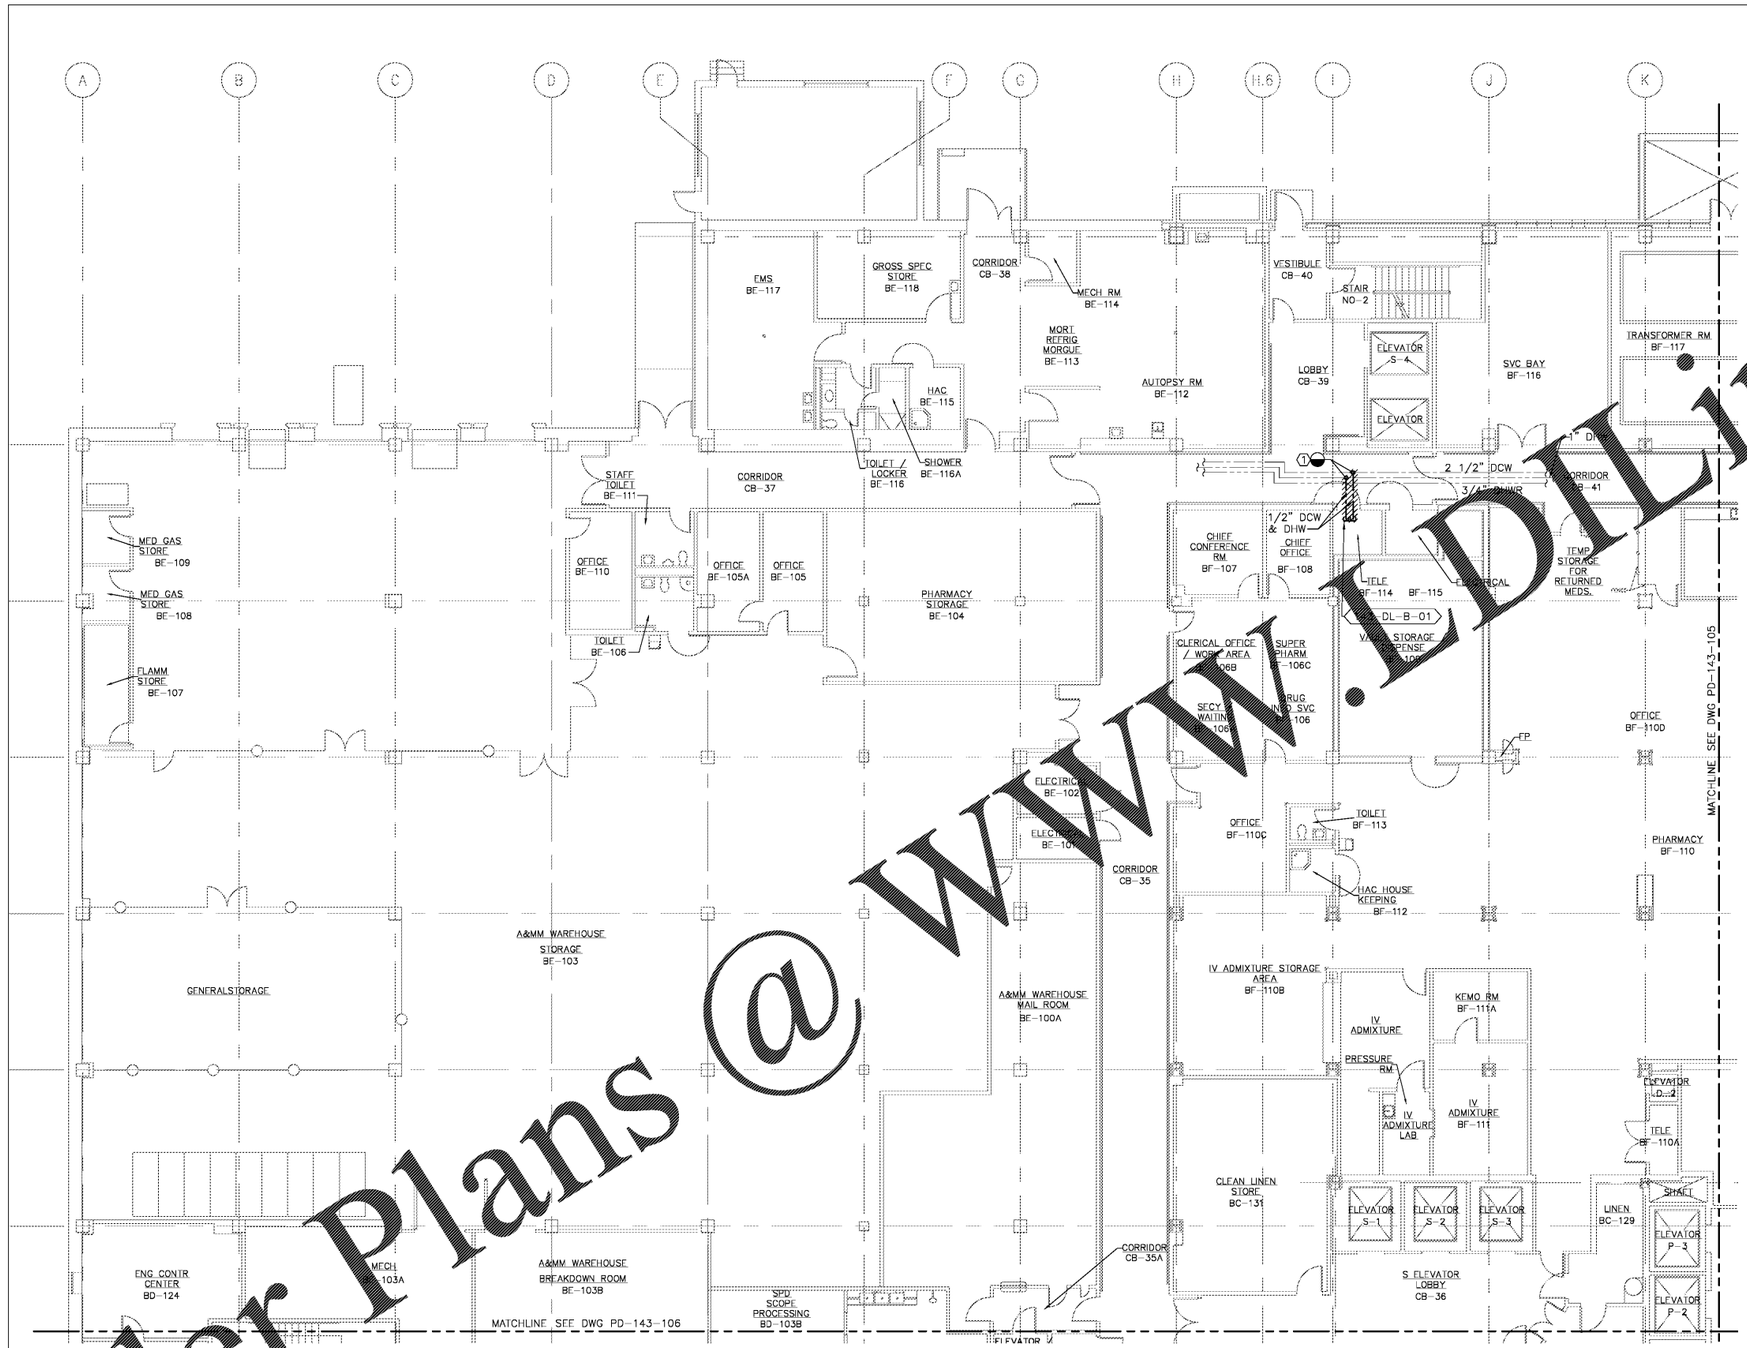

PLAN NORTH

1 **BASEMENT PLUMBING DEMOLITION PLAN - AREA "A"**

SCALE: 1/8" = 1'-0"



PLAN NORTH

BASEMENT KEY PLAN

Order Plans @ WWW.EDLine.com

Revisions	Date
-	-

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24288
4/25/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title	PD-143-104 BLDG 143 BASEMENT PLUMBING PLAN AREA "A" DEMOLITION
Approved: Chief of Facility Management Svc.	
Approved: Medical Center Director	
Project Title	RENOVATE FOR WATER QUALITY
Building Number	143
Checked	MJG
Drawn	JFC
Location	VA MEDICAL CENTER, SALEM, VA 24153
Date	04/ 28 / 2017
Project No.	658-15-101
DRAWING SET	2592
Dwg.	56 Of 155

Veterans Affairs