



**DEMOLITION NOTES:**  
 1 REMOVE DEADLEG BACK TO MAIN. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND FLEXIBLE ELASTOMERIC INSULATION.

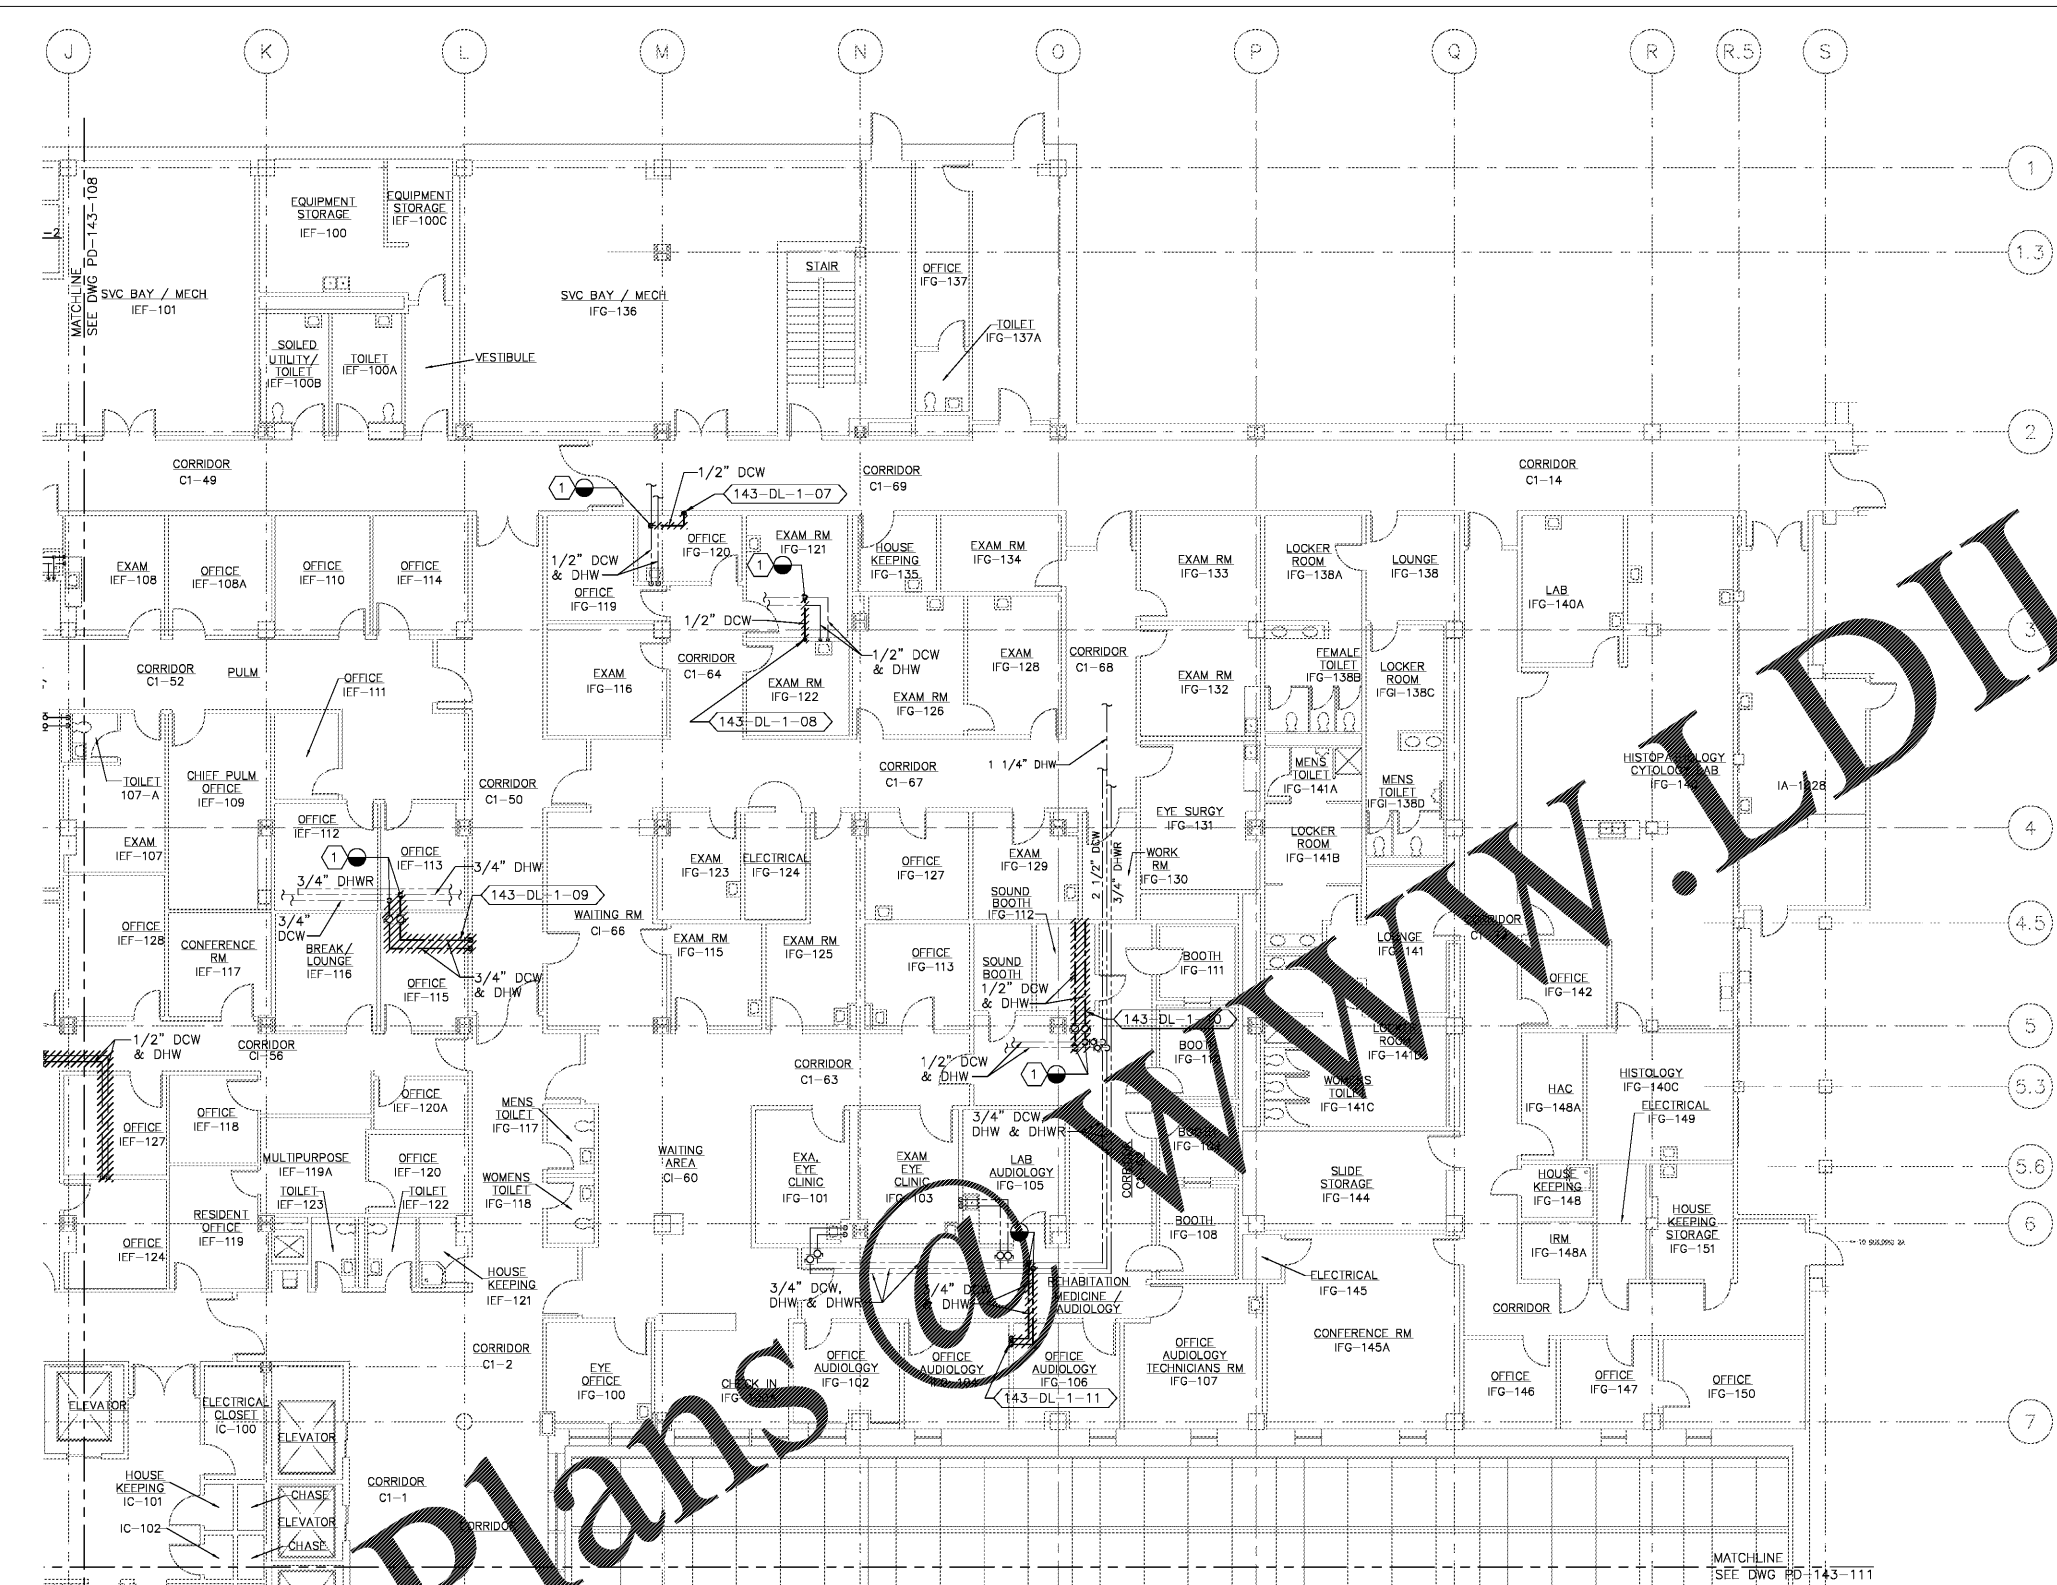

three inches = one foot  
 one and one-half inches = one foot  
 one inch = one foot  
 three-quarters inch = one foot  
 one-half inch = one foot  
 three-eighths inch = one foot  
 one-quarter inch = one foot  
 one-eighth inch = one foot

PLAN NORTH  
 1 **FIRST FLOOR PLUMBING DEMOLITION PLAN - AREA "B"**  
 SCALE: 1/8" = 1'-0"



Order Plans @ WWW.LDLine.com

Revisions Date	<b>Atrix</b> Atrix, p.l.c. 102 3rd Avenue, NE PO Box 1628, Hickory, NC 28603 Phone: 828.315.9962 Fax: 828.315.9964 www.atrigrp.com	<b>Wiley Wilson</b> Wiley Wilson 127 Nationwide Drive Lynchburg, VA 24502 Phone: 434.947.1901 www.wileywilson.com		Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief	Drawing Title PD-143-109 BLDG 143 FIRST FLOOR PLUMBING PLAN AREA "B" DEMOLITION	Project Title RENOVATE FOR WATER QUALITY	Date 04/28/2017	Veterans Affairs
				<b>CONSTRUCTION DOCUMENTS</b>	Approved: Infection Control Officer	Approved: Chief of Staff	Approved: Chief of Facility Management Svcs.	Building Number 143	Checked MJG	