DEMOLITION NOTES:

1. REMOVE DEADLEG BACK TO MAIN. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND FLEXIBLE ELASTOMERIC INSULATION.

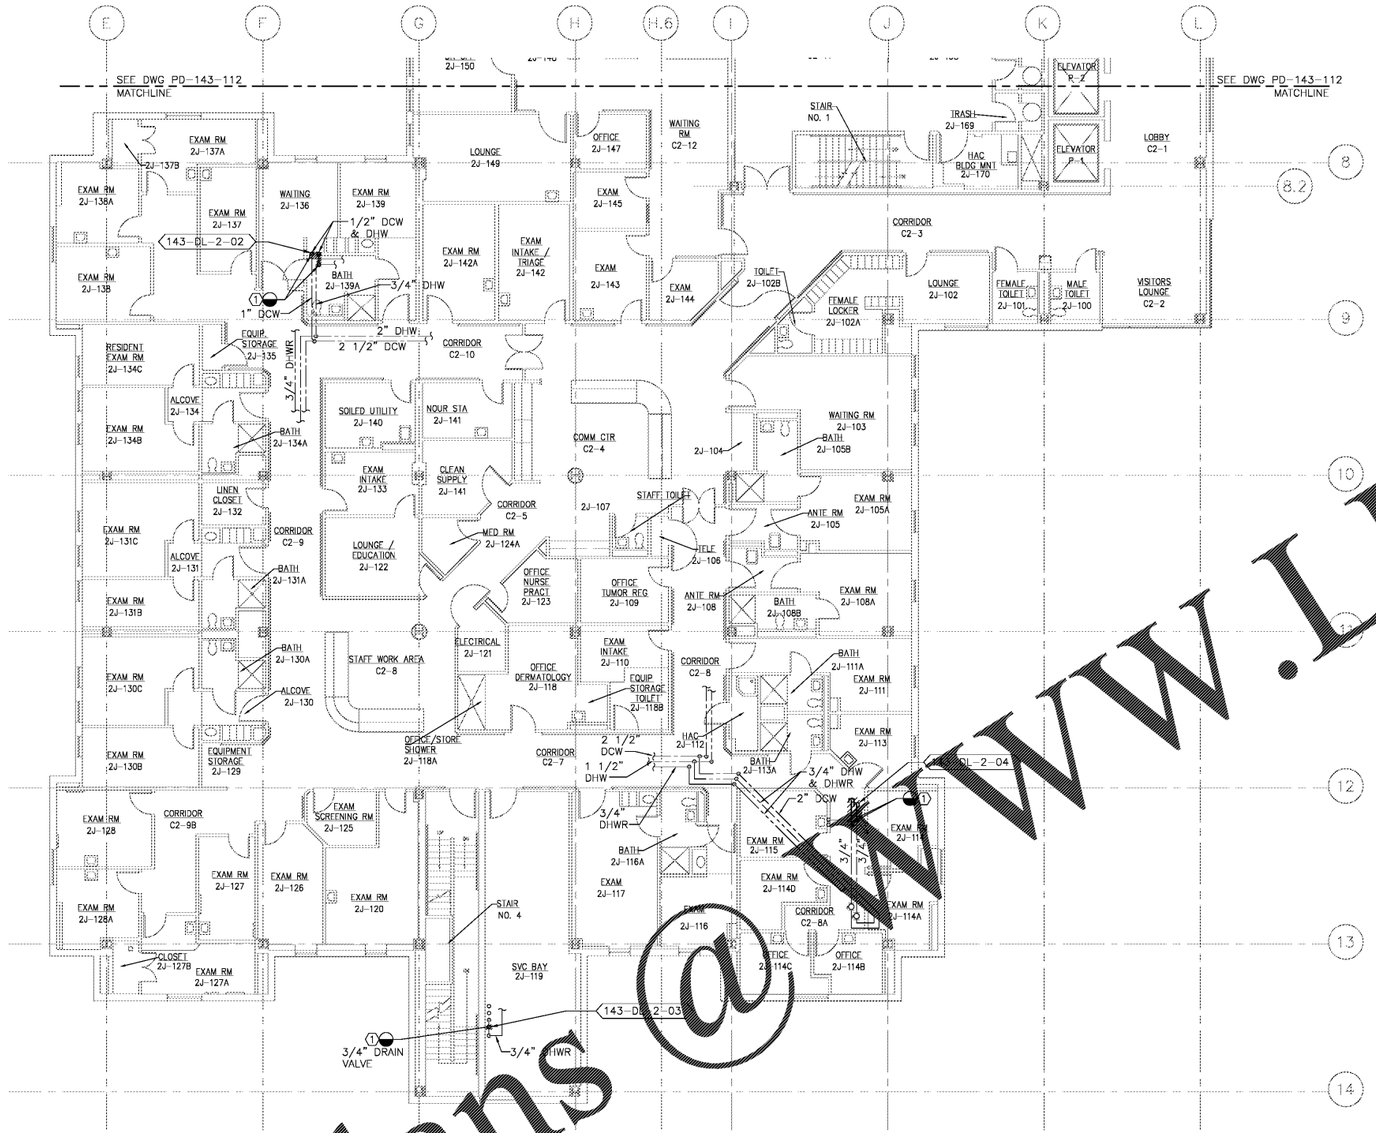

1 SECOND FLOOR PLUMBING DEMOLITION PLAN - AREA "B"
SCALE: 1/8" = 1'-0"



SECOND FLOOR KEY PLAN

Order Plans @ WWW.LDILine.com

Revisions	Date
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-

Atriax
Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

WileyWilson
WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24288
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PD-143-113 BLDG 143 SECOND FLOOR PLUMBING PLAN AREA "B" DEMOLITION	Project Title: RENOVATE FOR WATER QUALITY	Date: 04/ 28 / 2017
Approved: Chief of Facility Management Svc.	Building Number: 143 / Checked: MJG / Drawn: WJC	Project No.: 658-15-101
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153	DRAWING SET: 2592 Dwg. 65 Of 155

Veterans Affairs