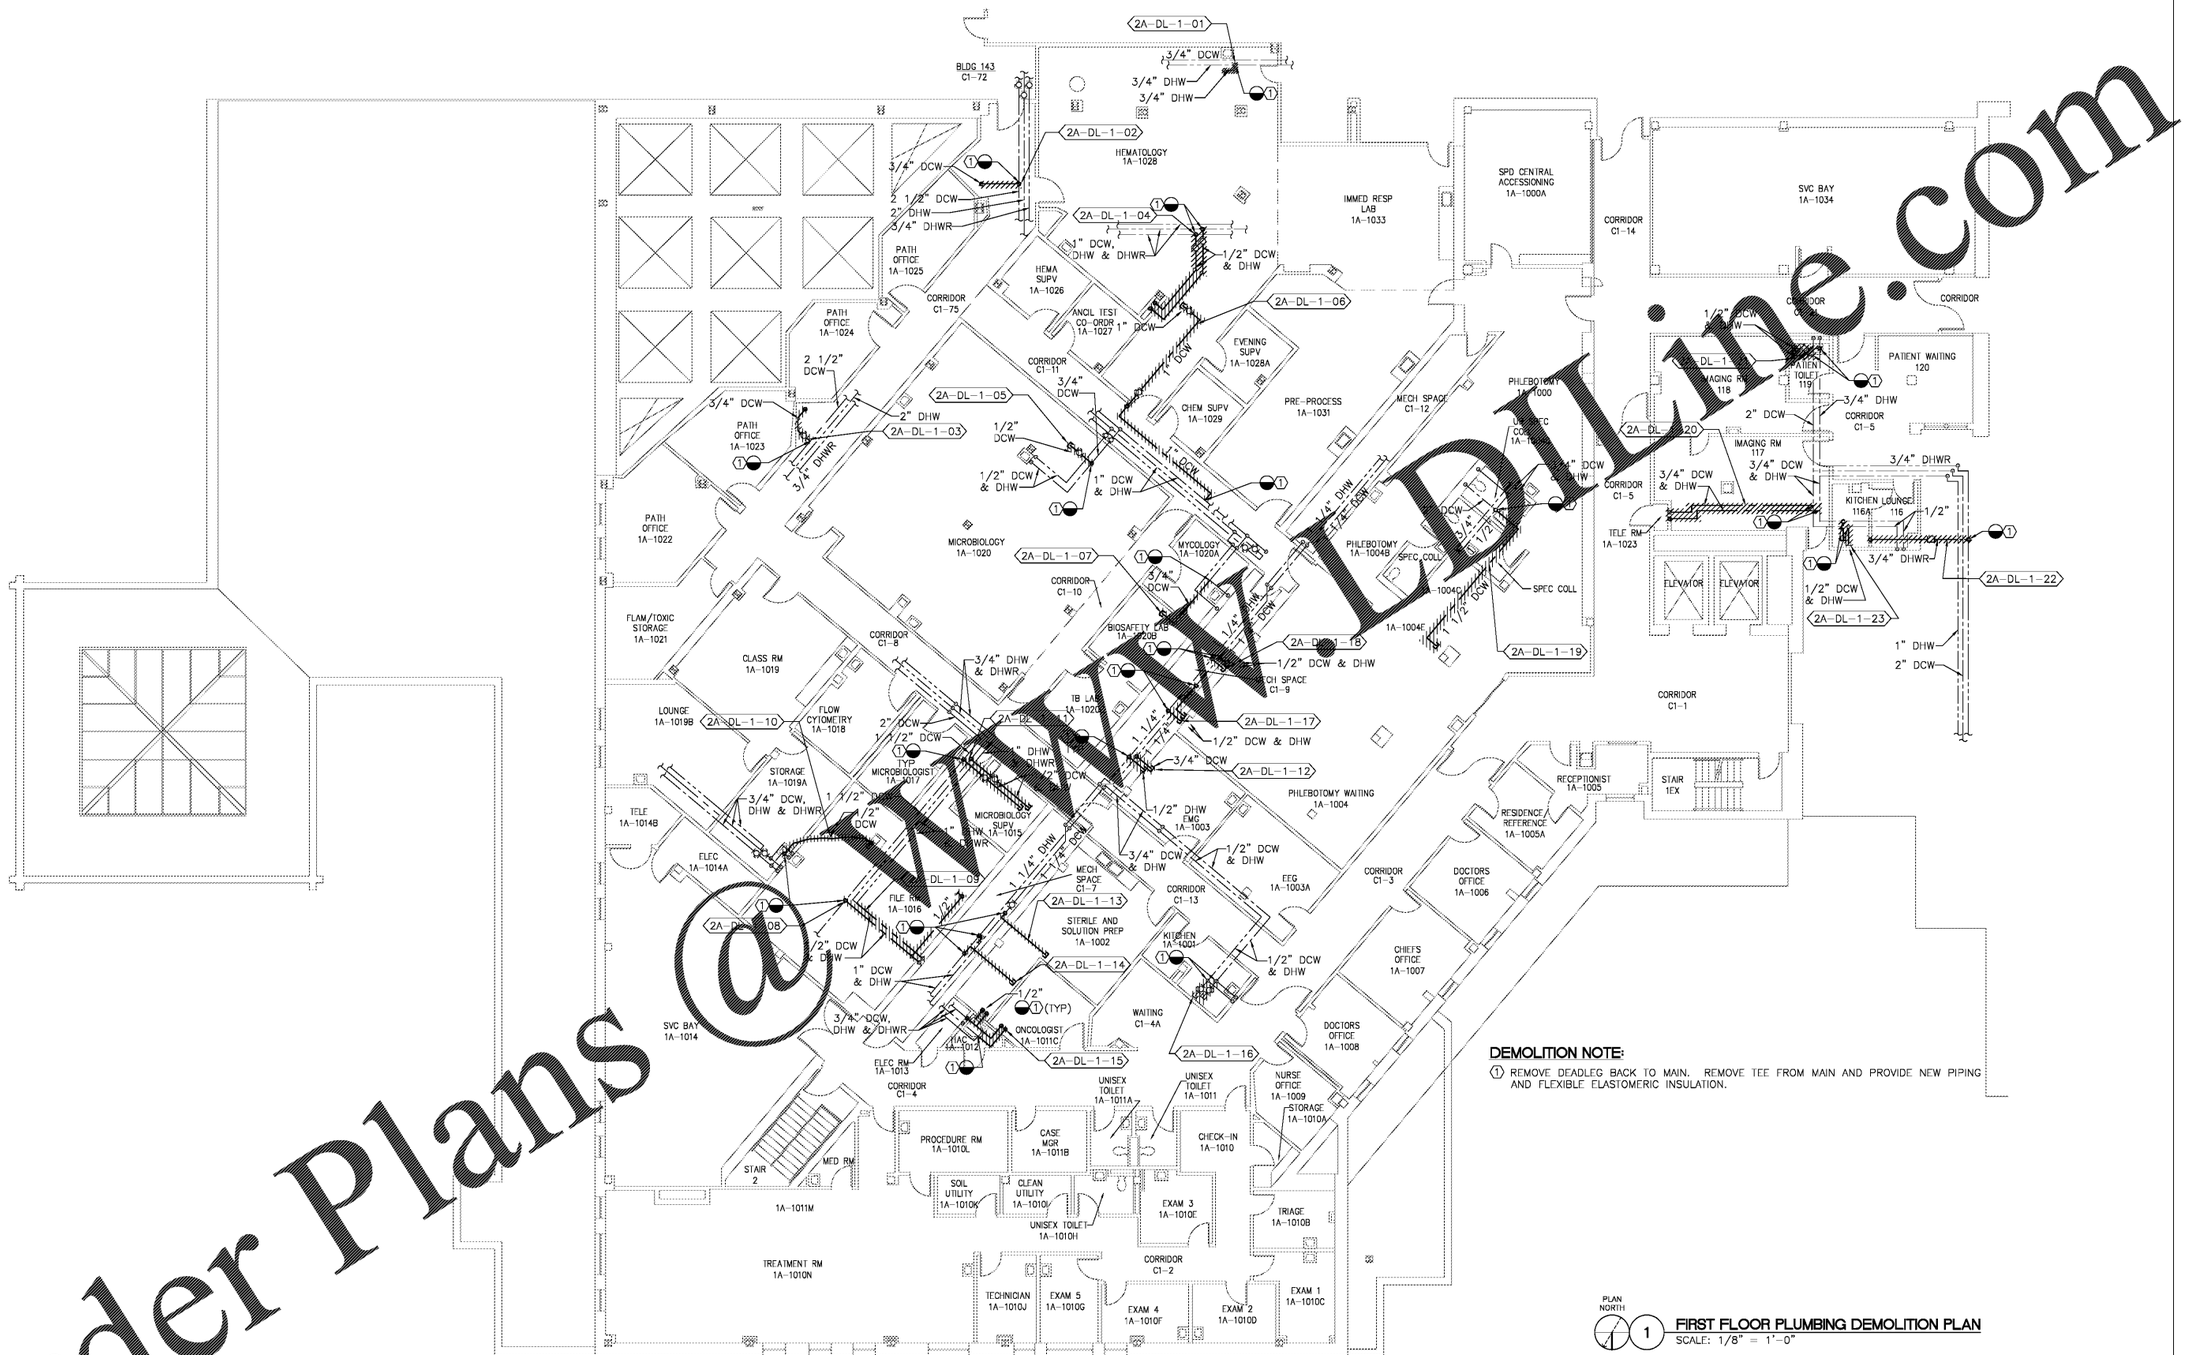

DEMOLITION NOTE:

(1) REMOVE DEADLEG BACK TO MAIN. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND FLEXIBLE ELASTOMERIC INSULATION.

PLAN NORTH

(1) FIRST FLOOR PLUMBING DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

Order Plans @ VADline.com

Revisions	Date
-	-

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9984
www.atriaxgroup.com

WileyWilson
127 Nellonside Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24298
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PD-2A-102 BLDG 2A FIRST FLOOR PLUMBING PLAN DEMOLITION	Project Title: RENOVATE FOR WATER QUALITY		Date: 04/28/2017
			Project No.: 658-15-101
Approved: Chief of Facility Management Svc.	Building Number: 2A	Checked: MJG / Drawn: WJC	DRAWING SET: 2592
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153		Dwg. 33 Of 155

Veterans Affairs

three inches = one foot 0 6 8
one and one-half inches = one foot 1 0 6
one inch = one foot 2 0 6 8
three-quarter inch = one foot 2 0 6 8
one-half inch = one foot 4 0 6 8
three-eighth inch = one foot 4 0 6 8
one-quarter inch = one foot 4 0 6 8
one-eighth inch = one foot 8 0 6 16