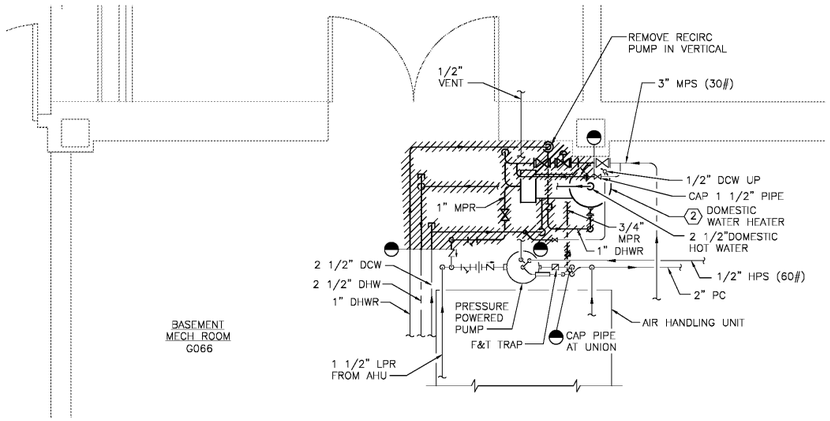

PLAN NORTH

1 **ENLARGED BASEMENT MECH ROOM G066 DEMOLITION PLAN**

SCALE: 1/2" = 1'-0"

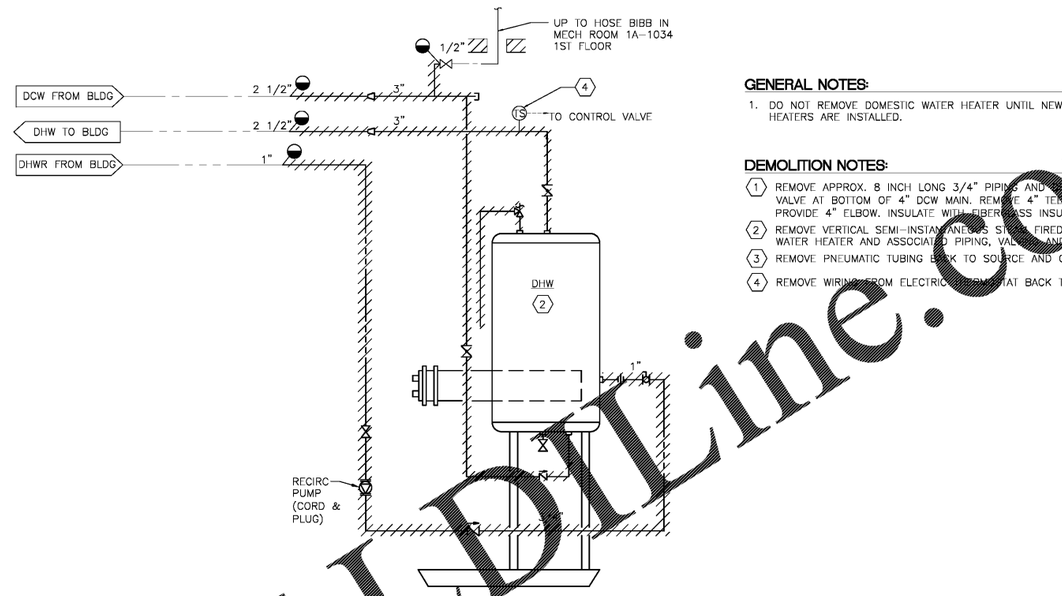

GENERAL NOTES:

1. DO NOT REMOVE DOMESTIC WATER HEATER UNTIL NEW WATER HEATERS ARE INSTALLED.

DEMOLITION NOTES:

1. REMOVE APPROX. 8 INCH LONG 3/4" PIPING AND BRASS VALVE AT BOTTOM OF 4" DCW MAIN. REMOVE 4" TEE AND PROVIDE 4" ELBOW. INSULATE WITH FIBERGLASS INSULATION.
2. REMOVE VERTICAL SEMI-INSTANTANEOUS STEAM FIRED DOMESTIC WATER HEATER AND ASSOCIATED PIPING, VALVES AND ACCESSORIES.
3. REMOVE PNEUMATIC TUBING BACK TO SOURCE AND CAP.
4. REMOVE WIRING FROM ELECTRIC THERMOSTAT BACK TO SOURCE.

A **BLDG 2A DOMESTIC WATER HEATER DOMESTIC WATER DEMOLITION DIAGRAM**

NO SCALE

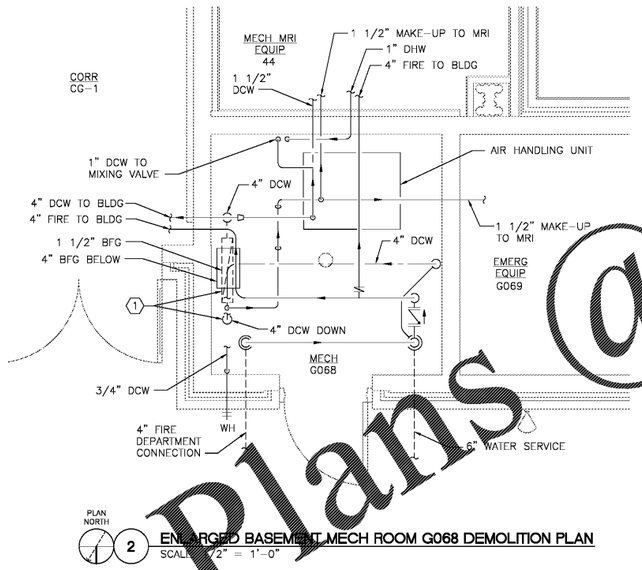

PLAN NORTH

2 **ENLARGED BASEMENT MECH ROOM G068 DEMOLITION PLAN**

SCALE: 1/2" = 1'-0"

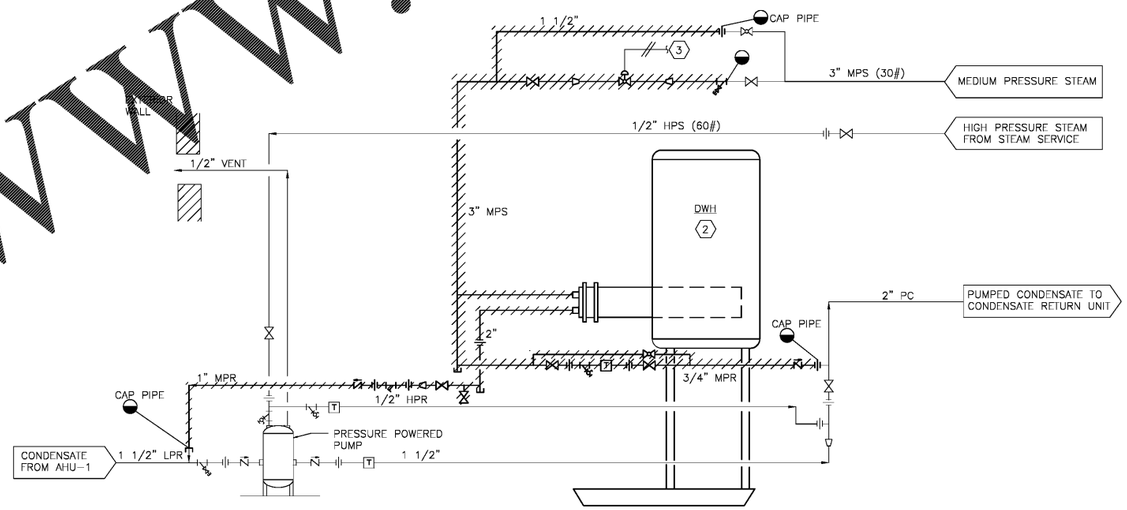

B **BLDG 2A DOMESTIC WATER HEATER STEAM AND CONDENSATE DEMOLITION DIAGRAM**

NO SCALE

Order Plans @ www.LDLine.com

Revisions	Date
-	-

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24298
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PD-2A-401 BLDG 2A ENLARGED BASEMENT PLANS DEMOLITION

Approved: Chief of Facility Management Svc.

Approved: Medical Center Director

Project Title: RENOVATE FOR WATER QUALITY

Building Number: 2A | Checked: MJG | Drawn: JFC

Location: VA MEDICAL CENTER, SALEM, VA 24153

Date: 04/ 28 / 2017

Project No.: 658-15-101

DRAWING SET: 2592

Dwg. 34 Of 155

Veterans Affairs