DEMOLITION NOTES:

1. REMOVE DEADLEG BACK TO MAIN. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND FLEXIBLE ELASTOMERIC INSULATION.
1. REMOVE EXISTING VALVE.

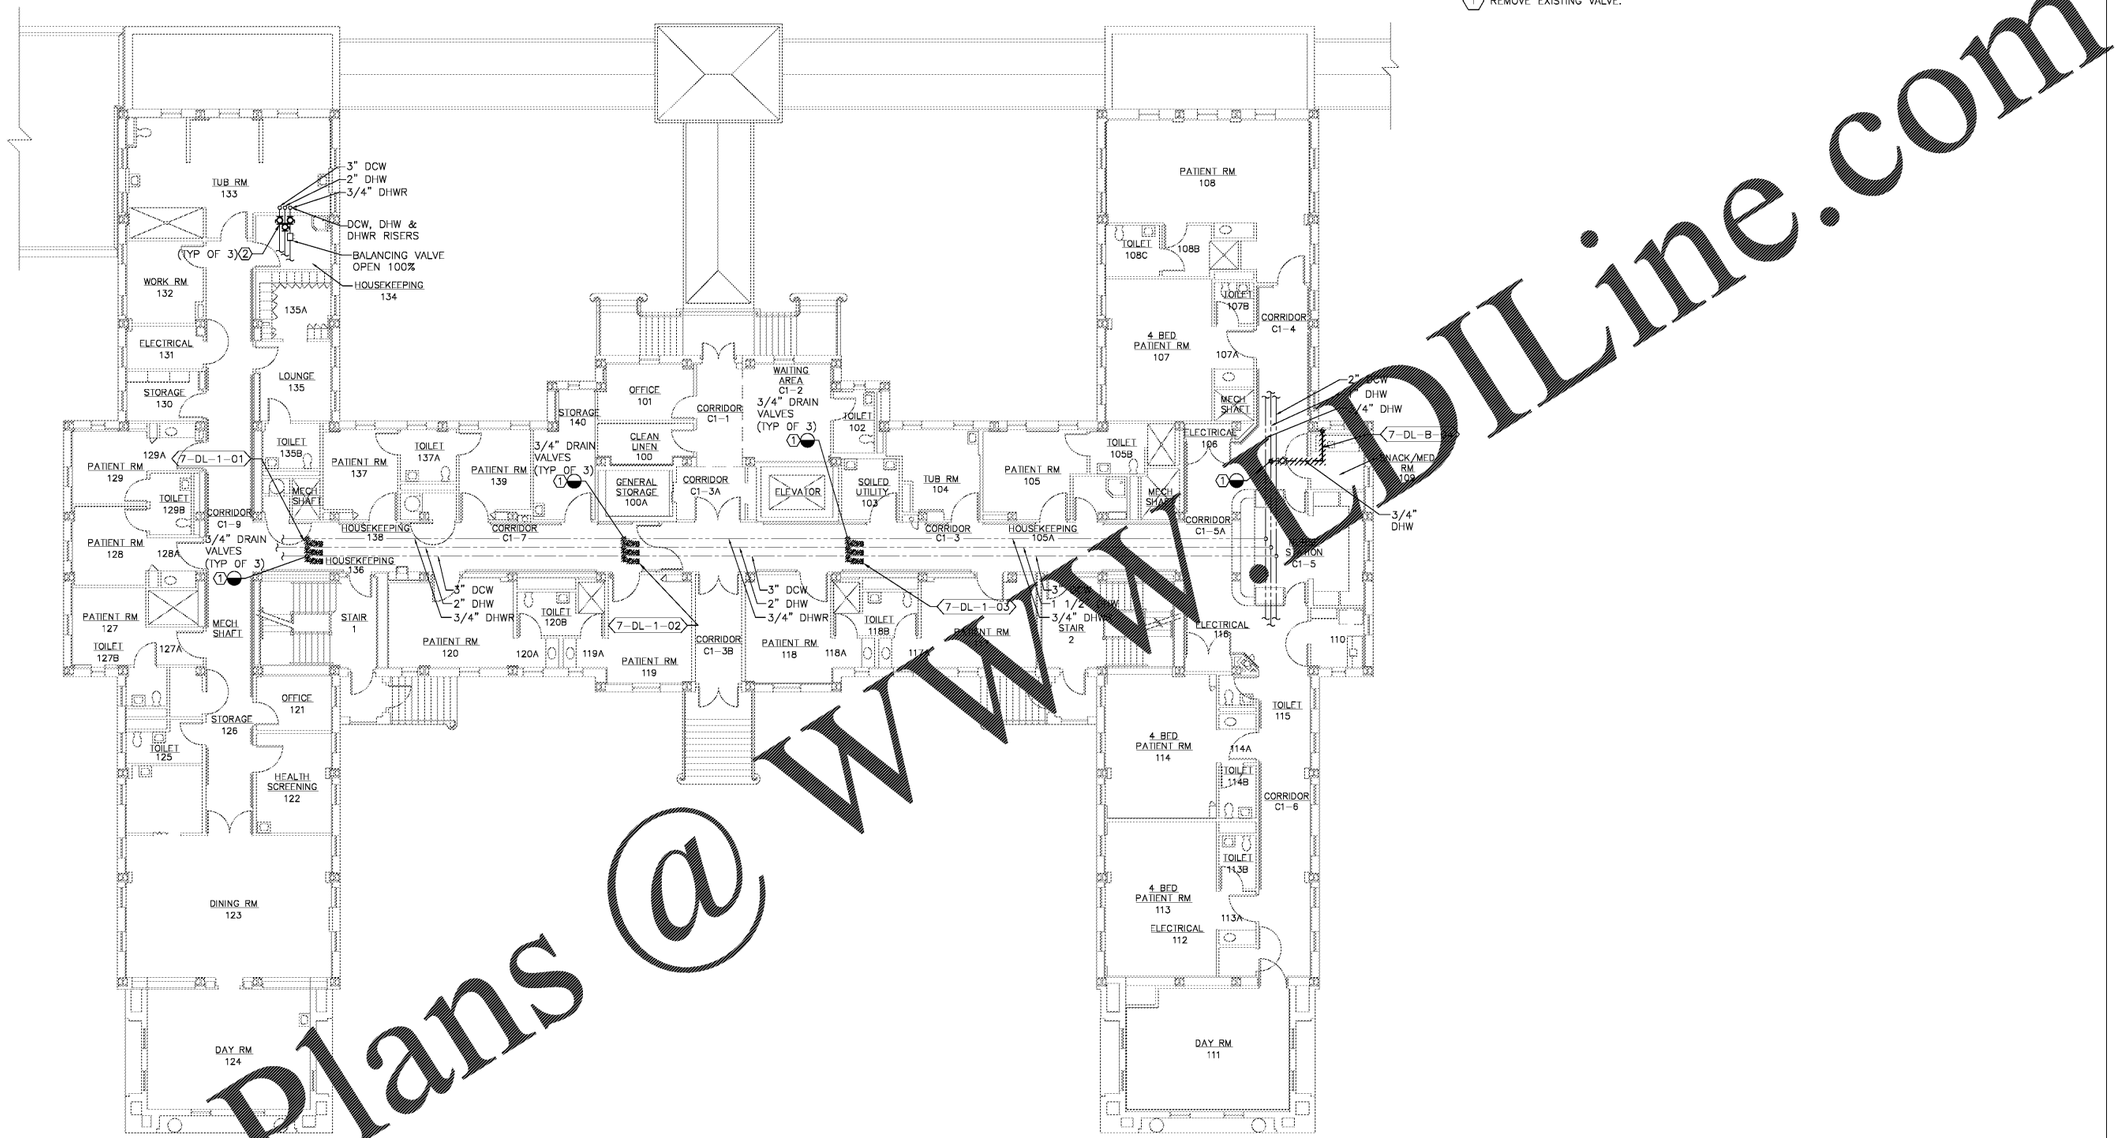

PLAN NORTH

1 **FIRST FLOOR PLUMBING DEMOLITION PLAN**
SCALE: 1/8" = 1'-0"

Order Plans @ WWW.PDLine.com

Revisions	Date

Atriax
Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

Wiley|Wilson
Wiley|Wilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL W. GEHL
Lic. No. 24298
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PD-7-102 BLDG 7 FIRST FLOOR PLUMBING PLAN DEMOLITION

Project Title: RENOVATE FOR WATER QUALITY

Approved: Chief of Facility Management Svc.

Approved: Medical Center Director

Building Number: 7 | Checked: MJG | Drawn: WJC

Location: VA MEDICAL CENTER, SALEM, VA 24153

Date: 04/ 28 / 2017

Project No.: 658-15-101

DRAWING SET: 2592

Dwg. 36 Of 155

Veterans Affairs