## GENERAL NOTES:

1. DO NOT REMOVE DOMESTIC WATER HEATERS UNTIL NEW WATER HEATERS ARE INSTALLED.

## DEMOLITION NOTES:

1. REMOVE VERTICAL SEMI-INSTANTANEOUS STEAM FIRED DOMESTIC WATER HEATER AND ASSOCIATED PIPING, VALVING AND ACCESSORIES.
2. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND FIBERGLASS INSULATION.
3. PATCH MASONRY WALL TO MATCH EXISTING UPON REMOVAL OF WALL HYDRANT.

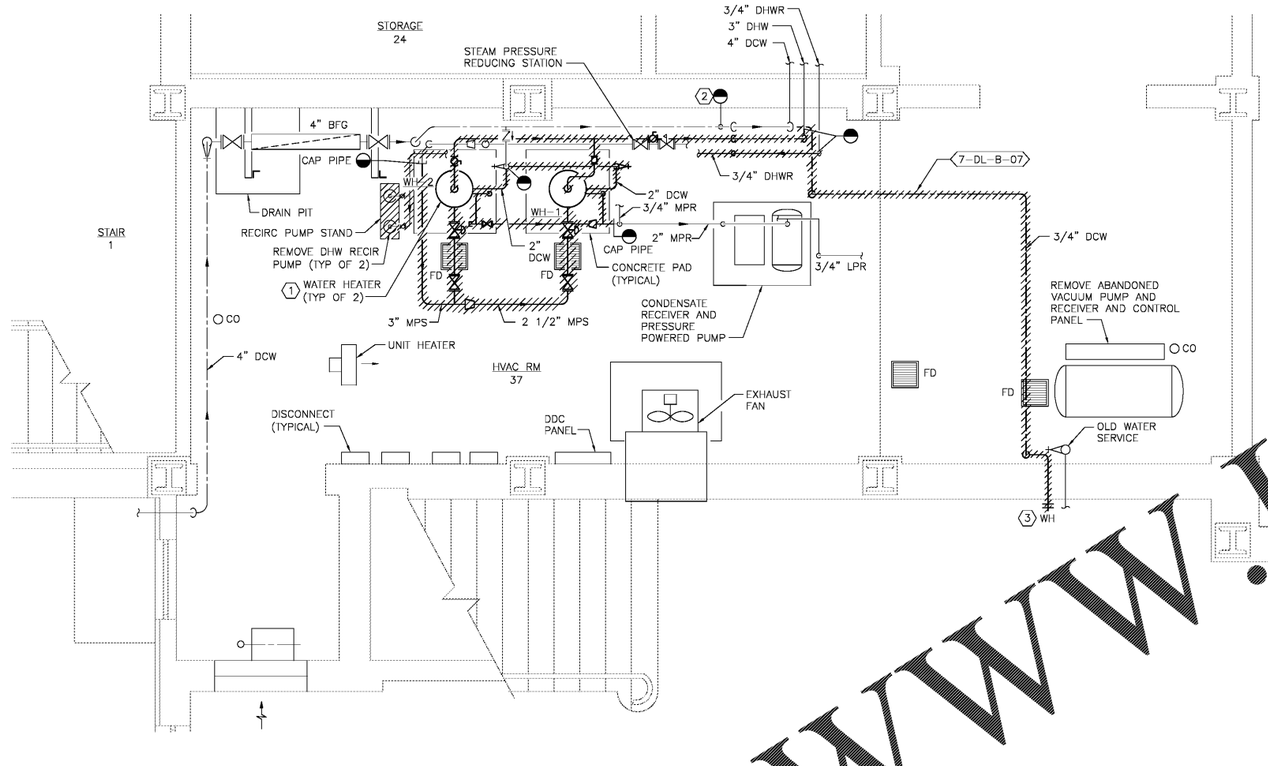


PLAN

1 ENLARGED BASEMENT HVAC RM 37 DEMOLITION PLAN
SCALE: 1/2" = 1'-0"

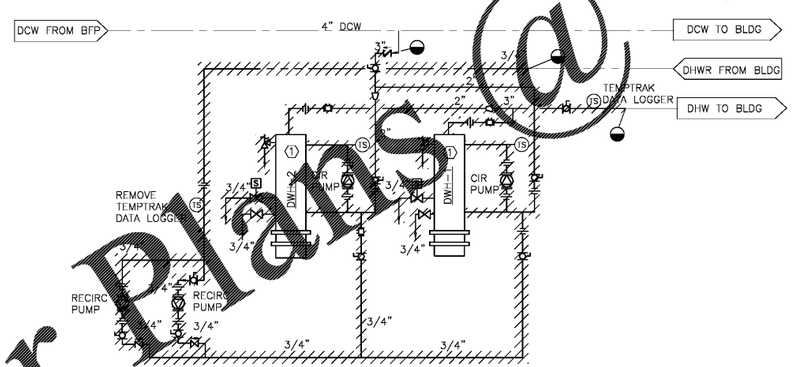


A BLDG 7 DOMESTIC WATER HEATERS DOMESTIC WATER DEMOLITION DIAGRAM
NO SCALE

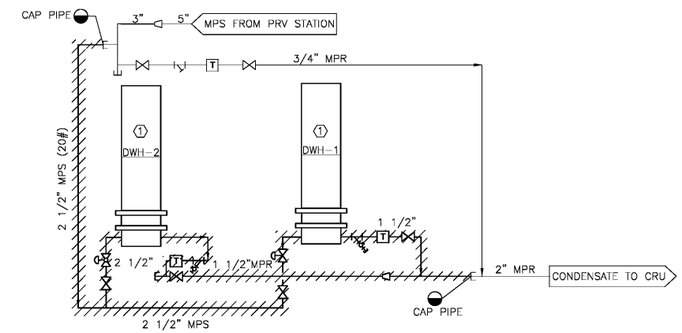


B BLDG 7 DOMESTIC WATER HEATERS STEAM AND CONDENSATE DEMOLITION DIAGRAM
NO SCALE

Order Plans @ WWW.LDILine.com

| Revisions | Date |
|---|---|
| - | - |

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9984
www.atriaxgroup.com

WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24288
4/22/2017
PROFESSIONAL ENGINEER

| | | |
|---|---|---|
| Approved: Energy Engineer | Approved: Safety Manager | Approved: Service Chief |
| CONSTRUCTION DOCUMENTS | Approved: Infection Control Officer | Approved: Chief of Staff |
| | Approved: GEMS Coordinator | Approved: Associate Director |

| | | |
|---|---|---|
| Drawing Title: PD-7-401 BLDG 7 ENLARGED BASEMENT PLUMBING PLAN DEMOLITION | Project Title: RENOVATE FOR WATER QUALITY | Date: 04/28/2017 |
| Approved: Chief of Facility Management Svc. | Building Number: 7 / Checked: MJG / Drawn: JFC | Project No.: 658-15-101 |
| Approved: Medical Center Director | Location: VA MEDICAL CENTER, SALEM, VA 24153 | DRAWING SET: 2592 Dwg. 38 Of 155 |

Veterans Affairs