


three inches = one foot
 one and one-half inches = one foot
 one inch = one foot
 three-quarters inch = one foot
 one-half inch = one foot
 three-eighths inch = one foot
 one-quarter inch = one foot
 one-eighth inch = one foot

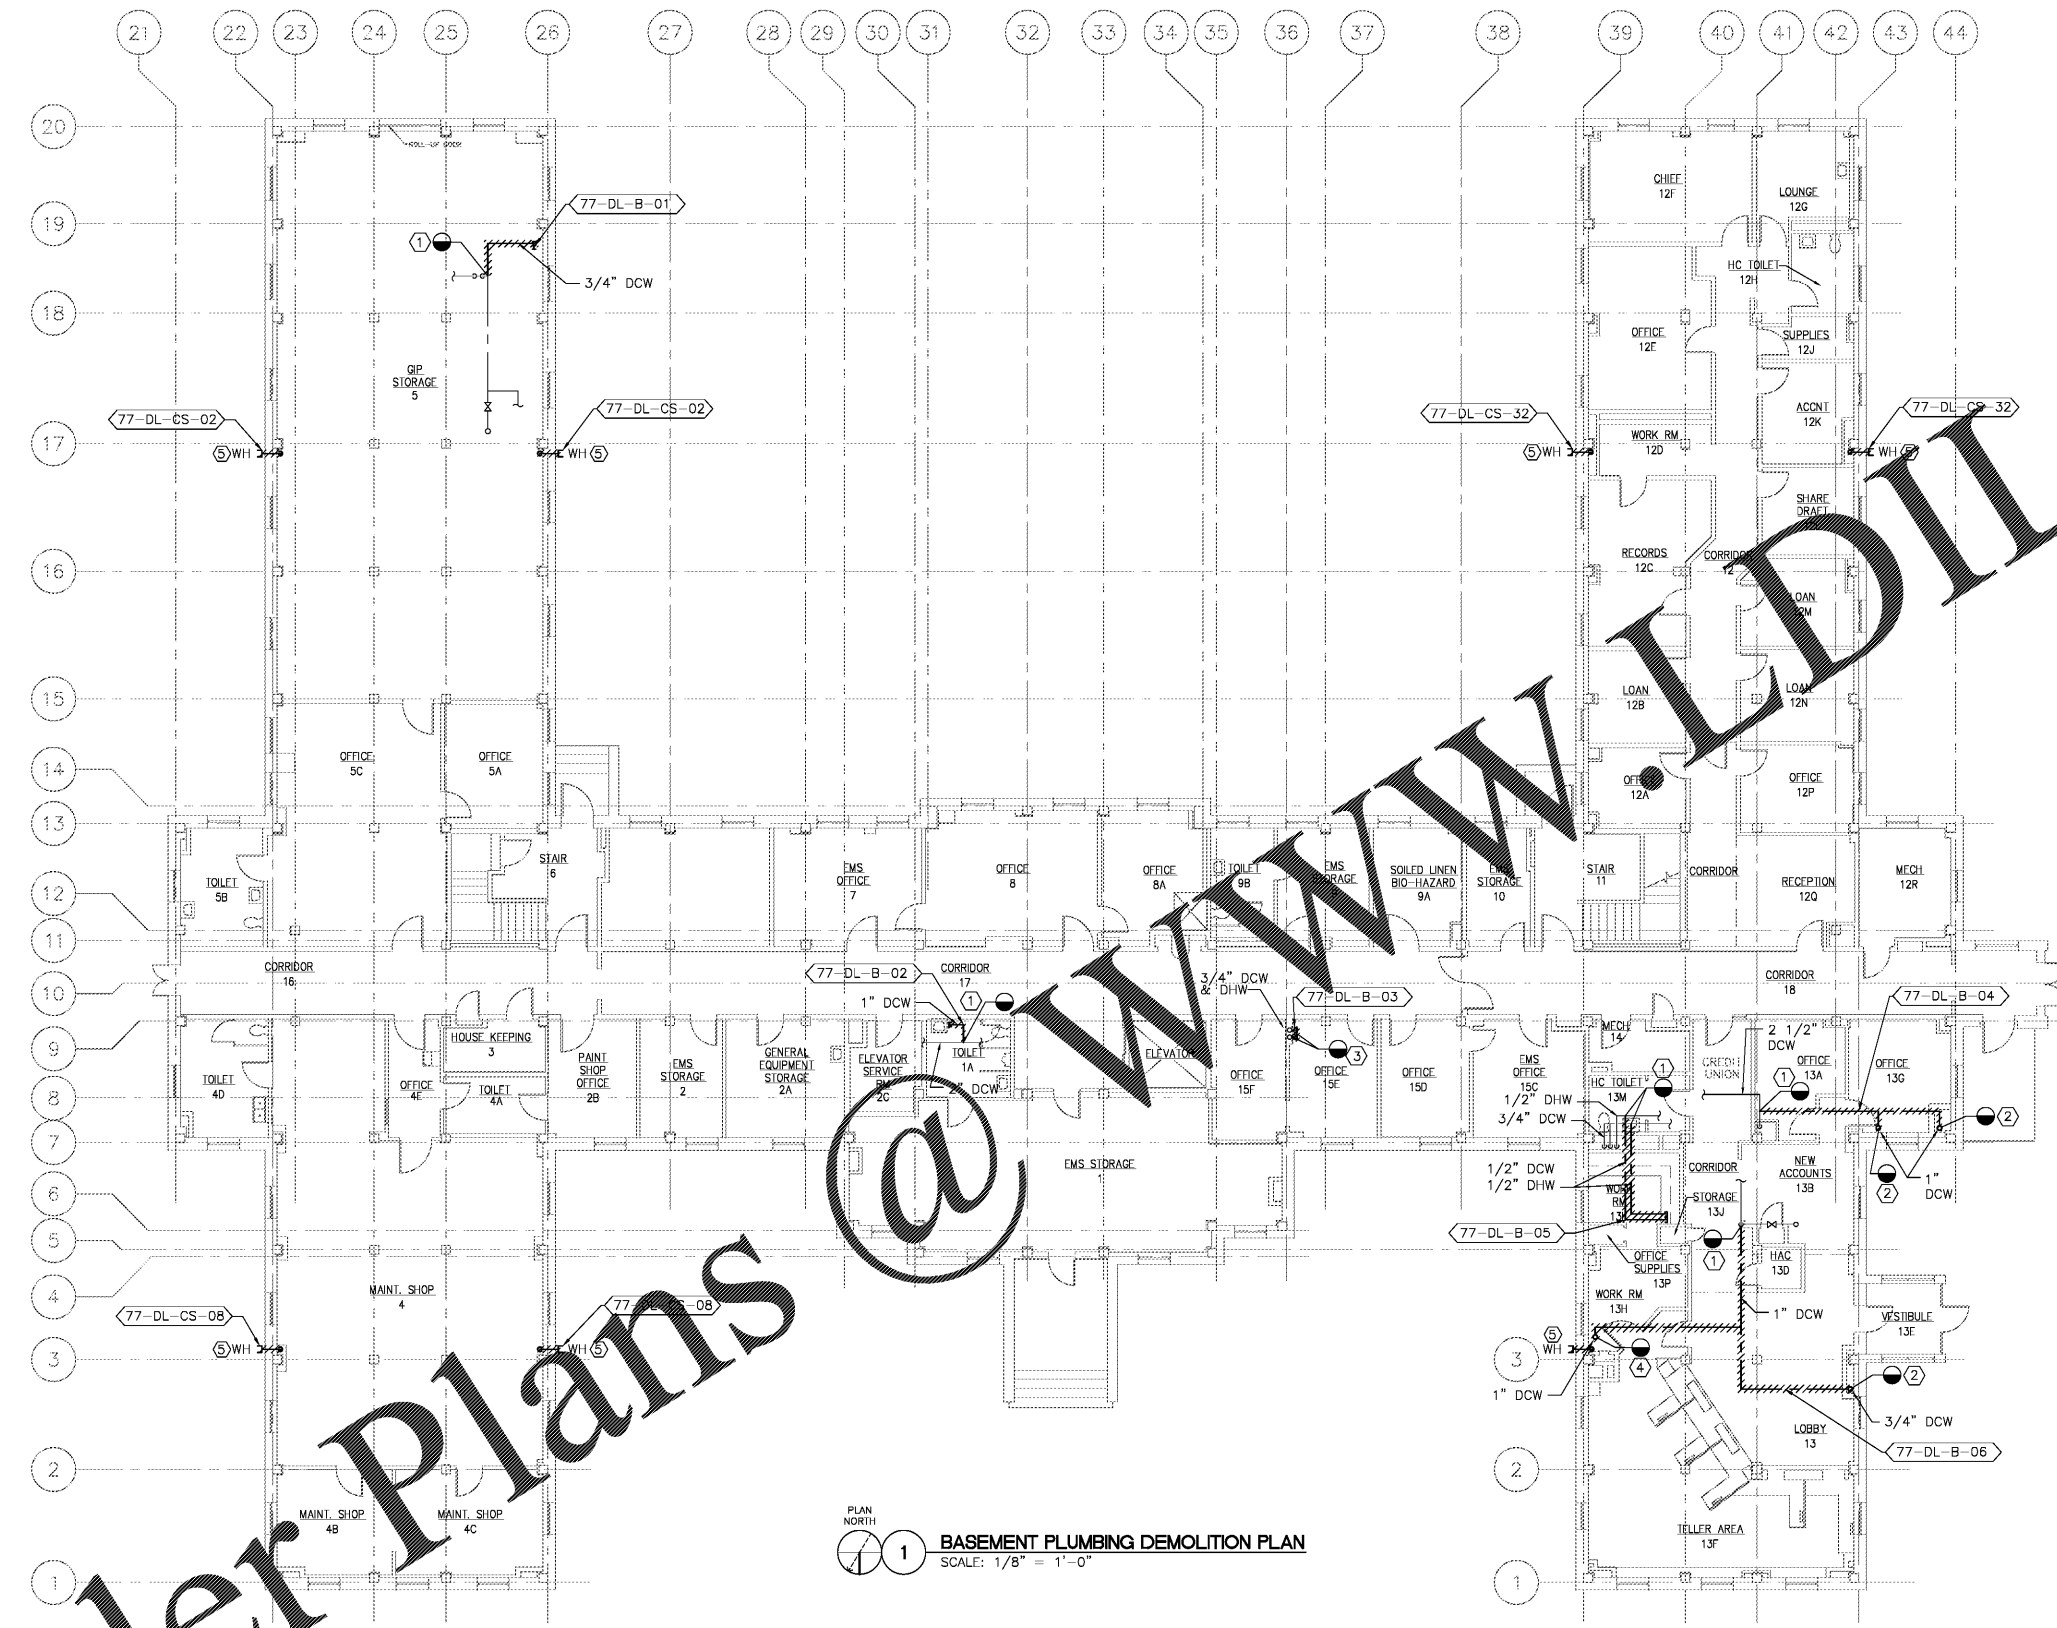

- DEMOLITION NOTES:**
- 1 REMOVE DEADLEG BACK TO MAIN. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND FIBERGLASS INSULATION.
 - 2 CUT AND CAP PIPE AT FIRST FLOOR SLAB.
 - 3 REMOVE DEADLEGS BACK TO MAIN. REMOVE TEE FROM MAIN. PROVIDE NEW PIPING AND FIBERGLASS INSULATION. PATCH AND REPAIR WALL TO MATCH EXISTING.
 - 4 FIRESTOP OPENING IN SLAB UPON REMOVAL OF PIPE.
 - 5 OPEN CHASE WALL TO ALLOW ACCESS TO 3/4\"/>
- GENERAL NOTES:**
1. REFER TO THE DOMESTIC WATER DDD LEG AND ASBESTOS ABATEMENT SCHEDULE FOR PIPING CONTAINING ASBESTOS INSULATION.

PLAN NORTH
 1 BASEMENT PLUMBING DEMOLITION PLAN
 SCALE: 1/8" = 1'-0"

Order Plans

Revisions	Date	Atrix Atrix, LLC 102 3rd Avenue, NE PO Box 1628, Hickory, NC 28603 Phone: 828.315.9962 Fax: 828.315.9964 www.atrigrp.com	WileyWilson 127 Nationwide Drive Lynchburg, VA 24502 Phone: 434.947.1901 www.wileywilson.com		Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief	Drawing Title PD-77-102 BLDG 77 BASEMENT PLUMBING PLAN DEMOLITION	Project Title RENOVATE FOR WATER QUALITY	Date 04/28/2017	Veterans Affairs
					CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff	Approved: Chief of Facility Management Svcs. Approved: Medical Center Director	Project No. 658-15-101	Building Number 77	