DEMOLITION NOTES:

1. REMOVE DEADLEG BACK TO MAIN. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND INSULATION TO MATCH EXISTING.
2. PATCH WALL TO MATCH EXISTING UPON REMOVAL OF WALL HYDRANT.
3. CUT PIPE AT SLAB FLOOR AND CAP PIPE.
4. CUT PIPE AT WALL PENETRATION. CAP PIPE AND ABANDON IN PLACE.

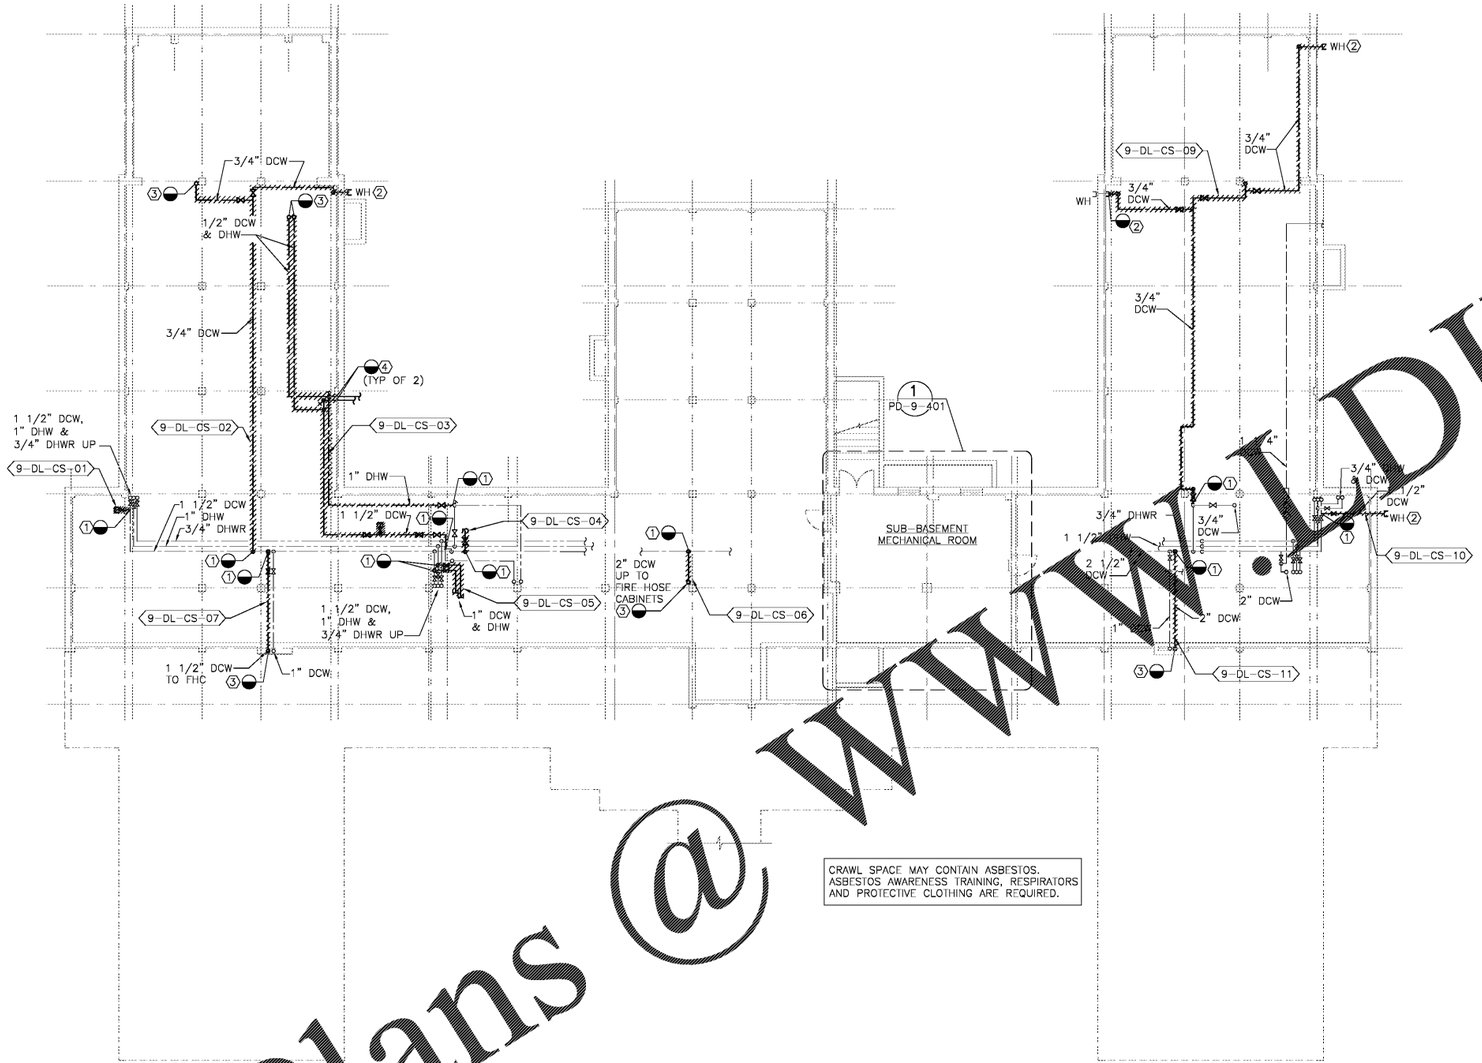

CRAWL SPACE MAY CONTAIN ASBESTOS. ASBESTOS AWARENESS TRAINING, RESPIRATORS AND PROTECTIVE CLOTHING ARE REQUIRED.

PLAN NORTH

1 CRAWL SPACE PLUMBING DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

Order Plans @ WWW.DILine.com

Revisions	Date
-	-

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9984
www.atriaxgroup.com

WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24288
4/22/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PD-9-101 BLDG 9 CRAWL SPACE PLUMBING PLAN DEMOLITION	Project Title: RENOVATE FOR WATER QUALITY	Date: 04/ 28 / 2017
Approved: Chief of Facility Management Svc.	Building Number: 9 / Checked: MJG / Drawn: WJC	Project No.: 658-15-101
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153	DRAWING SET: 2592 Dwg. 39 Of 155

Veterans Affairs