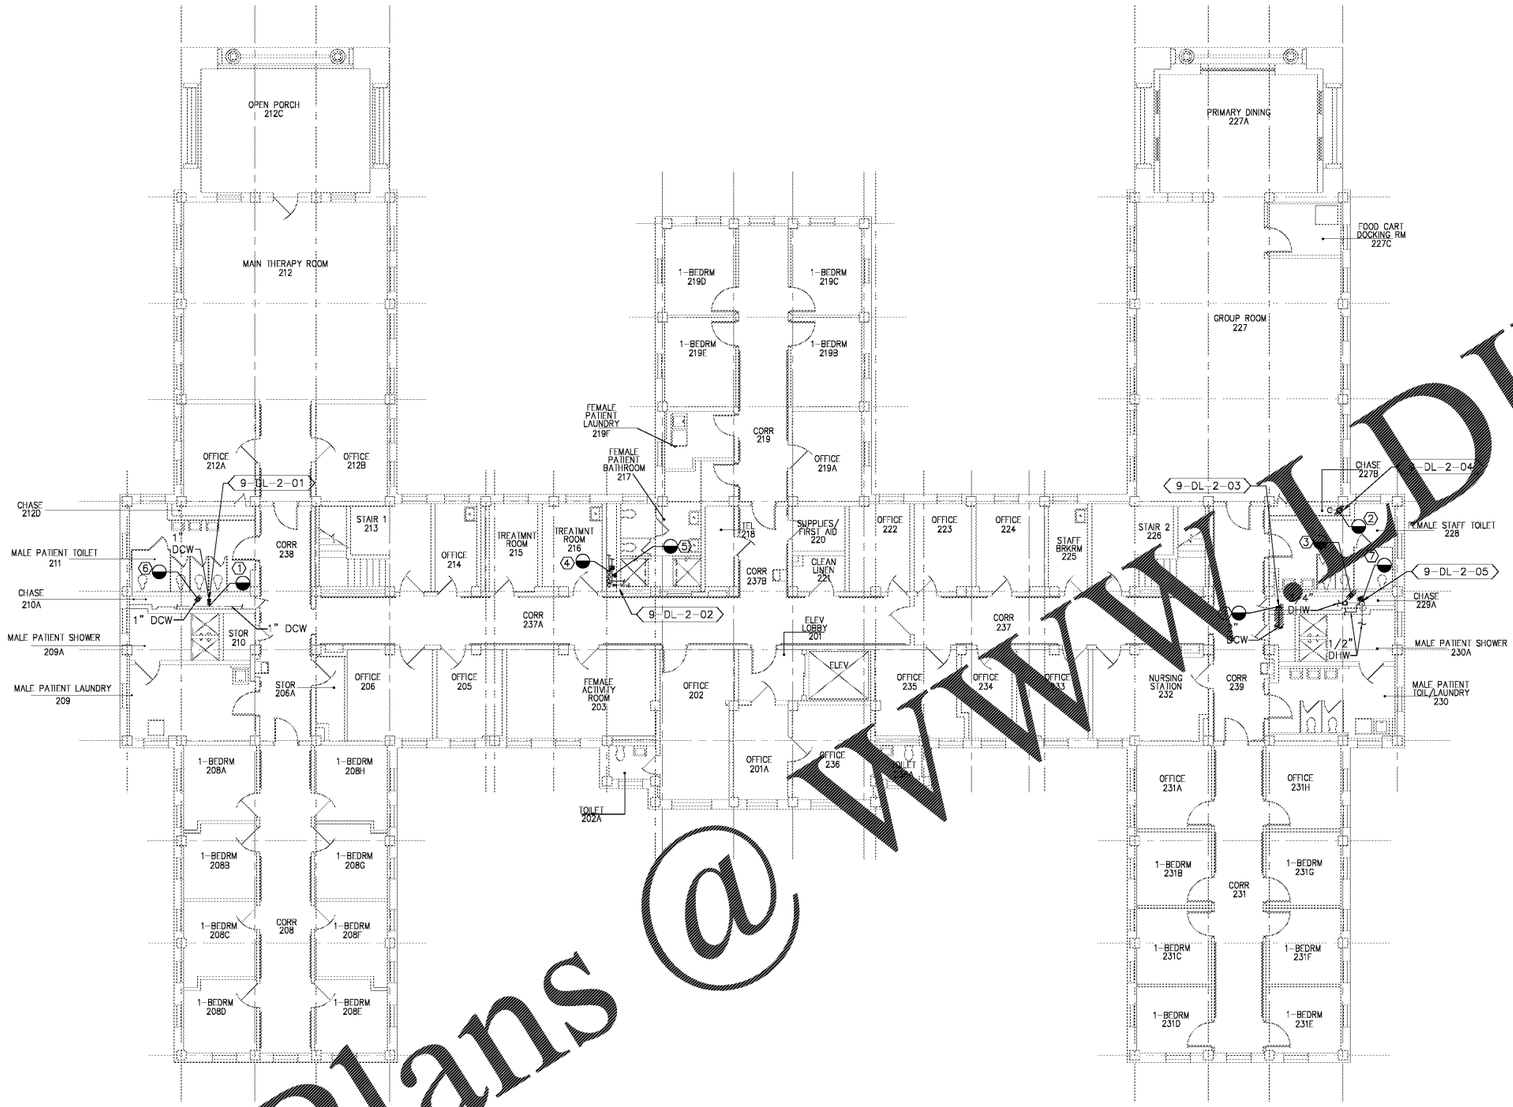

PLAN NORTH

1 SECOND FLOOR PLUMBING DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

DEMOLITION NOTES:

1. REMOVE DEADLEG BACK TO MAIN. REMOVE TEE FROM MAIN AND PROVIDE NEW PIPING AND INSULATION TO MATCH EXISTING.
2. REMOVE APPROXIMATELY 2 FT OF 1" DHW DEADLEG IN VERTICAL. REMOVE TEE WHERE DHWR TIE-IN OCCURS AND REPLACE WITH STRAIGHT PIPE AND ELBOW.
3. REMOVE 1" DEADLEG THAT IS CAPPED 30" ABOVE FLOOR BACK TO MAIN IN CHASE 124A ON FIRST FLOOR. REMOVE TEE AND REPLACE WITH STRAIGHT PIPE AND ELBOWS AS NECESSARY. PROVIDE INSULATION TO MATCH EXISTING. FIRE STOP OPENING IN SLAB UPON REMOVAL OF PIPE.
4. REMOVE 3/4" DHW CAPPED DEADLEG THAT TEES OFF 1" DHW MAIN. REMOVE TEE AND PROVIDE NEW PIPING. PROVIDE FLEXIBLE ELASTOMERIC INSULATION.
5. REMOVE 1/2" DCW CAPPED DEADLEG THAT TEES OFF 1" DCW MAIN. REMOVE TEE AND PROVIDE NEW PIPING. PROVIDE FLEXIBLE ELASTOMERIC INSULATION.
6. REMOVE 1" DEADLEG THAT IS 18" ABOVE FLOOR. REMOVE DEADLEG BACK TO MAIN ON FIRST FLOOR. REMOVE TEE AND REPLACE WITH STRAIGHT PIPE AND ELBOWS AS NECESSARY. PROVIDE INSULATION TO MATCH EXISTING. FIRE STOP OPENING IN SLAB UPON REMOVAL OF PIPE.
7. REMOVE 3/4" DHW DEADLEG OFF VERTICAL THAT IS APPROXIMATELY 6" LONG. REMOVE DEADLEG BACK TO MAIN. REMOVE TEE AND REPLACE WITH STRAIGHT PIPE AND ELBOWS AS NECESSARY. PROVIDE INSULATION TO MATCH EXISTING.

Order Plans @ WWW.DILine.com

Revisions	Date
-	-

Atriax
Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9984
www.atriaxgroup.com

Wiley|Wilson
Wiley|Wilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24288
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PD-9-104 BLDG 9 SECOND FLOOR PLUMBING PLAN DEMOLITION	Project Title: RENOVATE FOR WATER QUALITY		Date: 04/ 28 / 2017
Approved: Chief of Facility Management Svc.	Building Number: 9	Checked: MJG / Drawn: WJC	Project No.: 659-15-101
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153		DRAWING SET: 2592 Dwg. 42 Of 155

Veterans Affairs