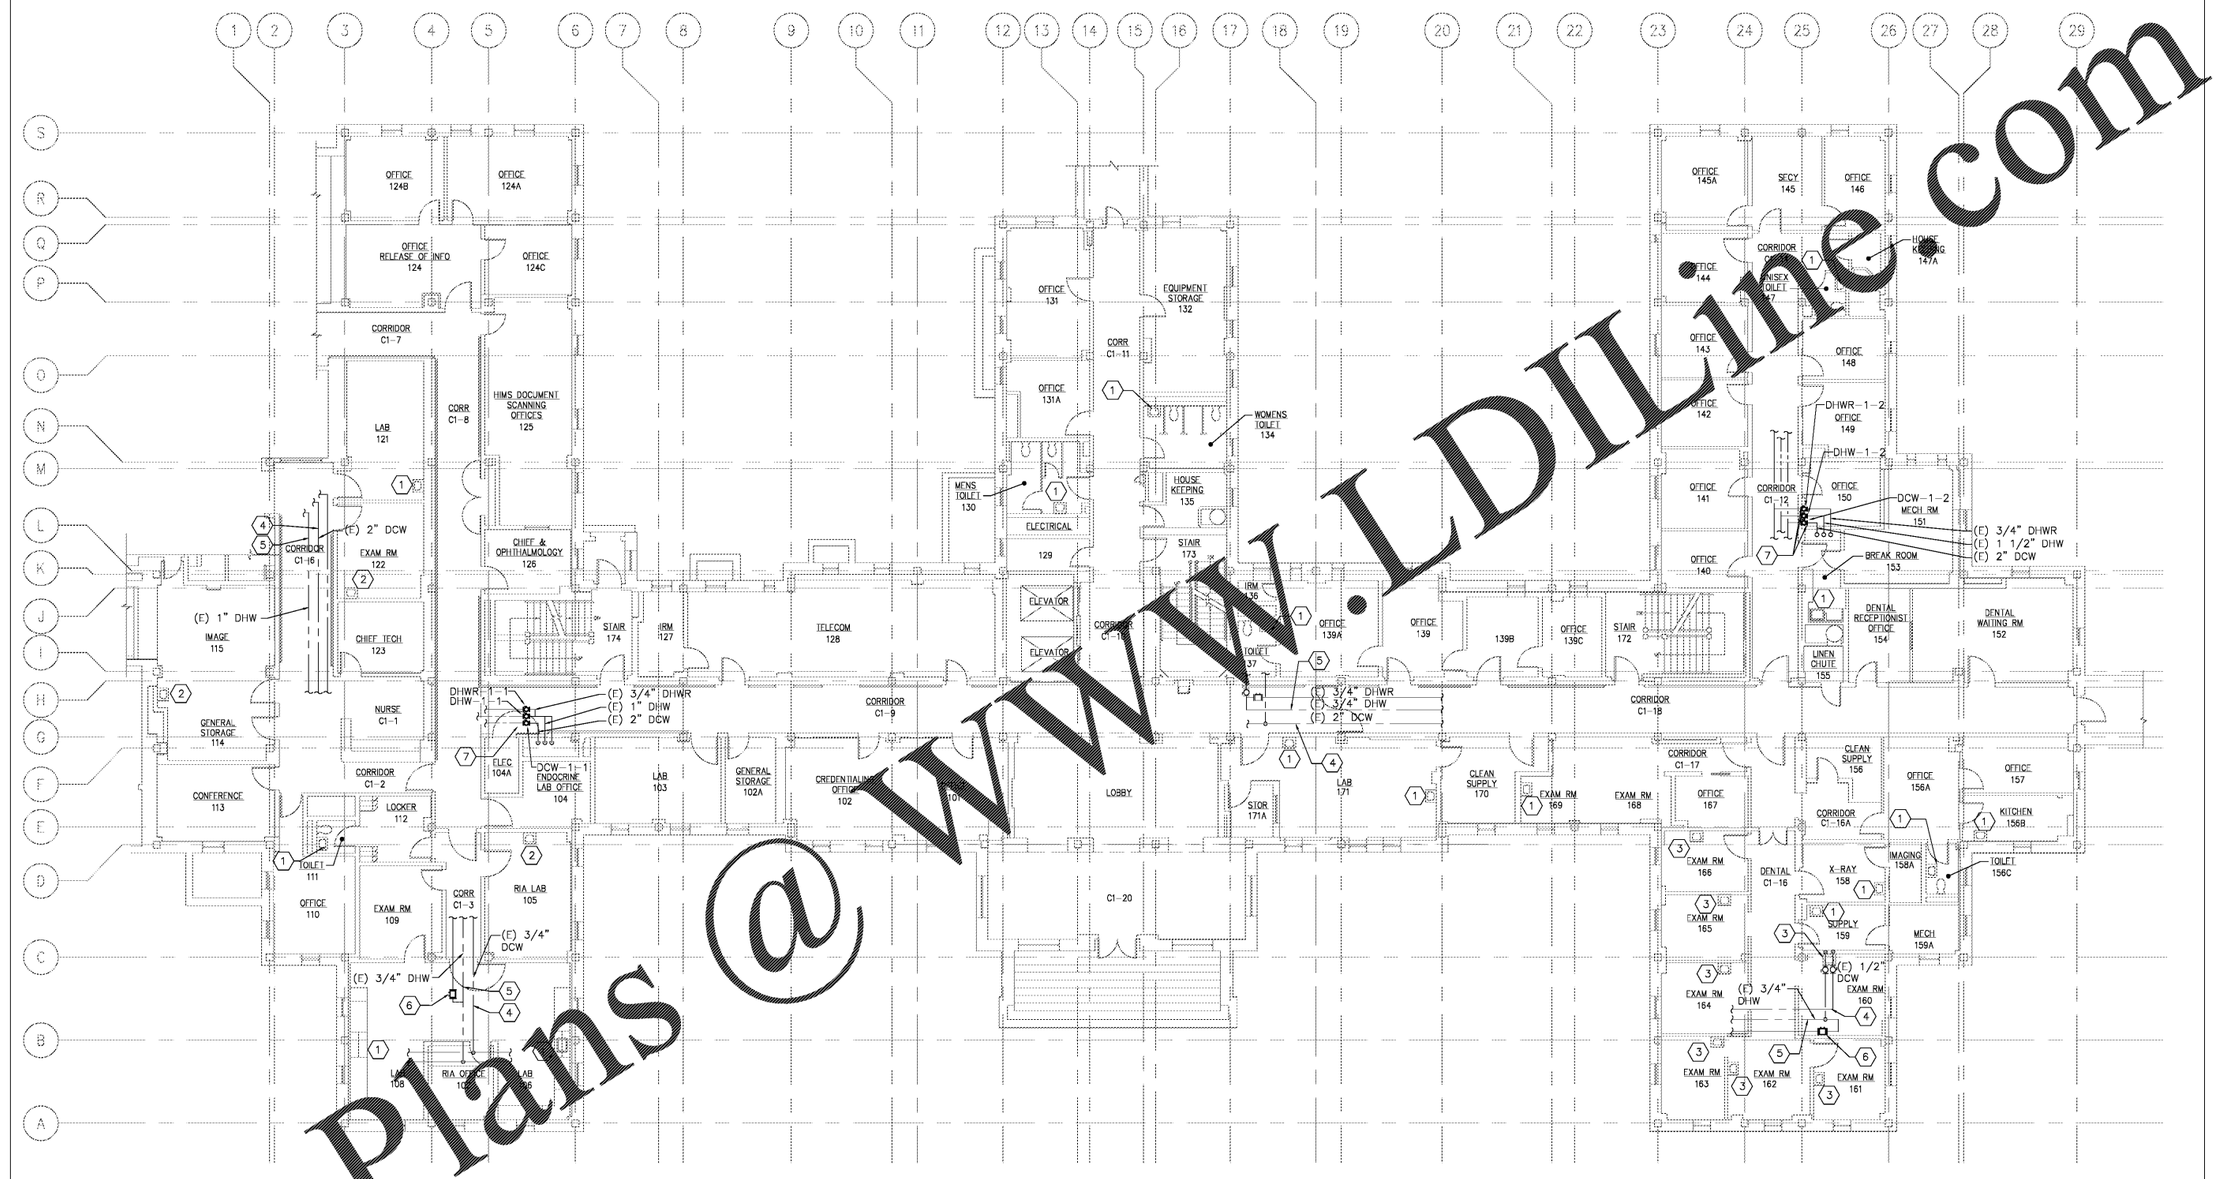

PLAN NORTH

1 **FIRST FLOOR PLUMBING PLAN**
SCALE: 1/8" = 1'-0"

CONSTRUCTION NOTES:

1. PROVIDE THERMOSTATIC MIXING VALVE BELOW SINK/LAVATORY PER DETAIL 'C' ON DRAWING PL-501.
2. PROVIDE THERMOSTATIC MIXING VALVE IN CEILING ABOVE LAVATORY FOOT PEDAL PER DETAIL 'D' ON DRAWING PL-501.
3. PROVIDE THERMOSTATIC MIXING VALVE BELOW COUNTER MOUNTED LAVATORY PER DETAIL 'D' ON DRAWING PL-501.
4. PROVIDE TEMPERATURE TRANSMITTER IN DCW AND CONNECT TO DDC PANEL LOCATED IN MECH/LIFE SAFETY EQUIP RM 21A BASEMENT LEVEL.
5. PROVIDE TEMPERATURE TRANSMITTER IN DHW AND CONNECT TO DDC PANEL LOCATED IN MECH LIFE SAFETY EQUIP RM 21A BASEMENT LEVEL.
6. PROVIDE 3/4" COMBINATION SHUT-OFF/CALIBRATED BALANCING VALVE ON DHWR. BALANCE TO 0.5 GPM.
7. PROVIDE NEW BALL VALVE.

Order Plans @ WWW.LDILine.com

Revisions	Date
-	-

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9984
www.atriaxgroup.com

WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24298
4/22/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title	PL-2-102 BLDG 2 FIRST FLOOR PLUMBING PLAN NEW WORK
Approved: Chief of Facility Management Svc.	
Approved: Medical Center Director	
Project Title	RENOVATE FOR WATER QUALITY
Building Number	2
Checked	MJG
Drawn	JFC
Location	VA MEDICAL CENTER, SALEM, VA 24153
Date	04/ 28 / 2017
Project No.	658-15-101
DRAWING SET	2592
Dwg.	76 Of 155

Veterans Affairs