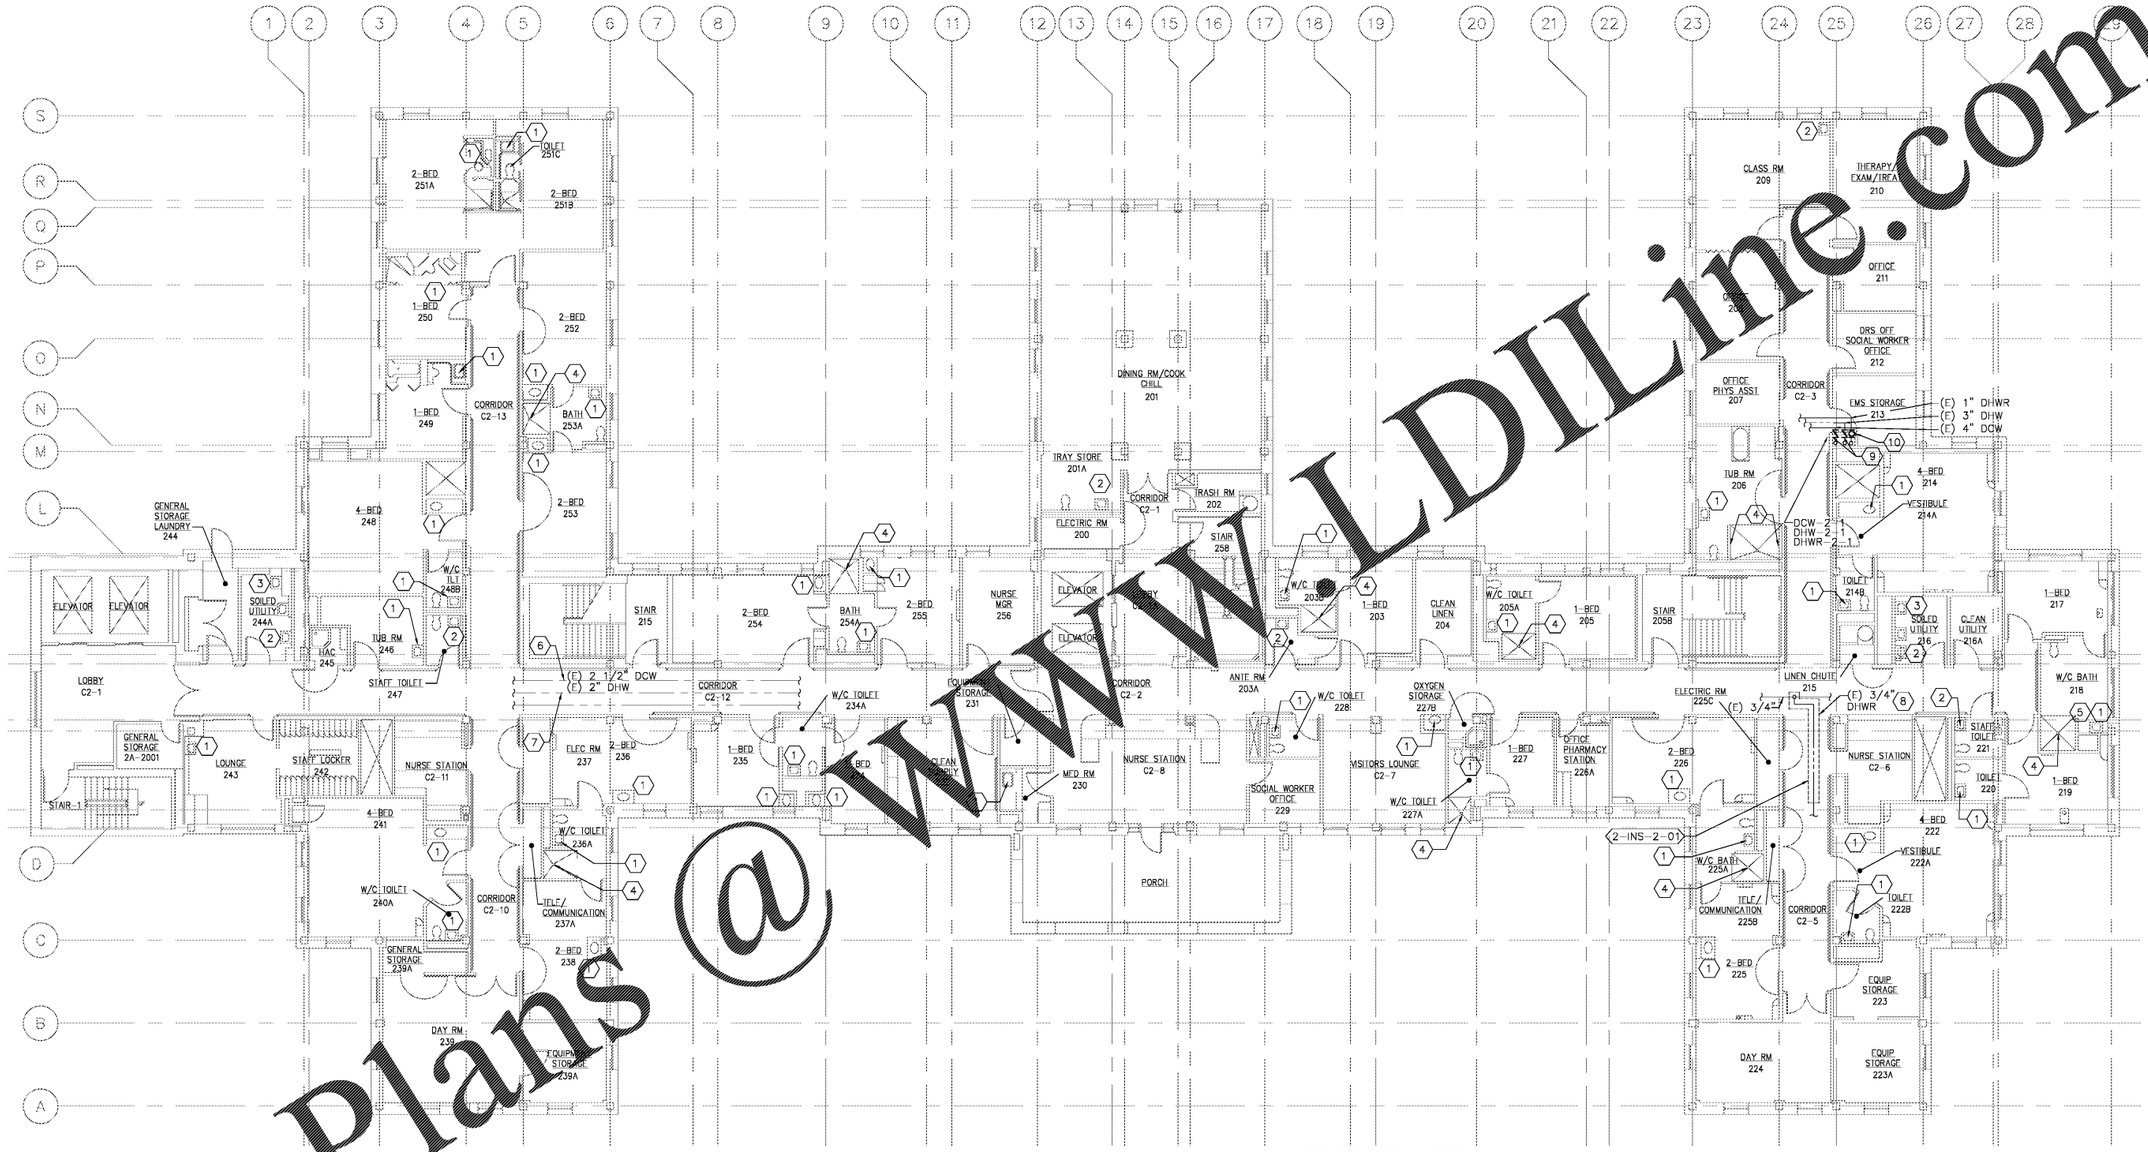

PLAN NORTH

1 **SECOND FLOOR PLUMBING PLAN**
SCALE: 1/8" = 1'-0"

CONSTRUCTION NOTES:

1. PROVIDE THERMOSTATIC MIXING VALVE BELOW SINK/LAVATORY PER DETAIL 'C' ON DRAWING PL-501.
2. PROVIDE THERMOSTATIC MIXING VALVE IN CEILING ABOVE LAV FOOT PEDAL PER DETAIL 'D' ON DRAWING PL-501.
3. PROVIDE THERMOSTATIC MIXING VALVE IN CEILING ABOVE CLINIC SINK FAUCET PER DETAIL 'D' ON DRAWING P-501. MIXING VALVE SHALL SERVE CLINIC SINK FAUCET AND BEDPAN WASHER FOOT PEDAL.
4. REMOVE SHOWER VALVE AND PROVIDE ASSE 1016 THERMOSTATIC AND PRESSURE BALANCING COMBINATION SHOWER VALVE. REMOVE AND REPLACE PORTION OF TILE WALL TO ALLOW INSTALLATION OF NEW SHOWER VALVE.
5. REMOVE FAUCET AERATOR AND PROVIDE LAMINAR FLOW OUTLET.
6. PROVIDE TEMPERATURE TRANSMITTER IN DCW AND CONNECT TO DDC PANEL LOCATED IN MECH/LIFE SAFETY EQUIP RM 21A BASEMENT LEVEL.
7. PROVIDE TEMPERATURE TRANSMITTER IN DHW AND CONNECT TO DDC PANEL LOCATED IN MECH/LIFE SAFETY EQUIP RM 21A BASEMENT LEVEL.
8. INSULATE PIPING TO MATCH EXISTING.
9. PROVIDE NEW BUTTERFLY VALVE
10. PROVIDE NEW BALL VALVE

Order Plans @ WWW.LDILine.com

Revisions	Date
-	-

Atriax
Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

Wiley|Wilson
Wiley|Wilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL W. GEHL
Lic. No. 24298
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PL-2-103 BLDG 2 SECOND FLOOR PLUMBING PLAN NEW WORK	Project Title: RENOVATE FOR WATER QUALITY		Date: 04/28/2017
Approved: Chief of Facility Management Svc.	Building Number: 2	Checked: MJG	Drawn: JFC
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153		Project No.: 658-15-101
			DRAWING SET: 2592
			Dwg. 77 Of 155

Veterans Affairs