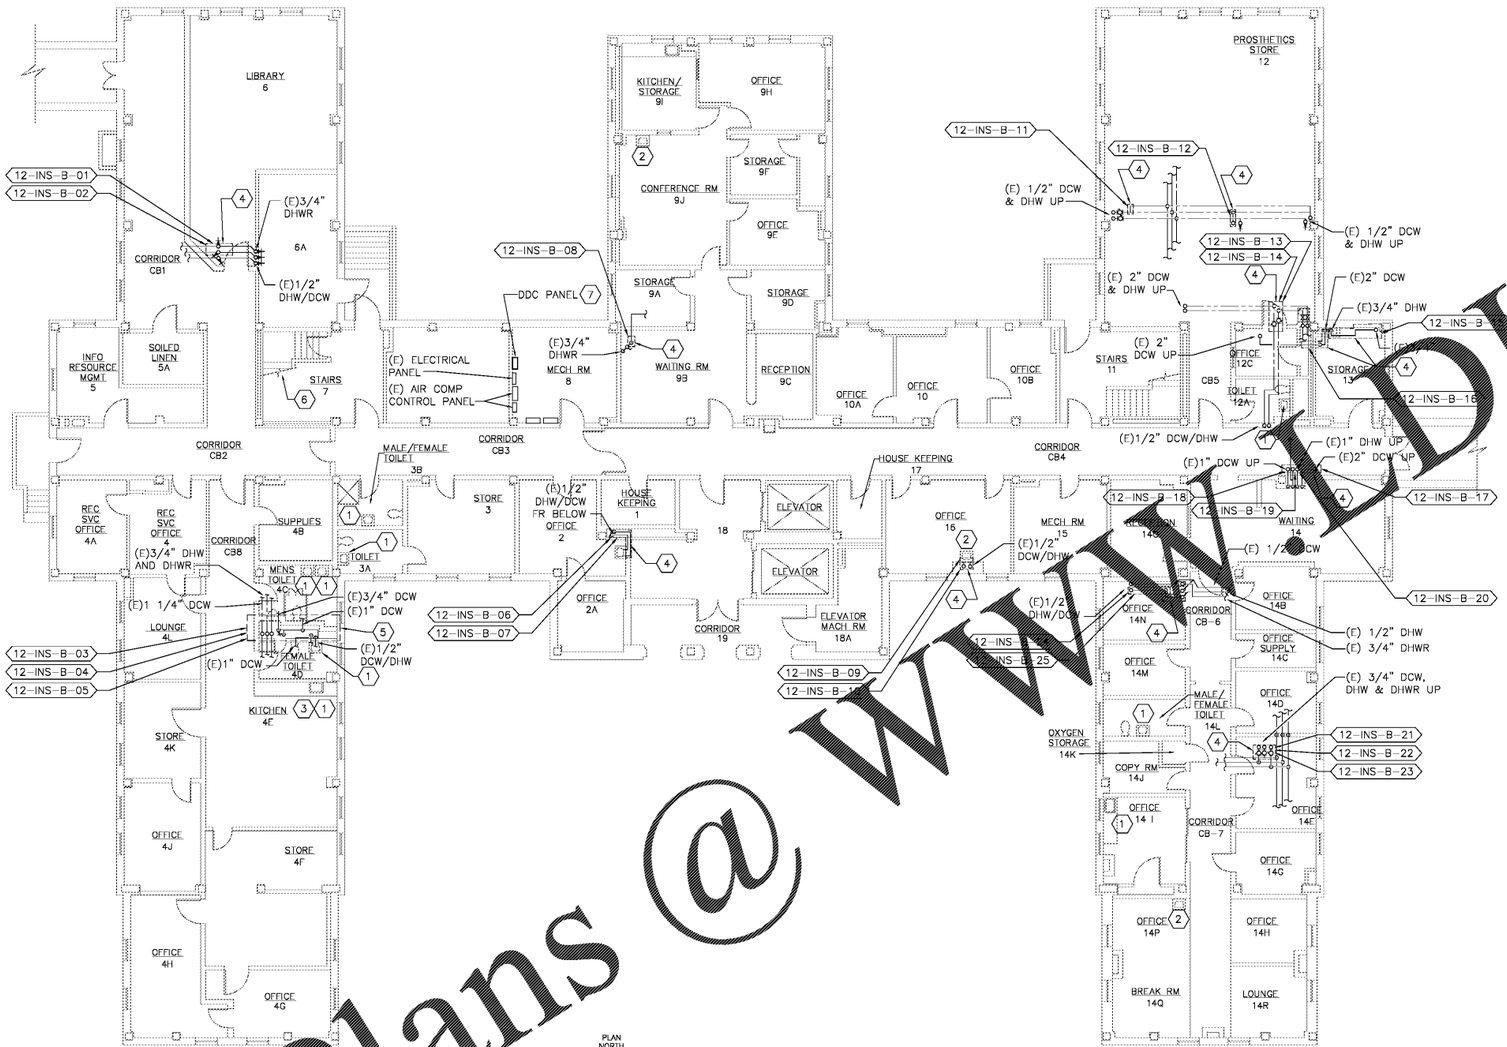

PLAN NORTH

1 **BASEMENT PLUMBING PLAN**
SCALE: 1/8" = 1'-0"

CONSTRUCTION NOTES:

1. PROVIDE THERMOSTATIC MIXING VALVE BELOW SINK/LAVATORY PER DETAIL 'C' ON DRAWING PL-501.
2. PROVIDE THERMOSTATIC MIXING VALVE IN CEILING ABOVE LAV PER DETAIL 'D' ON DRAWING PL-501.
3. REMOVE FAUCET AERATOR AND PROVIDE LAMINAR FLOW OUTLET.
4. INSULATE PIPING WITH FIBERGLASS INSULATION.
5. INSULATE ALL PIPING IN THIS SPACE WITH FIBERGLASS INSULATION.
6. REMOVE AND REINSTALL HANDRAILS AS REQUIRED TO INSTALL DOMESTIC WATER HEATERS. DISASSEMBLE DOMESTIC WATER HEATERS AS REQUIRED TO ALLOW INSTALLATION IN SUB-BASEMENT MECHANICAL ROOM.
7. CONNECT TO EXISTING BUILDING AUTOMATION SYSTEM VIA EXISTING DDC HIGH SPEED TRUNK ISOLATOR EXTENDER. REFER TO DWG PL-12-101 FOR CONNECTION POINT IN SUB-BASEMENT MECHANICAL ROOM.

Order Plans @ WWW.DILIE.com

Revisions	Date
-	-

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9984
www.atriaxgroup.com

WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24288
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PL-12-102 BLDG 12 BASEMENT PLUMBING PLAN NEW WORK

Project Title: RENOVATE FOR WATER QUALITY

Approved: Chief of Facility Management Svc.

Approved: Medical Center Director

Building Number: 12 | Checked: MJG | Drawn: JFC

Location: VA MEDICAL CENTER, SALEM, VA 24153

Date: 04/ 28 / 2017

Project No.: 658-15-101

DRAWING SET: 2592

Dwg. 93 Of 155

Veterans Affairs