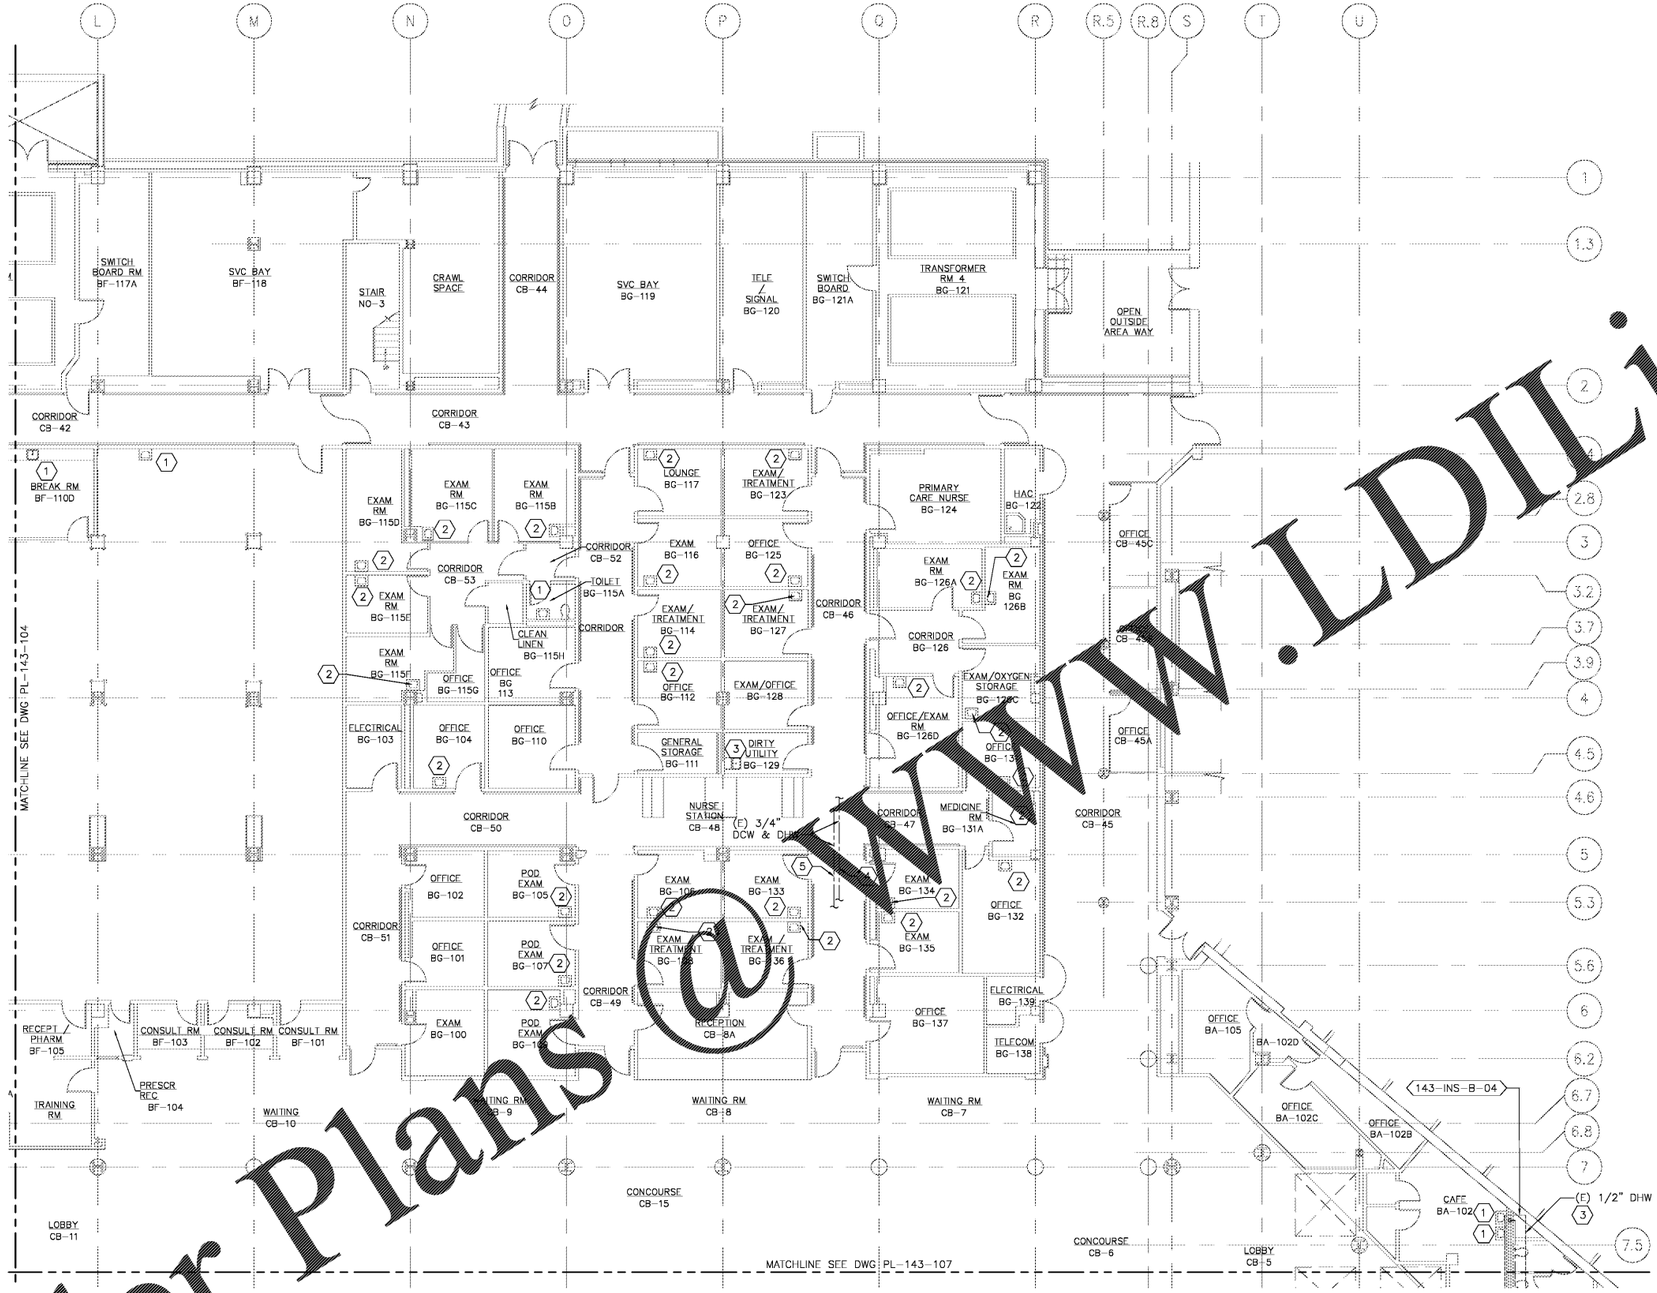

PLAN NORTH

1 **BASEMENT PLUMBING PLAN - AREA "B"**

SCALE: 1/8" = 1'-0"

CONSTRUCTION NOTES:

1. PROVIDE THERMOSTATIC MIXING VALVE BELOW SINK/LAVATORY PER DETAIL 'C' ON DRAWING PL-501.
2. PROVIDE THERMOSTATIC MIXING VALVE IN CEILING ABOVE LAV PER DETAIL 'D' ON DRAWING PL-501.
3. INSULATE PIPING WITH FLEXIBLE ELASTOMERIC INSULATION.
4. PROVIDE TEMPERATURE SENSOR IN DCW AND CONNECT TO DDC PANEL LOCATED IN SUB-BASEMENT MECH RM. REFER TO DWG PL-143-401.
5. PROVIDE TEMPERATURE SENSOR IN DHW AND CONNECT TO DDC PANEL LOCATED IN SUB-BASEMENT MECH RM. REFER TO DWG PL-143-401.



PLAN NORTH

BASEMENT KEY PLAN

Order Plans @ WWW.LDILine.com

Revisions	Date
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24298
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PL-143-105 BLDG 143 BASEMENT PLUMBING PLAN AREA "B" NEW WORK	Project Title: RENOVATE FOR WATER QUALITY		Date: 04/28/2017
			Project No.: 658-15-101
Approved: Chief of Facility Management Svc.	Building Number: 143	Checked: MJG / Drawn: JFC	DRAWING SET: 2592
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153		Dwg. 105 Of 155

Veterans Affairs