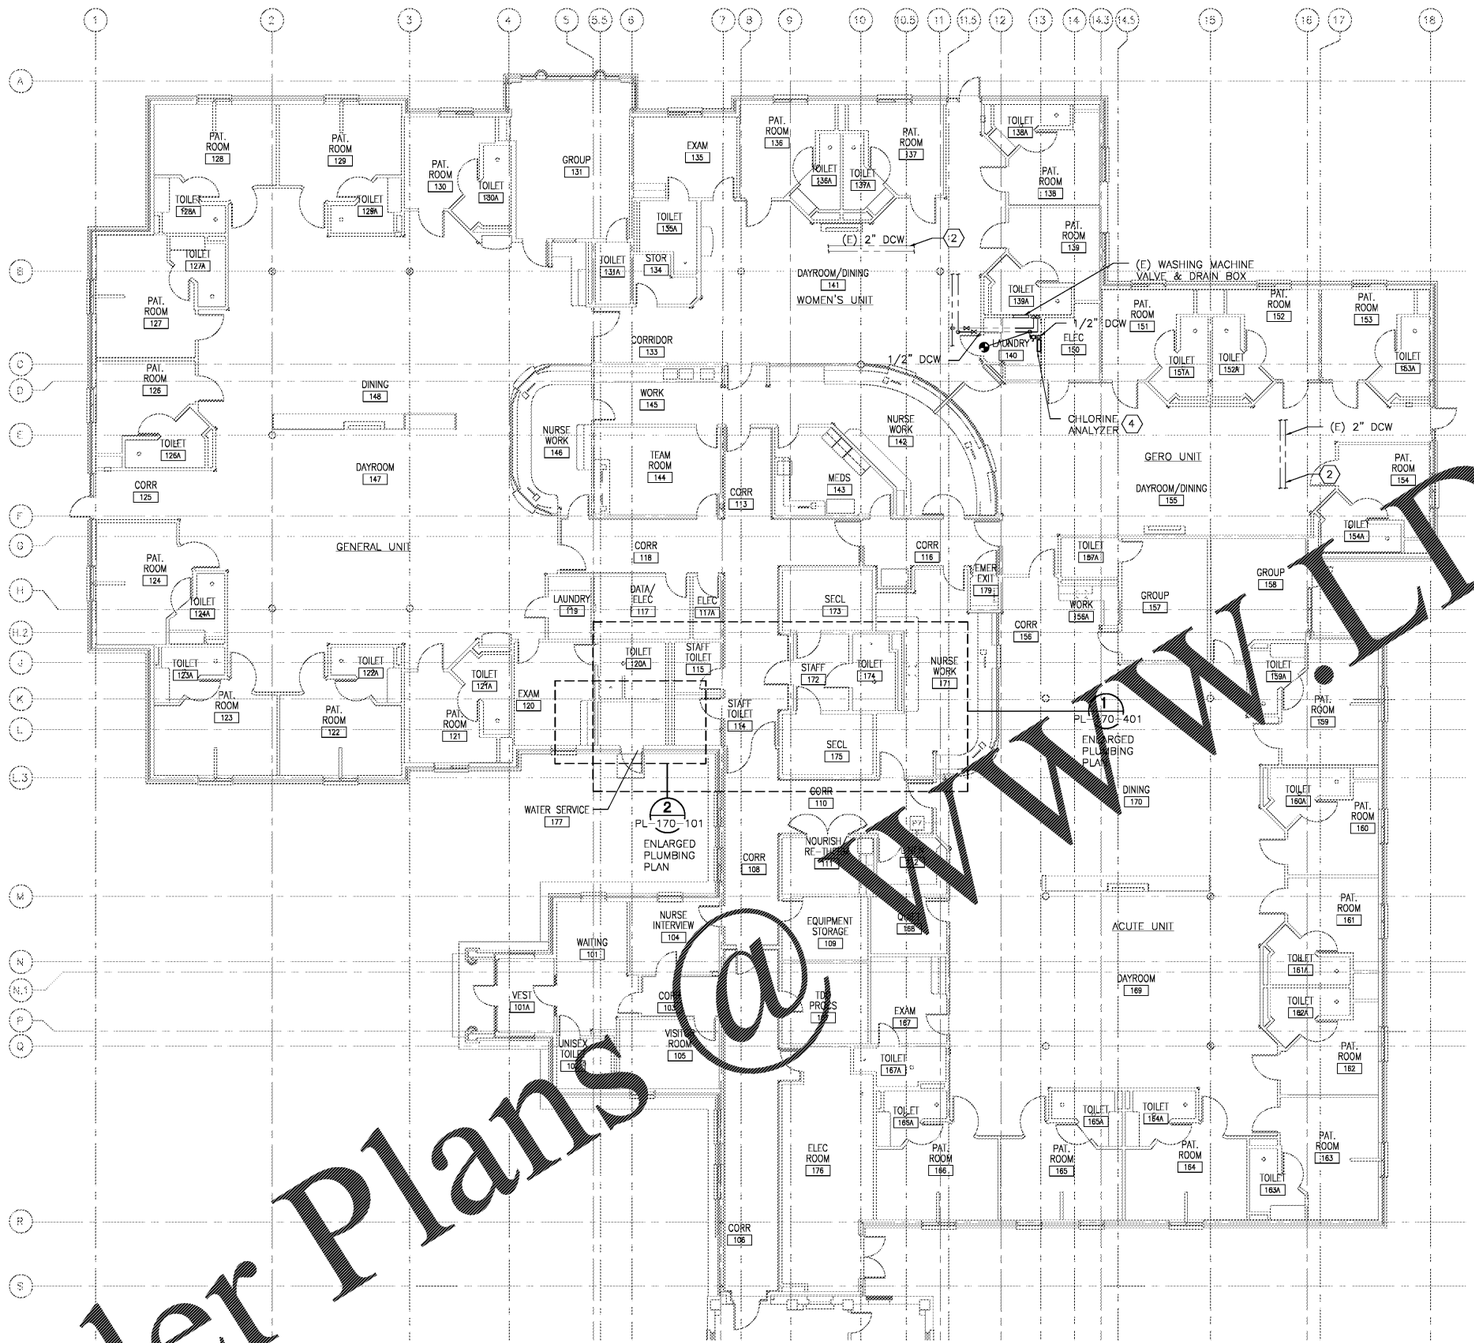

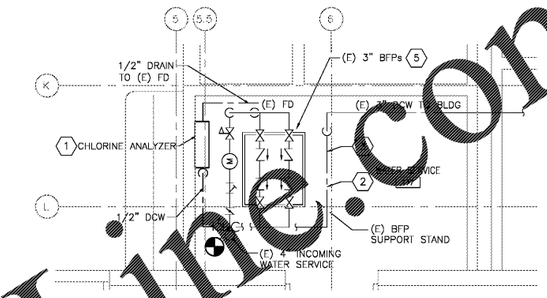

CONSTRUCTION NOTES:

1. PROVIDE CHLORINE ANALYZER. CONNECT TO DDC PANEL LOCATED IN MECHANICAL PENTHOUSE 203.
2. PROVIDE TEMPERATURE TRANSMITTER AND CONNECT TO DDC PANEL LOCATED IN MECHANICAL PENTHOUSE 203.
3. PROVIDE PRESSURE TRANSMITTER AND CONNECT TO DDC PANEL LOCATED IN MECHANICAL PENTHOUSE 203.
4. PROVIDE 1/2" DRAIN AND DISCHARGE INTO WASHING MACHINE DRAIN BOX. CONNECT CHLORINE ANALYZER TO DDC PANEL LOCATED IN MECHANICAL PENTHOUSE 203.
5. INSULATE EXISTING WILKENS/ZURN MODEL 375A BACKFLOW PREVENTERS AND ASSOCIATED SHUT-OFF VALVES.

Order Plans @ WWW.LDIline.com

Revisions	Date
-	-

Atriax
Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

WileyWilson
WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24298
4/25/2017
PROFESSIONAL ENGINEER

CONSTRUCTION DOCUMENTS

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PL-170-101 BLDG 170 BASEMENT PLUMBING PLAN NEW WORK	Project Title: RENOVATE FOR WATER QUALITY		Date: 04/ 28 / 2017
Approved: Chief of Facility Management Svc.	Building Number: 170	Checked: MJG / Drawn: WJC	Project No.: 658-15-101
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153		DRAWING SET: 2592 Dwg. 120 Of 155

Veterans Affairs