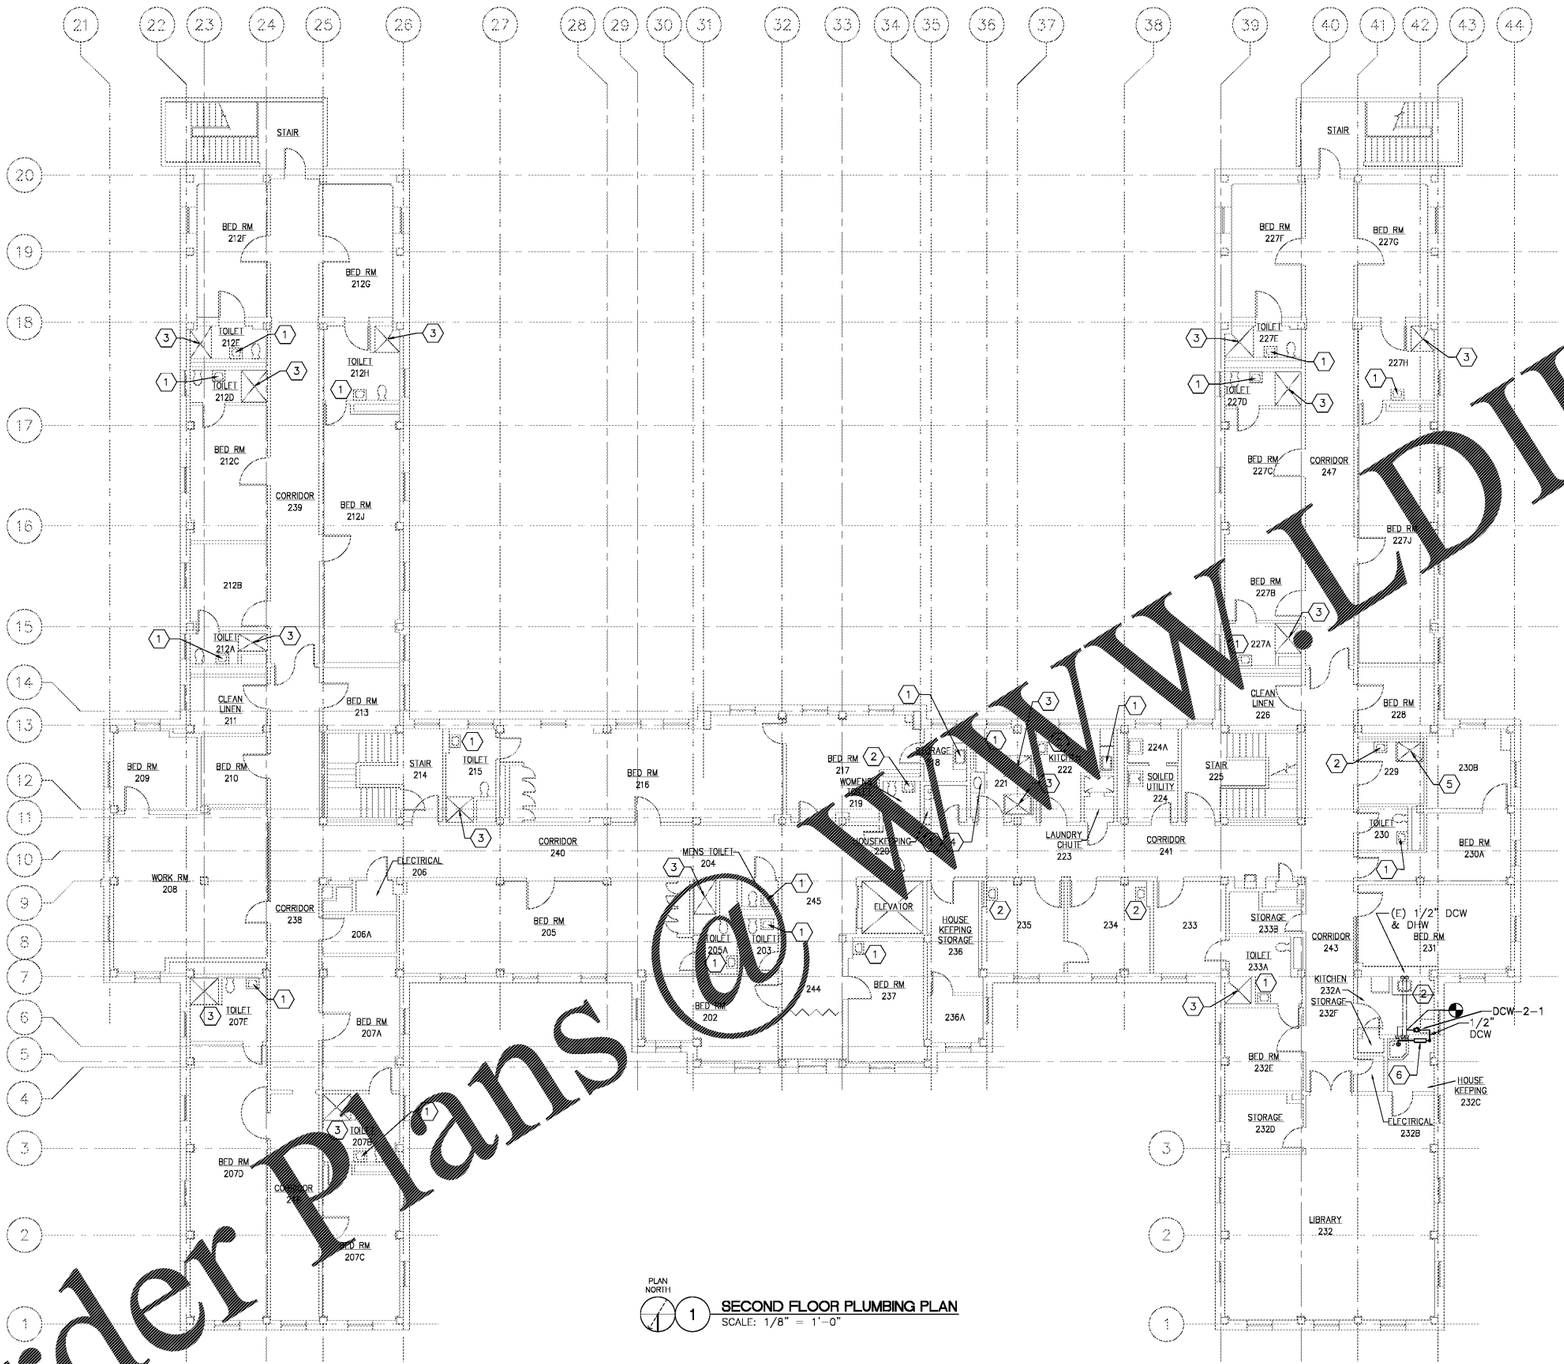

PLAN NORTH

1 SECOND FLOOR PLUMBING PLAN
SCALE: 1/8" = 1'-0"

CONSTRUCTION NOTES:

1. PROVIDE THERMOSTATIC MIXING VALVE BELOW SINK/LAVATORY PER DETAIL 'C' ON DRAWING PL-501.
2. PROVIDE THERMOSTATIC MIXING VALVE IN CEILING ABOVE LAV PER DETAIL 'D' ON DRAWING PL-501.
3. REMOVE SHOWER VALVE AND PROVIDE ASSE 1016 THERMOSTATIC AND PRESSURE BALANCING COMBINATION SHOWER VALVE. REMOVE AND REPLACE PORTION OF TILE WALL TO ALLOW INSTALLATION OF NEW SHOWER VALVE.
4. REMOVE FAUCET AERATOR AND PROVIDE LAMINAR FLOW OUTLET.
5. PROVIDE ASSE 1069 THERMOSTATIC MIXING VALVE AND LOCATE ABOVE CEILING. CONNECT TO EXISTING DOMESTIC HOT AND COLD WATER LINES PER DETAIL 'E' ON DRAWING PL-501. PROVIDE SHUT-OFF VALVES AND SET AT 110 DEGREES FAHRENHEIT.
6. PROVIDE CHLORINE ANALYZER. CONNECT TO PANEL LOCATED IN SUB-BASEMENT MECH RM. PROVIDE 1/2" TEMPLE OUTLET DRAIN PIPING TO SERVICE SINK. PROVIDE SHUTOFF VALVE IN VERTICAL ON 1/2" DCW SUPPLY.

Order Plans @ WWW.LDILine.com

Revisions	Date
-	-

Atriax
Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

WileyWilson
WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24288
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PL-77-104 BLDG 77 SECOND FLOOR PLUMBING PLAN NEW WORK	Project Title: RENOVATE FOR WATER QUALITY		Date: 04/ 28 / 2017
Approved: Chief of Facility Management Svc.	Building Number: 77	Checked: MJG / Drawn: JFC	Project No.: 658-15-101
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153		DRAWING SET: 2592 Dwg. 100 Of 155

Veterans Affairs