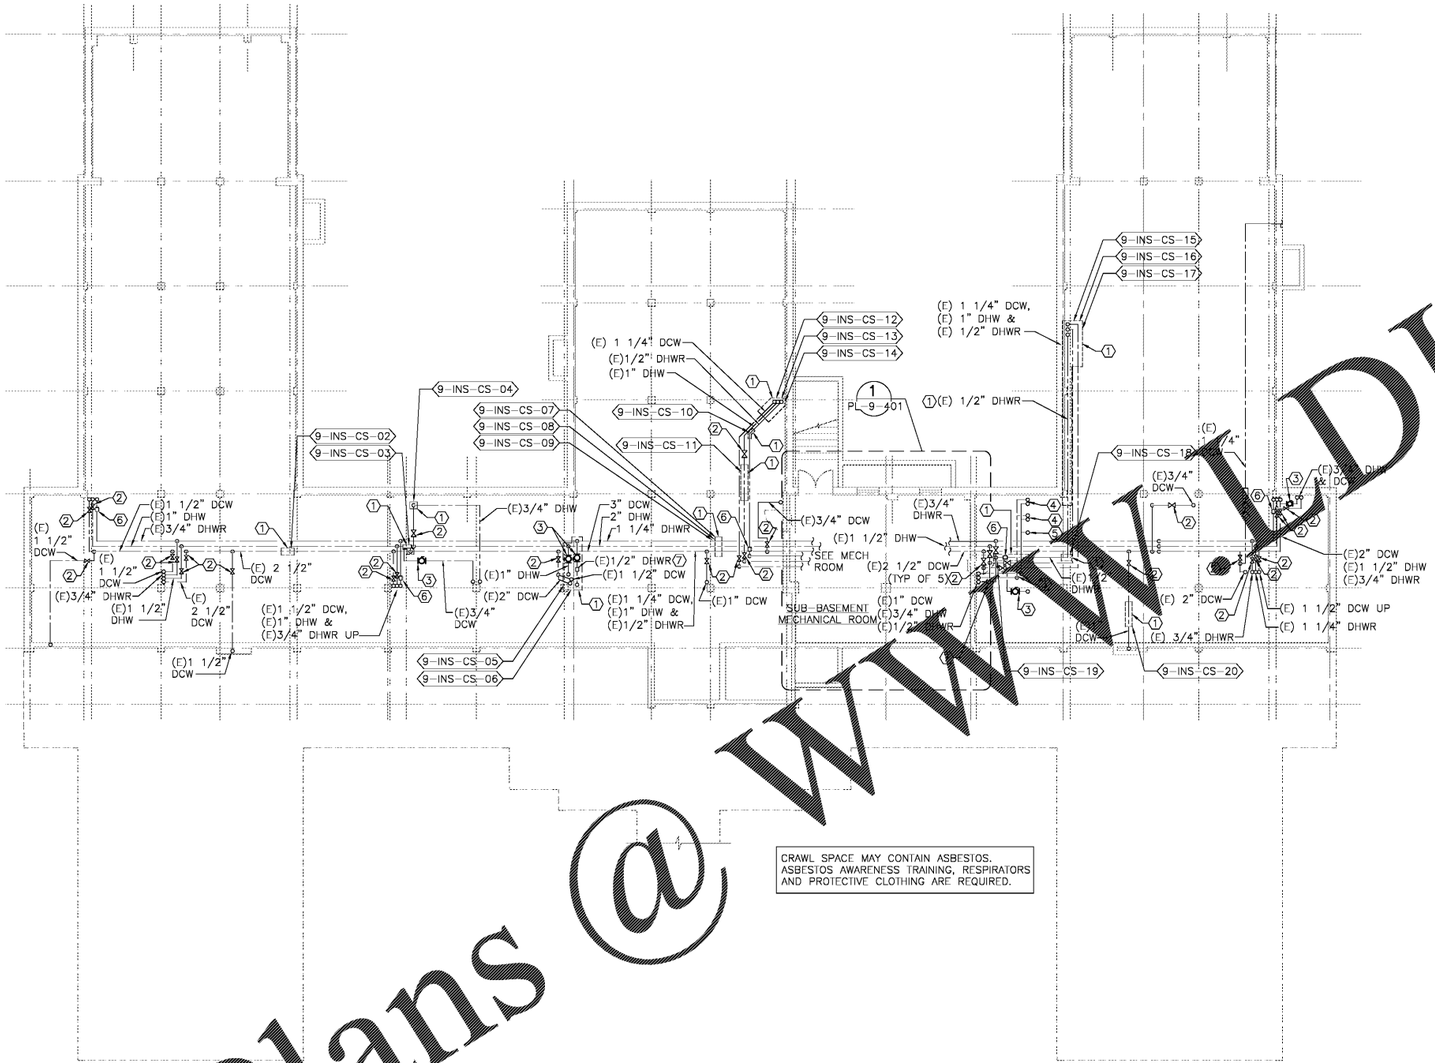

CONSTRUCTION NOTES:

1. INSULATE PIPING WITH FIBERGLASS INSULATION.
2. REPLACE EXISTING GATE VALVE WITH BALL VALVE.
3. PROVIDE NEW BALL VALVE.
4. 3/4" DCW AND 3/4" DHW UP. PROVIDE NEW BALL VALVE AND BRANCH.
5. 3/4" DCW UP. PROVIDE NEW BALL VALVE.
6. REPLACE EXISTING GATE VALVE ON DHWR WITH COMBINATION SHUTOFF/ CALIBRATED BALANCING VALVE. BALANCE TO 1.0 GPM.
7. PROVIDE COMBINATION SHUTOFF/CALIBRATED BALANCING VALVE. BALANCE TO 1.0 GPM.

CRAWL SPACE MAY CONTAIN ASBESTOS. ASBESTOS AWARENESS TRAINING, RESPIRATORS AND PROTECTIVE CLOTHING ARE REQUIRED.

PLAN NORTH

1 **CRAWL SPACE PLUMBING PLAN**
SCALE: 1/8" = 1'-0"

Order Plans @ WWW.DILine.com

Revisions	Date
-	-

Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9984
www.atriaxgroup.com

WileyWilson
127 Nationwide Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24288
4/22/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PL-9-101 BLDG 9 CRAWL SPACE PLUMBING PLAN NEW WORK	Project Title: RENOVATE FOR WATER QUALITY		Date: 04/ 28 / 2017
Approved: Chief of Facility Management Svc.	Building Number: 9	Checked: MJG / Drawn: WJC	Project No.: 658-15-101
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153		DRAWING SET: 2592 Dwg. 87 Of 155

Veterans Affairs