CONSTRUCTION NOTES:

1. PROVIDE THERMOSTATIC MIXING VALVE BELOW SINK/LAVATORY PER DETAIL 'C' ON DRAWING PL-501.
2. INSULATE PIPING WITH FIBERGLASS INSULATION.
3. CONNECT NEW DDC PANEL TO EXISTING BAS NETWORK VIA EXISTING SIEMENS APOGEE BAS. PANEL CONTAINS THE FOLLOWING SIEMENS DEVICES: TXS1.EF4, PXX-485.3, PXC100-PE.A, TXS1.12F4 & TXM1.8X-ML. REFER TO DWG PL-9-401 FOR NEW DDC PANEL.

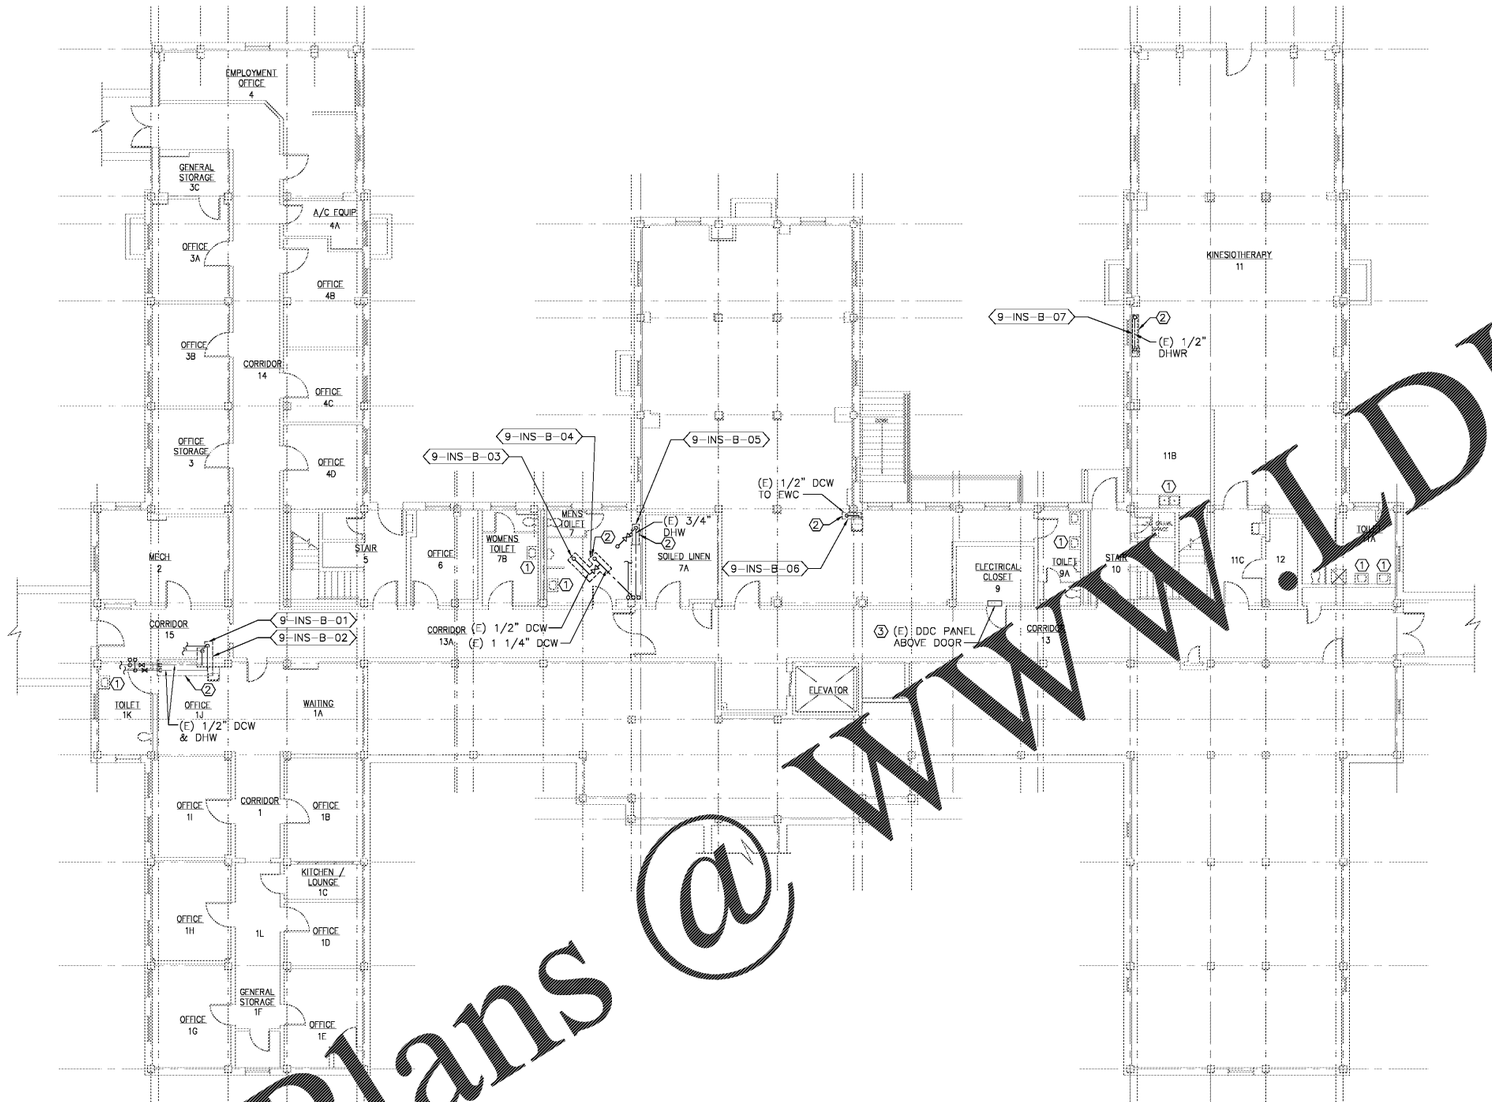

PLAN NORTH

1 **BASEMENT PLUMBING PLAN**
SCALE: 1/8" = 1'-0"

Order Plans @ WWW.LDILine.com

Revisions	Date
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-

Atriax
Atriax, pllc
102 3rd Avenue, NE
PO Box 1629,
Hickory, NC 28603
Phone: 828.315.9962
Fax: 828.315.9964
www.atriaxgroup.com

WileyWilson
WileyWilson
127 Nellcrekde Drive
Lynchburg, VA 24502
Phone: 434.947.1901
www.wileywilson.com

COMMONWEALTH OF VIRGINIA
MICHAEL J. GEHL
Lic. No. 24298
4/28/2017
PROFESSIONAL ENGINEER

Approved: Energy Engineer	Approved: Safety Manager	Approved: Service Chief
CONSTRUCTION DOCUMENTS	Approved: Infection Control Officer	Approved: Chief of Staff
	Approved: GEMS Coordinator	Approved: Associate Director

Drawing Title: PL-9-102 BLDG 9 BASEMENT PLUMBING PLAN NEW WORK	Project Title: RENOVATE FOR WATER QUALITY		Date: 04/ 28 / 2017
Approved: Chief of Facility Management Svc.	Building Number: 9	Checked: MJG / Drawn: WJC	Project No.: 658-15-101
Approved: Medical Center Director	Location: VA MEDICAL CENTER, SALEM, VA 24153		DRAWING SET: 2592 Dwg. 88 Of 155

Veterans Affairs