




TYPICAL DEVICE MOUNTING HEIGHT  
NOT TO SCALE

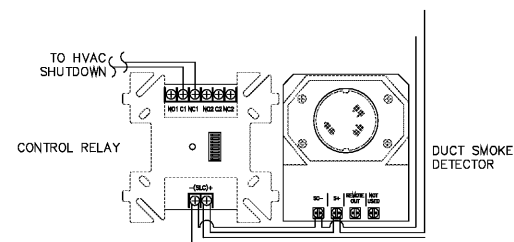


TYPICAL DUCT SMOKE DETECTOR WIRING DETAIL  
NOT TO SCALE

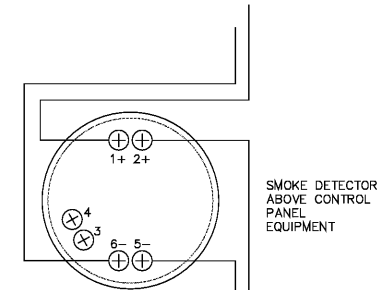


TYPICAL SMOKE DETECTOR WIRING DETAIL  
NOT TO SCALE

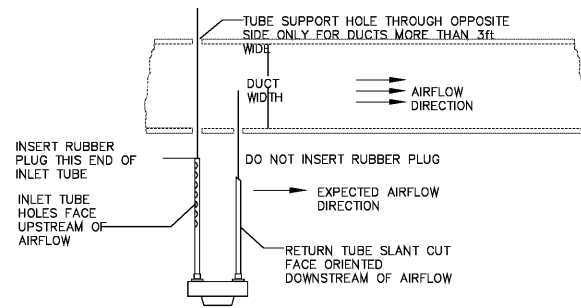


TYPICAL DUCT SMOKE DETECTOR INSTALLATION DETAIL  
NOT TO SCALE

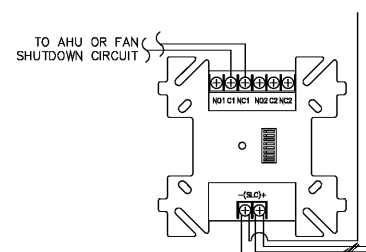


TYPICAL CONTROL RELAY WIRING DETAIL  
NOT TO SCALE

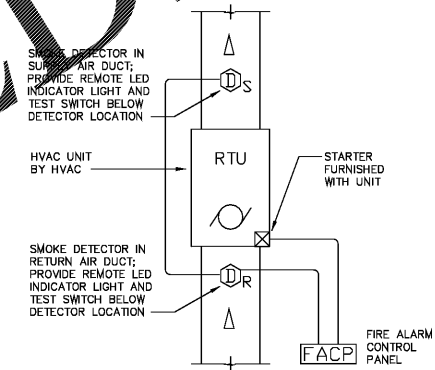


TYPICAL WIRING DIAGRAM - HVAC DUCT SMOKE DETECTOR  
NOT TO SCALE

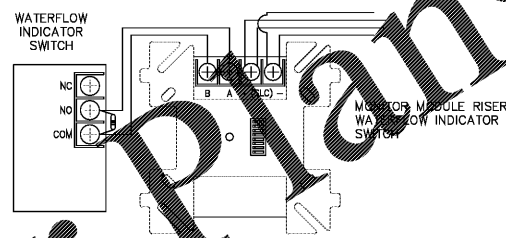

TYPICAL MONITOR MODULE WIRING DETAIL  
NOT TO SCALE

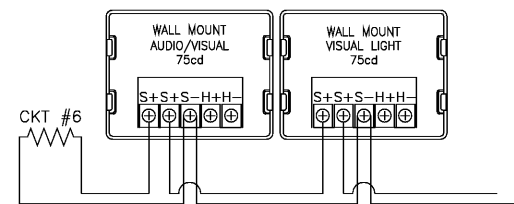

TYPICAL STROBE AND HORN/STROBE WIRING DETAIL  
NOT TO SCALE

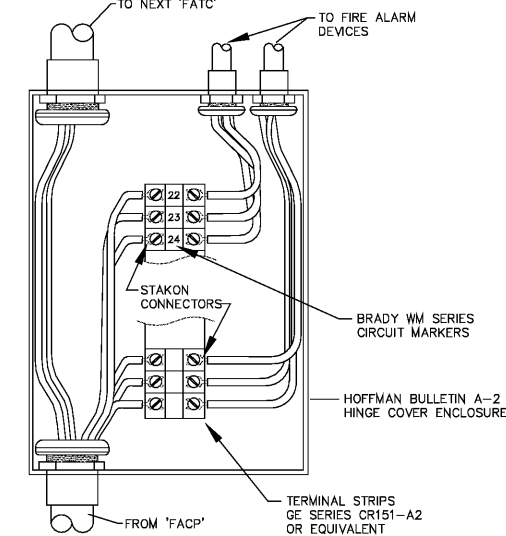

TYPICAL FIRE ALARM TERMINAL CABINET (FACT)  
NOT TO SCALE

GENERAL FIRE ALARM DETAILS:  
FIRE ALARM DETAILS ARE FOR REFERENCE ONLY. REFER TO MANUFACTURER INSTALLATION INSTRUCTION AND REQUIREMENTS FOR EXACT CONNECTIONS AND LAYOUTS.

FIRE ALARM DETAILS  
SCALE: N.T.S.

**GRINER**  
GRINER ENGINEERING, INC.  
1628 First Avenue North  
St. Petersburg, Florida 33713  
Phone: (727)-822-2335  
Fax: (727)-821-3361  
Certificate of Authorization #3173

Date	06-15-2017
Drawn	HH
Designed	HH
EOR	JAR
Job no.	17049

OFFICE OF TAMPA  
CONTRACT ADMINISTRATION  
DEPARTMENT  
PLANNING AND DESIGN DIVISION  
105 E. JACKSON STREET 4 NORTH  
TAMPA, FLORIDA 33602  
p: 813. 274. 8456 - f: 813. 274. 8080  
url: www.tampagov.net

James E. Jackson, Jr., AIA, NOMA  
City Architect  
Edward D. Rice, AIA  
Project Architect  
Kevin L. Henka, AIA  
Project Architect  
Thomas A. Hester, Sr., AIA, NOMA  
Project Architect  
David R. Pagitt  
Supervisor, Architectural Drafting  
Kinsey C. Tillman  
Drafting Technician  
Jerry P. Sanders  
Drafting Technician  
Byron K. Thomas, LEED AP  
Drafting Technician

MEP CONSULTANT  
GRINER ENGINEERING, INC.  
1628 1st. AVENUE NORTH  
ST. PETERSBURG, FL 33713

STRUCTURAL CONSULTANT  
BILLER REINHART  
STRUCTURAL GROUP, INC.  
4014 GUNN HWY. SUITE 240  
TAMPA, FL 33713

CIVIL CONSULTANT  
B M CIVIL LLC  
12315 WYCLIFF PLACE  
TAMPA, FL 33626

LANDSCAPE CONSULTANT  
DAVID CONNER & ASSOCIATES  
1503 W. SWANN AVENUE SUITE 255  
TAMPA, FL 33606

FIRE STATION 23  
20770 TROUT CREEK DR.  
TAMPA, FL 33647

DPW FILE NUMBER

DPW NUMBER  
17-C-00037

ISSUE DATE  
07-28-2017

DRAWN BY

REVISIONS  
△  
△  
△

SEAL

Jose A Rosario, P.E. FL. 74457

SCALE: N.T.S.

FIRE ALARM DETAILS

SHEET NUMBER

E6.2

X OF X

