



KPS GLOBAL PREFABRICATION  
WALK-IN FREEZER/COOLER UNIT

**kps GLOBAL** ENGINEERING BULLETIN NO: 6415  
 SUBJECT: NSF LABELING DATE: April 15, 2014

The National Sanitation Foundation (NSF) in accordance with Standards 7 and 51 establishes minimum food protection and sanitation requirements for the materials, design, manufacture construction and performance of walk-in coolers and freezers and their related components. An NSF inspector audits each of our facilities every three months.

When specified on the drawings, an NSF label is applied to the interior of the door section, latch side or to the interior of the panel adjacent to an opening when a door section is not used.

A standard NSF label is applied to units with panels and refrigeration supplied by KPS Global. An NSF "COMPONENT" label is applied when panels only are supplied by KPS Global and the refrigeration is supplied by someone else.

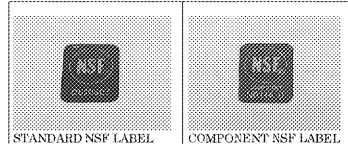


When specified on the drawings, a "PACKAGED PRODUCT ONLY" label is used.

**kps GLOBAL** ENGINEERING BULLETIN NO: 6420  
 SUBJECT: ETL ELECTRICAL LABELING DATE: April 15, 2014

ETL Testing Laboratories has conducted tests and evaluation of KPS Global wiring methods and installation in accordance with UL-471, CAN/CSA C22.2 and the National Electrical Code, NFPA 70. An ETL inspector audits each of our facilities every three months.

An ETL label is applied to the interior of the door section, latch side or to the interior of the panel adjacent to any factory installation of wiring or conduit.

A separate Procedures Manual is included as part of the ETL listing program. Each facility has a separate label and listing number.




**kps GLOBAL** ENGINEERING BULLETIN NO: 6423  
 SUBJECT: UL LABELING DATE: April 15, 2014

Underwriters Laboratories (UL) has conducted flammability tests on KPS Global products in accordance with UL-723 for surface burning characteristics. UL also conducted tests for Canadian Classification in accordance with CANULC-S102 AND ULCOED-C376. A UL inspector audits each of our facilities every three months.

When specified on the drawings, an UL label is applied to the interior of the door section, latch side or to the interior of the panel adjacent to an opening when a door section is not used and to each corner panel (five labels per unit).

A separate Procedures Manual is included as part of the UL listing program. Each facility has a separate label.

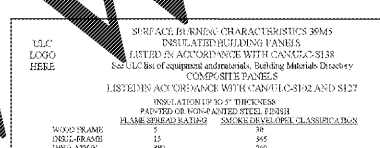

**L** A Brand of Heatcraft Refrigeration Products  
 2175 West Park Place Boulevard  
 Stone Mountain, GA 30087  
 800.532.7775  
 www.heatcraft.com

**PTN042H6AE**

Project:	Dollar Tree Stores	QUOTATION:	Submitted by:	Mike S. Jarrell
Location:	Various	DATE:	7/9/2015	
Customer:		For Record:	<input checked="" type="checkbox"/>	By:
Specs to:	Cooler	For Approval:	<input type="checkbox"/>	Date:

PHYSICAL & ELECTRICAL & CAPACITY DATA

REFRIGERANT	EVAPORATOR CFM	POWER SUPPLY Volts / Ph / Hz	MCA1	MOP1	Unit Amps	NEMA Receptacle	APPROX NET WEIGHT	Refrig Charge (oz)
R404A	340	115/1/60	11.3	15	9.3	3-20A	275	34

CAPACITY (BTUH)

+35°F Room	+38°F Room	0°F Room	-10°F Room	-20°F Room	AMBIENT TEMP CAPACITY (BTUH) at 95°F Ambient
4360	4570	0	0	0	3910



DIMENSIONS (Inches)

A	B	C	D	E	F	G	H	I	J	K
28.1	4	15.3	4.3	20.4						

DIMENSIONS (Inches)

L	M	N	P	R	S	T	U	V	W

WALK-IN COOLER SHEET 1 OF 2

**L** A Brand of Heatcraft Refrigeration Products  
 2175 West Park Place Boulevard  
 Stone Mountain, GA 30087  
 800.532.7775  
 www.heatcraft.com

**PTN042H6AE**


Project:	Dollar Tree Stores	QUOTATION:	Submitted by:	Mike S. Jarrell
Location:	Various	DATE:	7/9/2015	
Customer:		For Record:	<input checked="" type="checkbox"/>	By:
Specs to:	Cooler	For Approval:	<input type="checkbox"/>	Date:

PHYSICAL & ELECTRICAL & CAPACITY DATA

REFRIGERANT	EVAPORATOR CFM	POWER SUPPLY Volts / Ph / Hz	MCA1	MOP1	Unit Amps	NEMA Receptacle	APPROX NET WEIGHT	Refrig Charge (oz)
R404A	300	230/1/60	18.1	20	15.5	6-20R	275	45

CAPACITY (BTUH)

+35°F Room	+38°F Room	0°F Room	-10°F Room	-20°F Room	AMBIENT TEMP CAPACITY (BTUH) at 95°F Ambient
0	0	7000	5360	3910	3910

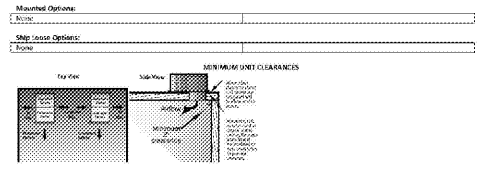

MINIMUM UNIT CLEARANCES

WALK-IN COOLER SHEET 2 OF 2

**L** A Brand of Heatcraft Refrigeration Products  
 2175 West Park Place Boulevard  
 Stone Mountain, GA 30087  
 800.532.7775  
 www.heatcraft.com

**PTN052L6BE**


Project:	Dollar Tree Stores	QUOTATION:	Submitted by:	Mike S. Jarrell
Location:	Various	DATE:	7/9/2015	
Customer:		For Record:	<input checked="" type="checkbox"/>	By:
Specs to:	Freezer	For Approval:	<input type="checkbox"/>	Date:

PHYSICAL & ELECTRICAL & CAPACITY DATA

REFRIGERANT	EVAPORATOR CFM	POWER SUPPLY Volts / Ph / Hz	MCA1	MOP1	Unit Amps	NEMA Receptacle	APPROX NET WEIGHT	Refrig Charge (oz)
R404A	300	230/1/60	18.1	20	15.5	6-20R	275	45

CAPACITY (BTUH)

+35°F Room	+38°F Room	0°F Room	-10°F Room	-20°F Room	AMBIENT TEMP CAPACITY (BTUH) at 95°F Ambient
0	0	7000	5360	3910	3910

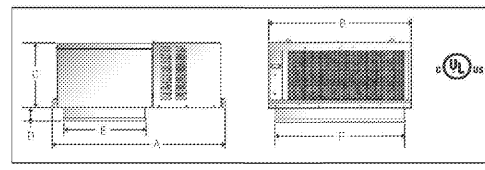

MINIMUM UNIT CLEARANCES

WALK-IN FREEZER SHEET 1 OF 2

**L** A Brand of Heatcraft Refrigeration Products  
 2175 West Park Place Boulevard  
 Stone Mountain, GA 30087  
 800.532.7775  
 www.heatcraft.com


**PTN052L6BE**

Project:	Dollar Tree Stores	QUOTATION:	Submitted by:	Mike S. Jarrell
Location:	Various	DATE:	7/9/2015	
Customer:		For Record:	<input checked="" type="checkbox"/>	By:
Specs to:	Freezer	For Approval:	<input type="checkbox"/>	Date:

STANDARD FEATURES

- Galvalume® Construction
- Top view door with extruded gasket for sealing
- Exterior venting for outdoor temperature control
- Insulated floor with urethane and polyurethane insulations
- Systems to factory assembled, equipped, charged, run tested and ready for use or have components installed
- Colletts are filtered from heavy duty compressors
- 2 year product warranty

- Options:
- Door-to-door fasteners
  - RSC fan motor (available on all models)
  - EC motor on all models

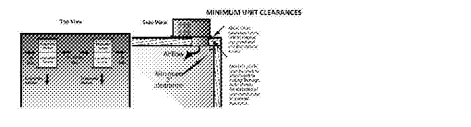

MINIMUM UNIT CLEARANCES

WALK-IN FREEZER SHEET 2 OF 2

- GENERAL NOTES:
- THE PROPOSED FREEZER/COOLER UNIT SIZE IS INDICATED ON FLOOR PLAN.
  - ALL WALK-IN & MERCHANDISING UNITS ARE SELF CONTAINED AND DO NOT REQUIRE A FLOOR DRAIN.
  - REFER TO SPECIFICATIONS.
  - INSTALLATION OF THESE NSF, ETL & UL LISTED UNITS SHALL CONFORM WITH ALL STATE AND LOCAL CODES PER APPROVED PLANS.

FOR REFERENCE ONLY

WWW.LDILine.com

Order Plans @

description  
by  
mark date  
revisions

FOR INFORMATION ONLY

REFRIGERATION SPECIFICATIONS  
 project  
drawing

D53