


Order Plans

WWW.LDILine.COM

@

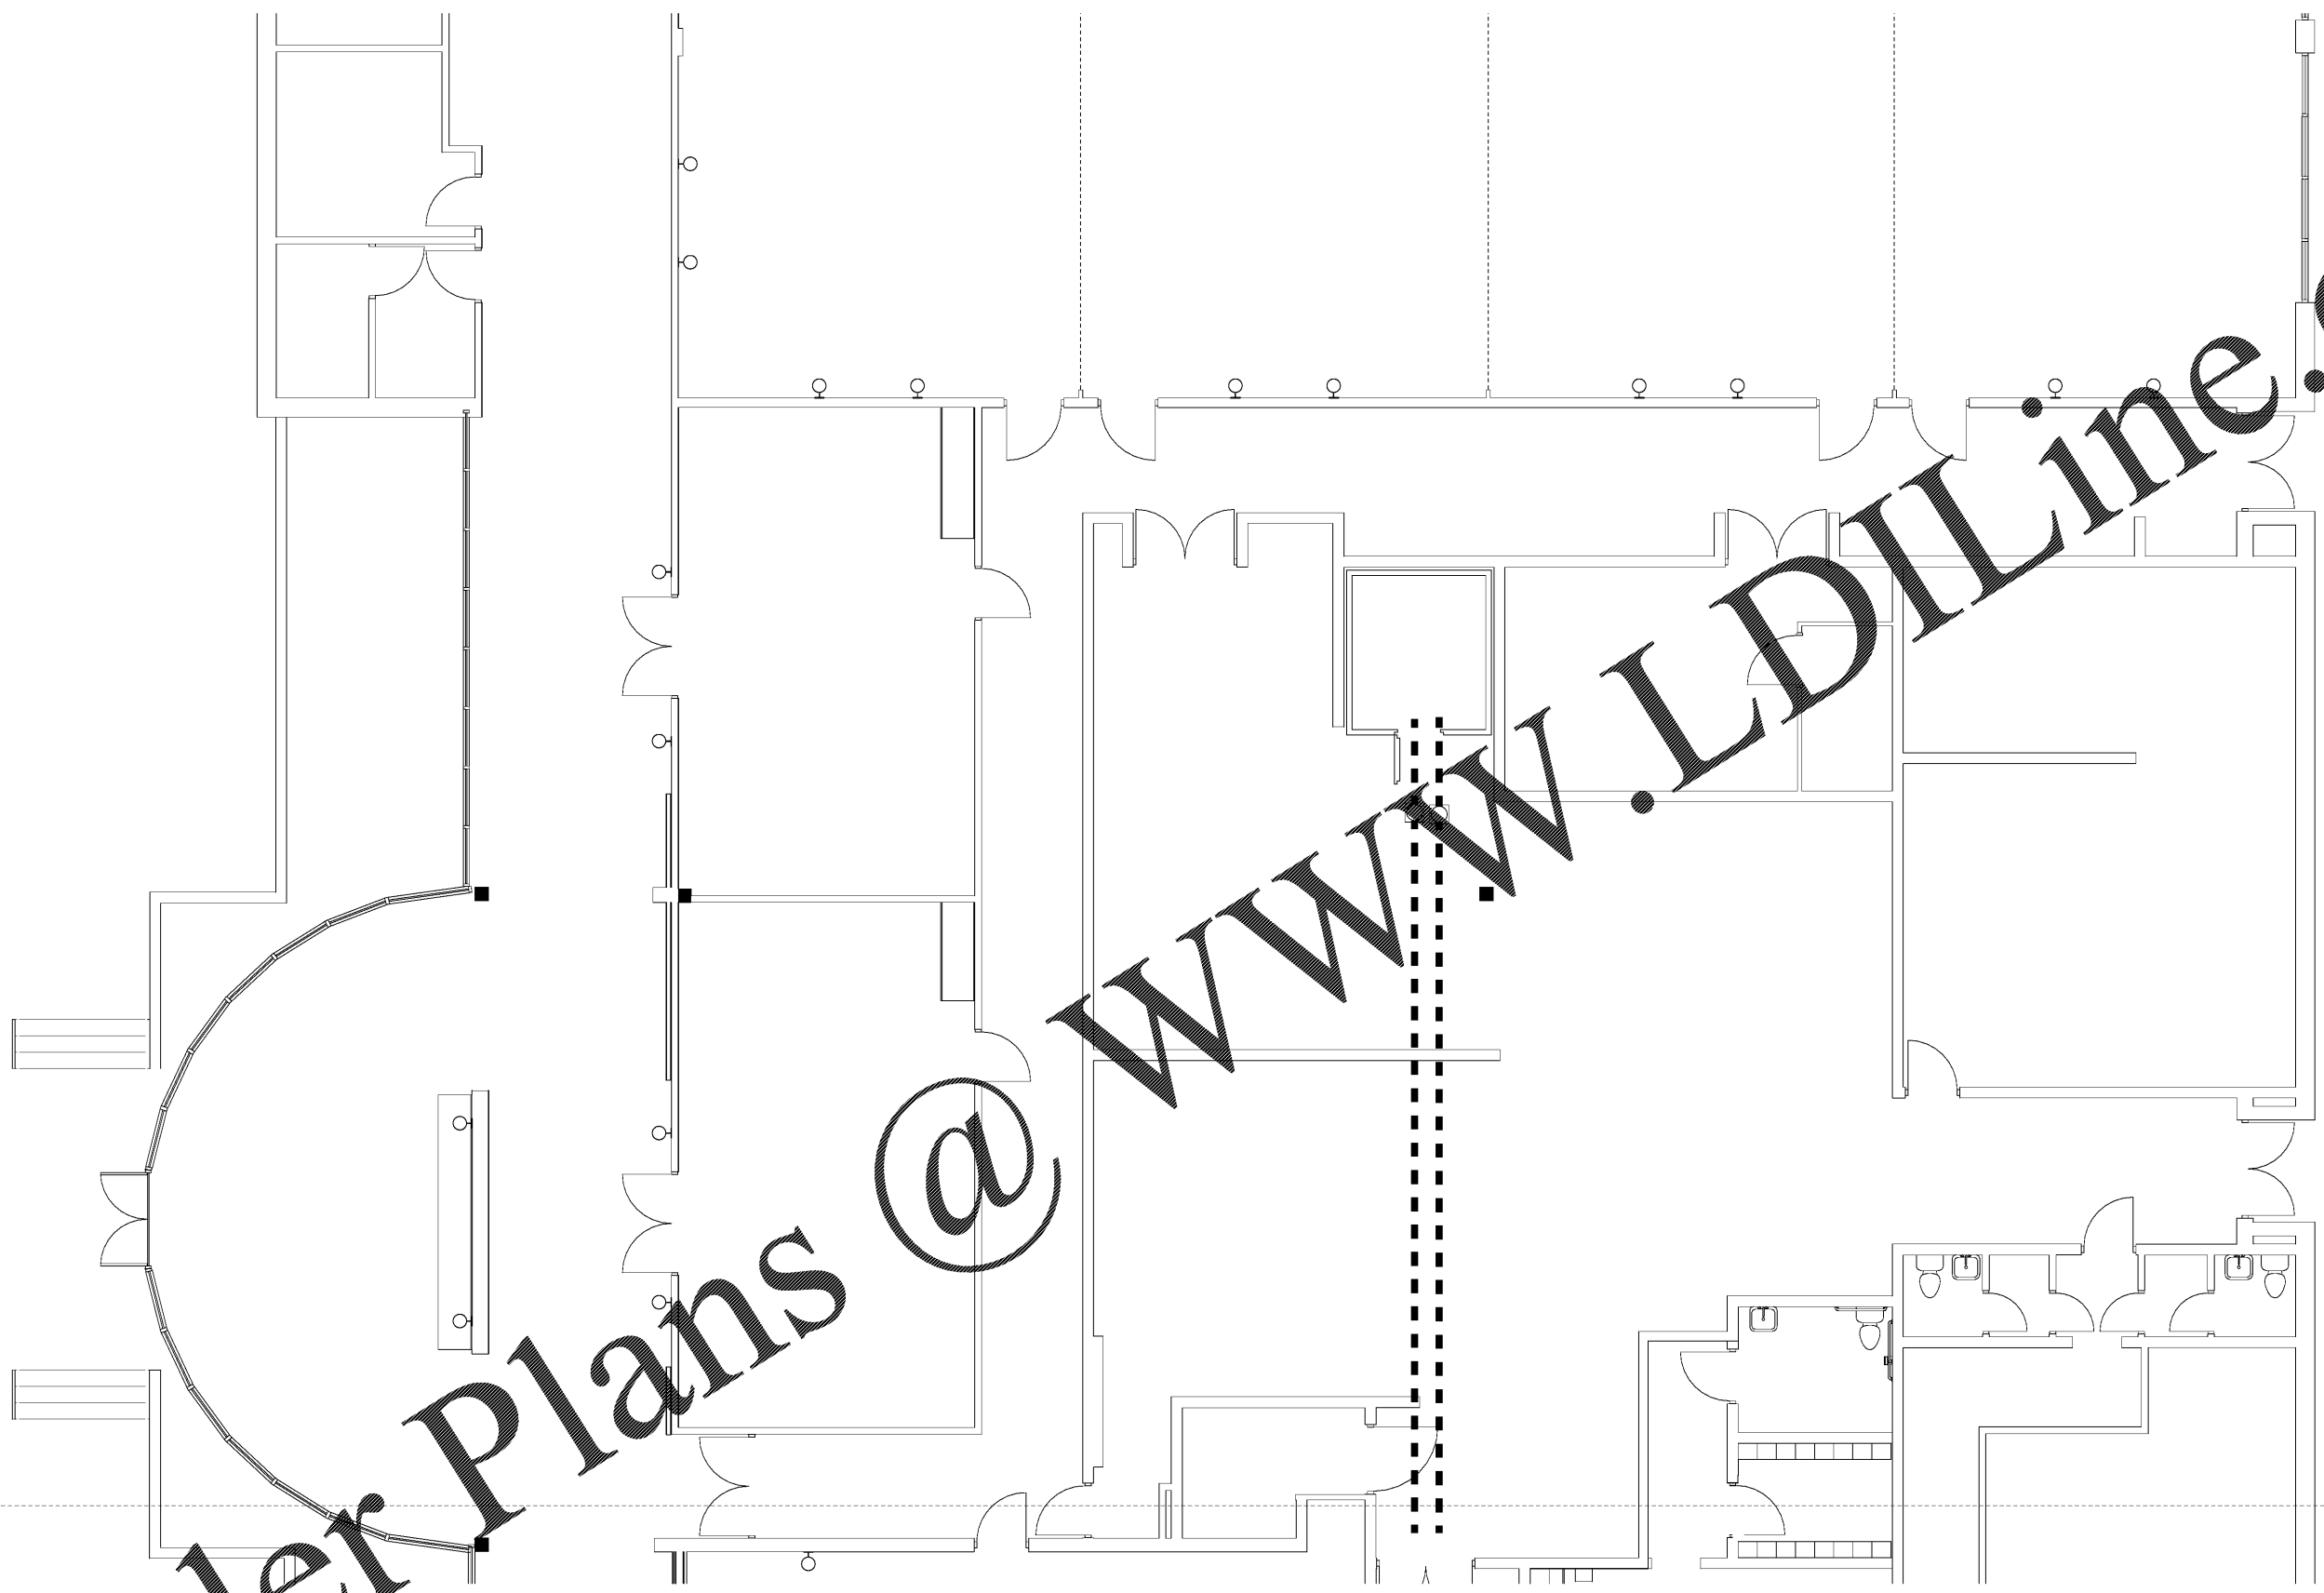

○ *PULL* JUNCTION BOXES

PROVIDE 8 INCH INSIDE DIAMETER EMT CONDUIT PLUS SCHEDULE 40 CONDUIT AND FITTINGS, OR EQUAL. ALL JOINTS SHALL BE SOLVENT CEMENTED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

PLUMBING STYLE SHORT RADIUS FACTORY "ELLS" ARE NOT ACCEPTABLE.

PROVIDE 36" RADIUS SWEEP ELBOWS UP TO BAR, WHERE SHOWN, FOR BEER LINE RUNS.

PULL JUNCTION BOXES TO BE 3'-0" X 18" X 18" H WHERE SHOWN.



△	For Owner	6/10/17
△	Revised Beer Tower	7/7/17
△		
△		
△		
△		
NO.	REVISION	DATE

Double Tree Hotel
ADDRESS
SUITE NUMBER
Birmingham, Alabama

FOODSERVICE
EQUIPMENT
BEER LINE RUNS

APPROVED
DATE
DESIGNED BY: BRIGHT
DRAWN BY:
SCALE:
DATE: 07.31.17
JOB NO.

SHEET

K-6