

HOOD INFORMATION

HOOD NO.	TAG	MODEL	LENGTH	MAX. COOKING TEMP.	EXHAUST PLENUM (RSERS)						MJA CFM	AC CFM	HOOD CONSTRUCTION	HOOD CONFIG.		
					TOTAL EXH. CFM	WIDTH	LENG.	HEIGHT	DIA.	CFM				S.P.	END TO END	ROW
1		5424 ND-2-ACSP-F	15' 0.00"	600 Deg.	3900	9"	37"	4"		3900	-0.720"	2912	660	430 SS Where Exposed	ALONE	ALONE

HOOD INFORMATION

HOOD NO.	TAG	FILTER(S)				LIGHT(S)				UTILITY CABINET(S)			FIRE SYSTEM PIPING	HOOD HANGING WEIGHT			
		TYPE	QTY.	HEIGHT	LENGTH	EFFICIENCY @ 9 MICRONS	QTY.	TYPE	WIRE GUARD	LOCATION	SIZE	FIRE SYSTEM			ELECTRICAL	SWITCHES	
1		SS Baffle with Handles	11	16"	16"	30%	9	L55 Series E26	NO	Left	12"x54"x24"	Ansul Piranha	10	SC-311110FP	1 Light 1 Fan	YES	1030 LBS


HOOD OPTIONS

HOOD NO.	TAG	OPTION
1		FIELD WRAPPER 17.00" High Front, Left, Right
		BACKSPLASH 120.00" High X 240.00" Long 430 SS Vertical
		LEFT QUARTER END PANEL 23" Top Width, 0" Bottom Width, 23" High 430 SS
		RIGHT QUARTER END PANEL 23" Top Width, 0" Bottom Width, 23" High 430 SS
		STRUCTURAL FRONT PANEL

PERFORATED SUPPLY PLENUM(S)


HOOD NO.	TAG	POS.	LENGTH	WIDTH	HEIGHT	TYPE	RSERS				
							WIDTH	LENG.	DIA.	CFM	S.P.
1		Front	192"	26"	6"	MJA	12"	28"		970	0.287"
						MJA	12"	28"		970	0.287"
						MJA	12"	28"		970	0.287"
						AC	6"	16"		220	0.074"
						AC	6"	16"		220	0.074"
						AC	6"	16"		220	0.074"

*** DUCT SENSOR WIRED TO TURN ON FANS IN COOKING MODE

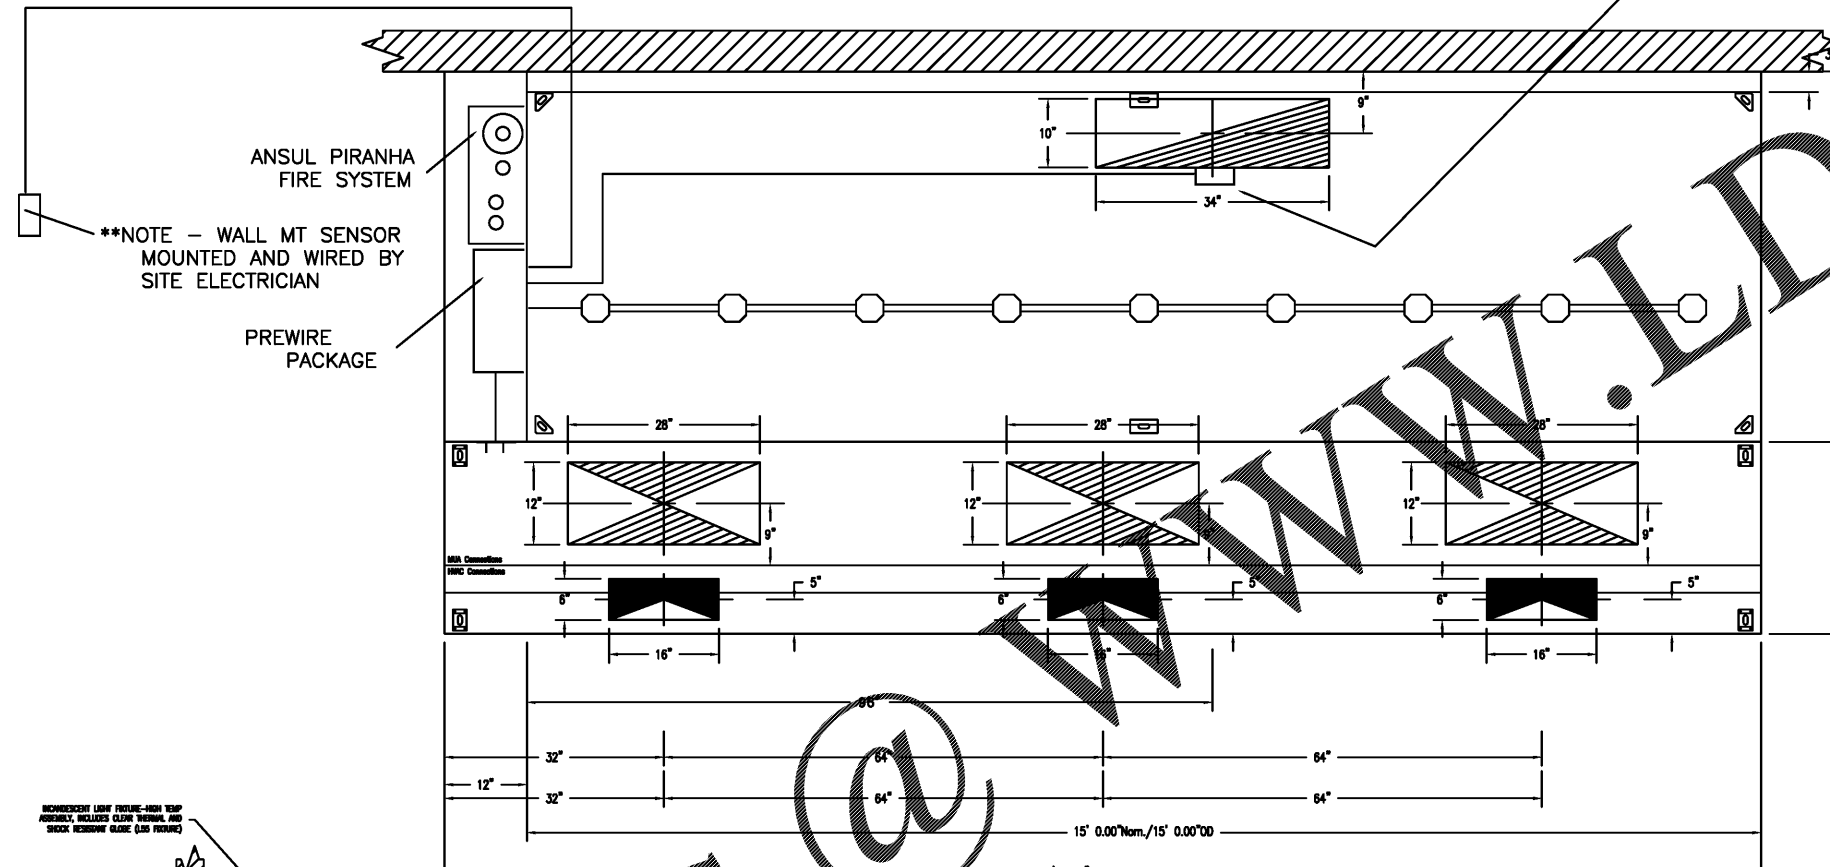

PLAN VIEW - Hood #1
 15' 0.00" LONG 5424ND-2-ACSP-F
 NOTE: Additional hanging angles provided for hoods 12' and longer.

ACSP ships loose for field installation

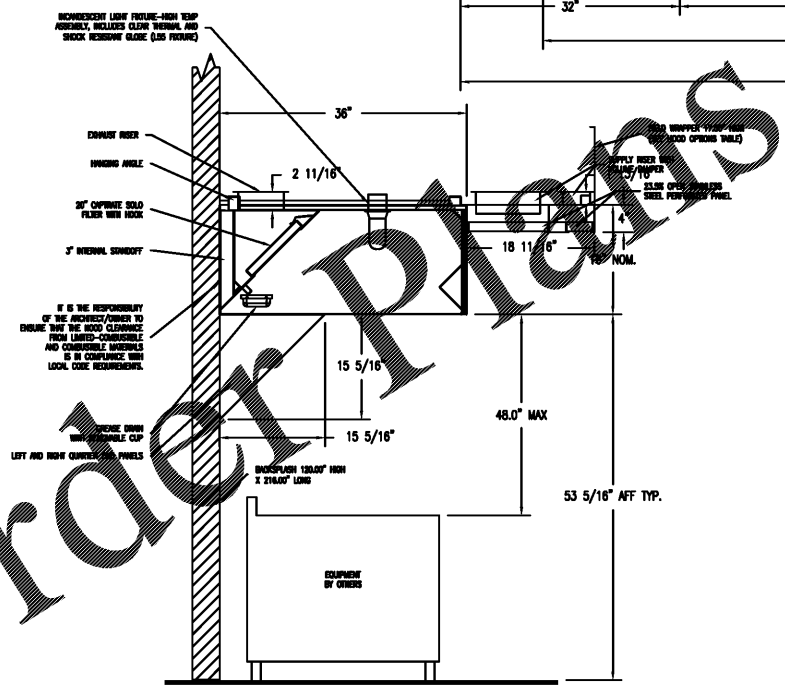

SECTION VIEW - MODEL 5424ND-2-ACSP-F

***** NOTE *****
 ALL WALLS THAT COME WITHIN 18" OF HOOD MUST BE METAL STUDS AND SHEETROCK. WOOD STUDS NOT ALLOWED.

CAPTIVE-AIRE HOODS ARE BUILT IN COMPLIANCE WITH





Intertek NFA #96
 NSF
 UL 710 & ULC710 STANDARDS
 E.T.L. LISTED 3054804-001

FOR QUESTIONS, CALL THE
 PIEDMONT NORTH CAROLINA OFFICE
 LONNIE GRANT (REGIONAL MANAGER)
 PHONE: 336-996-8484, FAX: 336-996-0418
 EMAIL: reg30@captiveaire.com

REVISIONS

NO.	DESCRIPTION	DATE

DATE: _____
 DWG.#: _____
 DRAWN BY: _____
 SCALE: NTS
 HOOD
 SHEET NO. 1

LANDSEY ARCHITECTURE
 125 S. Salisbury Street, Suite 300
 Salisbury, NC 27401
 P. 336.617.4402
 F. 336.617.4434
 www.landseyarchitecture.com

VP ENGINEERING
 VRETTOS PAPPAS CONSULTING ENGINEERS, P.A.
 193 Saw 21547, Charlotte, NC 28233
 2819 Colleton Drive, Ste 101, Charlotte, NC 28227
 704.322.7705 vpe@vpce.com

COOK OUT
 975 W. Poplar Ave.
 Collierville, TN

KITCHEN HOOD DETAILS

Date 07-11-17
 Drawn By MM
 Check By SRP
 Job No. 17-019-000
 Sheet
M4

Order Plans