






Sanitary Sewer Tap, Lower Lateral & Clean-Out Diagram

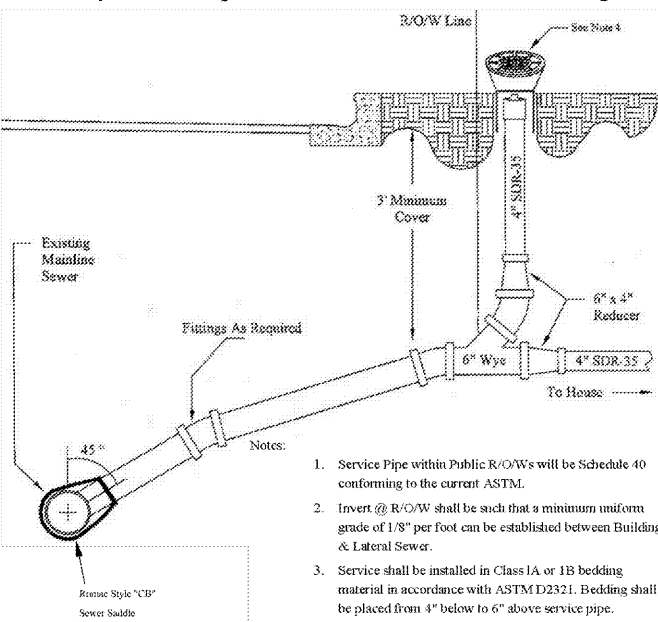

- Notes:
1. Service Pipe within Public R/O/Ws will be Schedule 40 conforming to the current ASTM.
 2. Invert @ R/O/W shall be such that a minimum uniform grade of 1/8" per foot can be established between Building & Lateral Sewer.
 3. Service shall be installed in Class 1A or 1B bedding material in accordance with ASTM D2321. Bedding shall be placed from 4" below to 6" above service pipe.
 4. A Cast Iron Valve box with "SEWER" indicated on the lid will be installed @ ground level to protect the clean-out.

Revised: July 26, 2007

Gantt Fire, Sewer & Police District
 1201 White Horse Road
 Greenville, South Carolina 29605
 (864) 277-7301 Option 1
 WWCs@GanttDistrict.org

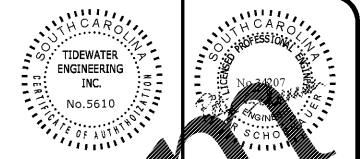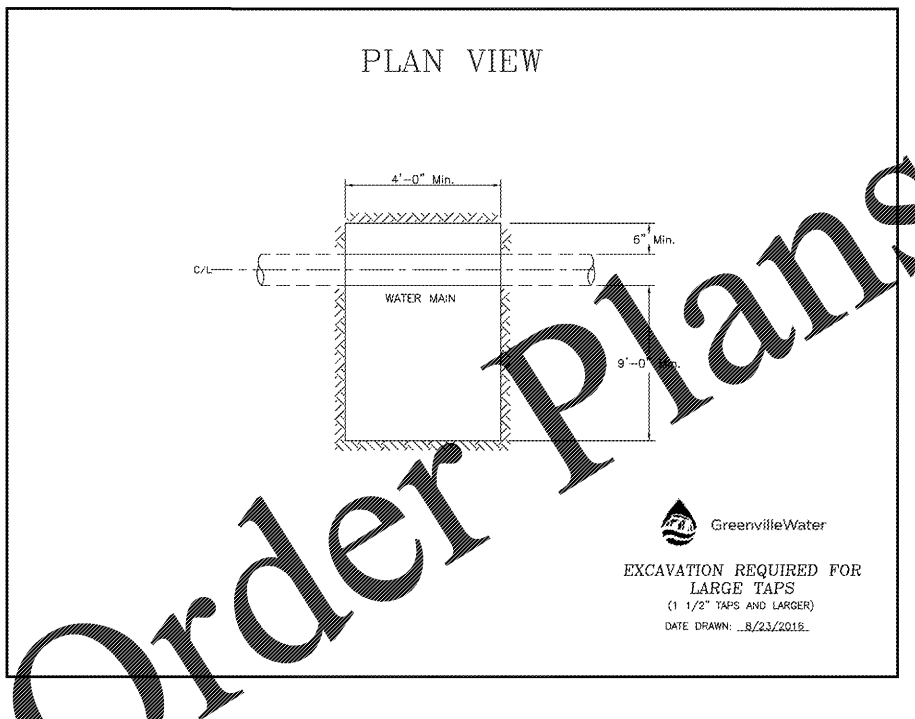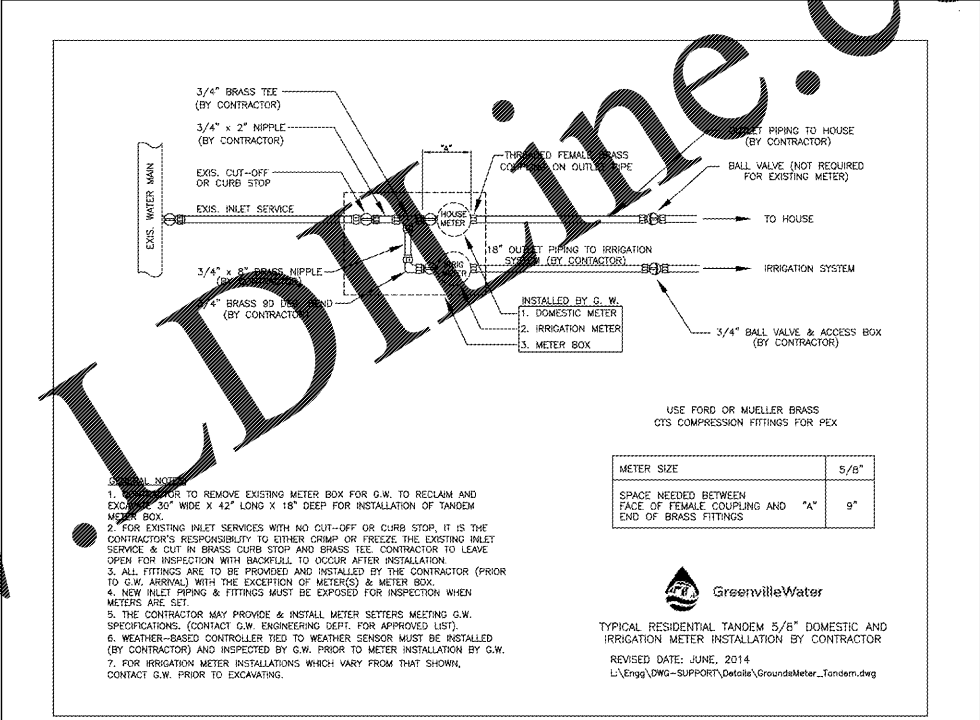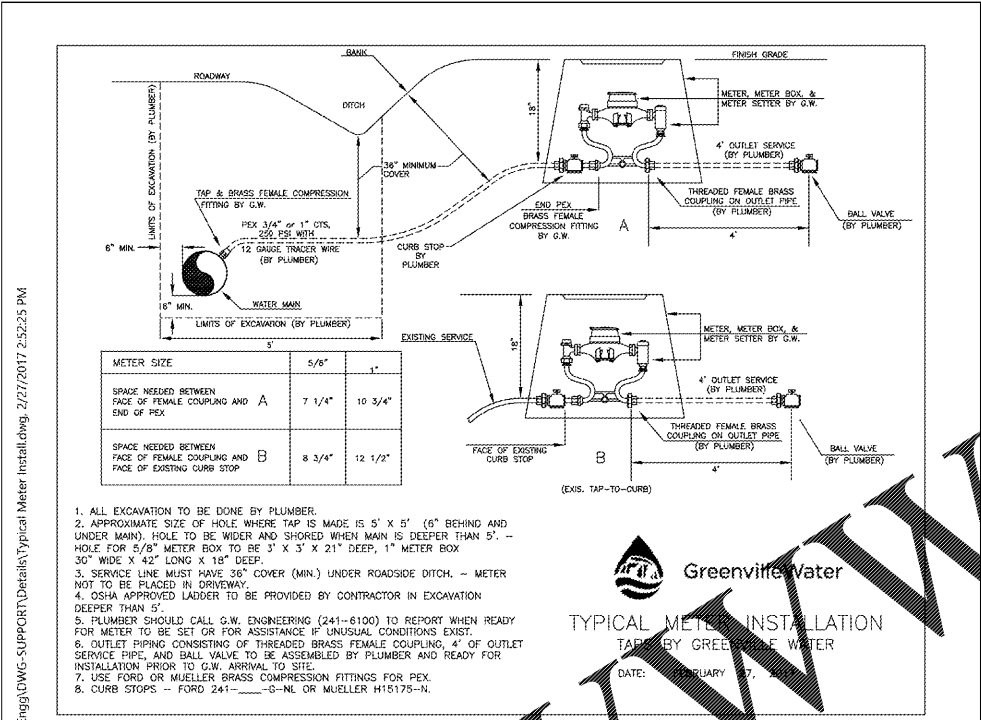

TIDEWATER ENGINEERING, INC.
 200 PLANTATION CHASE, SUITE 14
 ST. SIMONS ISLAND, GEORGIA 31522
 PHONE (912) 268-2164 FAX (912) 289-0561



REV.	DATE	DESCRIPTION

FAMILY DOLLAR
 1145 WHITE HORSE ROAD
 GREENVILLE, SC 29605
 DETAILS 1

DRAWN: pss
 APPROVED: pss
 DATE: 6-1-17
 PROJ#: 17-016
 SCALE: AS SHOWN