

KEY NOTES

- COORDINATE EXACT TRANSFORMER SECONDARY INSTALLATION WITH POWER COMPANY. VERIFY EXACT VOLTAGE AND EXACT POLE LOCATION WITH POWER COMPANY. COORDINATE WITH CIVIL PLANS AND POWER COMPANY FOR FINAL SECONDARY CONDUIT LOCATION. INCLUDE CONDUIT, WIRING AND ASSOCIATED TRENCHING AND BORING THAT IS NOT SUPPLIED BY POWER COMPANY IN SCOPE OF WORK. COORDINATE EXACT REQUIREMENTS WITH POWER COMPANY PRIOR TO BID.
- PROVIDE (2) 2" CONDUITS FOR TELEPHONE LINE. CONTRACTOR SHALL COORDINATE EXACT LOCATION WITH TELEPHONE COMPANY AND FD PROJECT MANAGER.


GENERAL NOTES

- REFER TO FLOOR PLAN SHEETS E1.0 & E2.0 FOR CIRCUIT INFORMATION.
- VERIFY MOUNTING AND LOCATION OF ALL FIXTURES WITH ARCHITECT PRIOR TO INSTALLATION.
- ACTUAL LOCATION, SIZE, AND ROUTING SHALL BE DETERMINED BY THE UTILITY COMPANY AND APPROVED BY OWNER. CONTACT UTILITY COMPANY FOR COORDINATION AND INSTALLATION REQUIREMENTS.
- CONTRACTOR SHALL VERIFY EXACT LOCATION OF ROAD SIGN. PRIOR TO INSTALLATION.

LIGHT FIXTURE SCHEDULE

TYPE	DESCRIPTION	MANUFACTURER CATALOG NUMBER	LAMP	NOTES
CW	4' LED STRIP	XWMLD	24W LED	SEE NOTE 1
G	EXTERIOR WALL PACK, WET LOCATION LISTED	LITHONIA DSXW1 LED 20C 1000 40K TFTM MVOLT	75W LED	SEE NOTE 1 & 3
N	EXTERIOR WALL PACK, WET LOCATION LISTED	LITHONIA DSXW1 LED 10C 350 40K T2S MVOLT	14W LED	SEE NOTE 1 & 3
P1	POLE LIGHT (TENON, 25'-0" DIRECT BURIAL POLE)	LITHONIA DSX2 LED 80C 1000 40K T3M MVOLT RPA AST20-280 DDBXD POLE - RTADB 25 7E T20 VD DDB PB062615H1	1-275W LED	SEE NOTE 1, 2, & 3
P2	POLE LIGHT (TENON, 25'-0" DIRECT BURIAL POLE)	LITHONIA DSX2 LED 80C 1000 40K TFTM MVOLT RPA AST20-190 DDBXD POLE - RTADB 25 7E T20 VD DDB PB062615H1	1-275W LED	SEE NOTE 1, 2, & 3

- NOTES:**
- NO OTHER SYSTEMS ARE ACCEPTABLE UNLESS REQUESTED AND PRE-APPROVED IN WRITING BY FAMILY DOLLAR STORE.
 - PROVIDE IN LINE FUSING IN BASE OF POLE
 - ALL EXTERIOR LIGHTS TO BE FULL CUTOFF FIXTURES, NO EXCEPTIONS

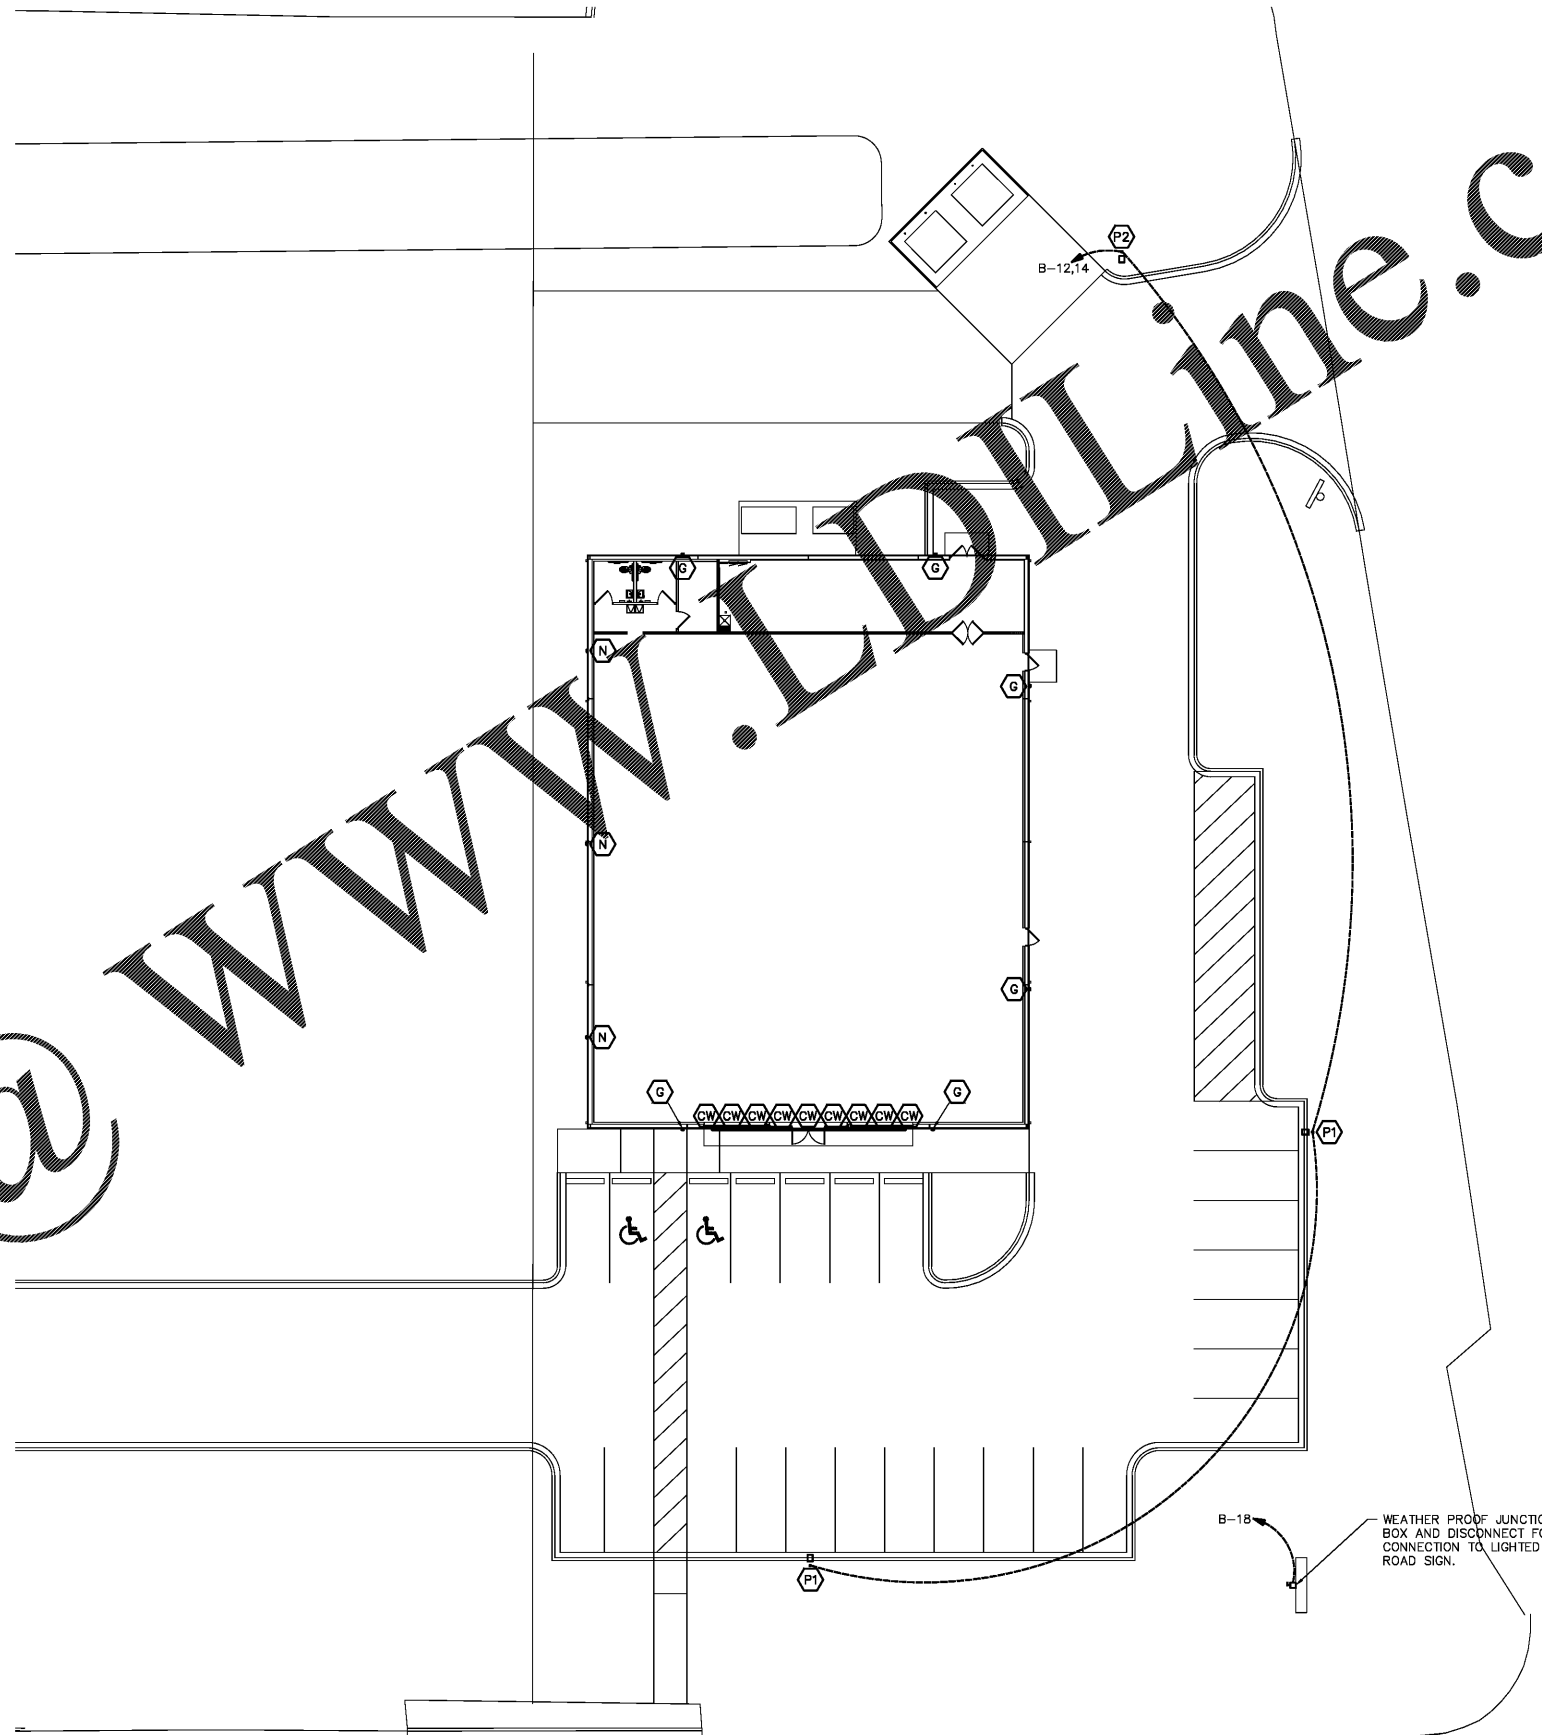

1 SITE PLAN - ELECTRICAL
1/16" = 1'-0"

pb2
architecture
+ engineering

100
Alax Avenue Suite 100
Greenville, SC 29615
Tel: 479.636.3545
Fax: 479.636.1209

Engineer of Record
Keith A. Williams, P.E.
South Carolina License No. 25844
COA Number: 4672

STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR THE EXCLUSIVE USE OF THE PROJECT AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF THE ENGINEER. REPRODUCTION OF THIS PROJECT IS NOT ALLOWED AND MAY BE CONTRARY TO THE LAW.


FAMILY DOLLAR STORE

1145 WHITE HORSE RD.
GREENVILLE, SOUTH CAROLINA

JOB NUMBER: 2017.0123

ISSUE BLOCK

CHECKED BY: HS
DRAWN BY: WQ
PROTO CYCLE: 2016-01
DOCUMENT DATE: 06.22.17



SITE PLAN - ELECTRICAL

SHEET: **E5.0**

PRINTED: 6/22/2017 5:25 PM BY: Travis Spikes LAST SAVED: 4/28/2017 8:41 AM BY: Westonqualls
c:\family_dollar\2017.0123_greenville_sc - white_horse - durban\drawings\mep\elec\sheets\e050.dwg

Order Plans @ WWW.LDOnline.com