

GENERAL NOTES

DIVISION NOTES:

A. DIVISION 1 - GENERAL REQUIREMENTS:

1.01. COMPLETE CONTRACT DOCUMENTS: THE COMPLETE DRAWINGS, SPECIFICATIONS, ADDENDA, AND CLARIFICATIONS ISSUED BY FIELD ORDER OF SIMILAR INSTRUMENTS CONSTITUTE THE CONTRACT DOCUMENTS AND SHALL REMAIN INTACT. THE GENERAL CONTRACTOR IS FULLY RESPONSIBLE FOR COMPLIANCE WITH THE REQUIREMENTS INCLUDED, OR REASONABLY IMPLIED THEREIN. THE CONSTRUCTION MANAGER OR GENERAL CONTRACTOR AS APPLICABLE MUST NOT ISSUE PARTIAL SETS OR OTHERWISE CAUSE AN INCOMPLETE CONTRACT DOCUMENT TO BE PROVIDED TO PARTIES TO THE CONTRACT, INCLUDING ASSOCIATED SUB-CONTRACTORS, OR SUB-SUB-CONTRACTORS.

1.02. MULTI-TRADE COORDINATION: ALL WORK SHALL BE COORDINATED WITH THE WORK OF OTHER TRADES TO AVOID INTERFERENCES AND CONFLICTS. SUB-CONTRACTORS SHALL WORK TOGETHER IN THE REVIEW OF WORK AND COORDINATION OF SYSTEMS IN FLEXIBLE AREAS, AND OTHER LOCATIONS WHERE CAREFUL COORDINATION IS NECESSARY TO ERECT THE WORK IN LIMITED SPACES. NO ALLOWANCES WILL BE MADE FOR THE FAILURE TO COORDINATE BETWEEN DISCIPLINES, SYSTEMS OR EQUIPMENT. UNCOORDINATED WORK THAT RESULTS IN THE INEFFICIENT USE OF AVAILABLE SPACE MAY BE SUBJECT TO REJECTION OF INSTALLED WORK. WHERE COMPLEXITY OF THE INSTALLED WORK OR WHERE WORK INSTALLED IN COMPACT SPACES NECESSITATES CAREFUL COORDINATION FOR SUCCESSFUL INSTALLATION, THE GENERAL CONTRACTOR IS STRONGLY ENCOURAGED TO UNDERTAKE A SYSTEMS COORDINATION PROGRAM THAT INCLUDES THREE-DIMENSIONAL MODELING OF THE REQUIRED WORK PRIOR TO INSTALLATION, WHETHER OR NOT REQUIRED ELSEWHERE BY THE CONTRACT DOCUMENTS.

1.03. VERIFICATION: THE GENERAL CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS, CONSTRUCTION, MATERIALS, METHODS OF CONSTRUCTION, GRADES AND ELEVATIONS, AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES OR CONFLICTS WITHIN THE DOCUMENTS PRIOR TO BID, CONSTRUCTION, AND/OR INSTALLATION OF ASSOCIATED WORK. COMMENCEMENT OF WORK CONSTITUTES ACCEPTANCE THAT THE EXISTING CONDITIONS ARE CONSISTENT WITH THOSE OF THE CONTRACT DOCUMENTS. ANY CHANGE ORDER REQUEST ASSOCIATED WITH AN IDENTIFIABLE EXISTING CONDITION, WHETHER IN CONFLICT OR COMPLIANCE WITH THE CONTRACT DOCUMENTS, WILL NOT BE ACCEPTED. THIS PROVISION SHALL NOT APPLY TO WORK PERFORMED UNDER UNIT PRICE OR ALLOWANCE FEE STRUCTURES.

1.04. DISCREPANCIES: THE GENERAL CONTRACTOR SHALL NOTIFY THE ARCHITECT PROMPTLY UPON IDENTIFICATION OF ANY DISCREPANCIES OR CONFLICTS IN THE CONTRACT DOCUMENTS, WITH THE OBJECTIVE OF RESOLVING THE CONFLICT OR DISCREPANCY IN A TIMELY MANNER AND PRIOR TO ANY IMPACT TO THE CONTRACT TIME OR PRICE. THE GENERAL CONTRACTOR SHALL INCLUDE THE MORE EXPENSIVE, COMPLEX, AND TIME CONSUMING COMPONENTS OF ANY DISCREPANCIES IN THE BASE BID PRICE. FAILURE TO NOTIFY THE ARCHITECT PROMPTLY OF A KNOWN DISCREPANCY CONSTITUTES ACCEPTANCE OF FULL RESPONSIBILITY FOR THE ASSOCIATED COST AND SCHEDULE IMPACT.

1.05. DRAWING SCALE: REPROGRAPHIC TECHNIQUES MAY RENDER DRAWINGS DIFFERENTLY THAN THE INTENDED PRINTED SCALE. THEREFORE, DO NOT RELY UPON THE SCALE OF ANY PRINTED DRAWINGS. CONTACT THE ARCHITECT FOR REQUIRED DIMENSIONS THAT ARE NOT PROVIDED CLEARLY IN NUMERIC FORM HEREIN. FAILURE TO REQUEST CRITICAL DIMENSIONAL INFORMATION FROM THE ARCHITECT MAY RESULT IN THE REJECTION OF INSTALLED WORK.

1.06. DIMENSIONAL STANDARDS: STANDARD DIMENSION CONVENTIONS UTILIZED HEREIN CALL FOR DIMENSIONS TO FACE OF STUDY MATERIAL OF FINISHED PARTITION, FACE OF FINISH, OR CENTERLINE OF COLUMN LINE OR OTHER REFERENCE LINE, UNLESS OTHERWISE NOTED OR GRAPHICALLY ILLUSTRATED. DIMENSIONS NOTED AS "CLEAR," "MIN," OR "MAX" SHALL BE STRICTLY ENFORCED.

1.07. IPM SOFTWARE: THE GENERAL CONTRACTOR SHALL SECURE AND PAY FOR ALL NECESSARY AND REQUIRED PERMITS AND APPROVALS FROM JURISDICTIONAL AUTHORITIES, PRIOR TO COMMENCING THE WORK. THIS REQUIREMENT SHALL APPLY TO ON-SITE AND OFF-SITE WORK REQUIRED BY THE CONTRACT DOCUMENTS.

1.08. CODE COMPLIANCE: THE WORK SHALL BE PERFORMED IN STRICT COMPLIANCE WITH ALL APPLICABLE LAWS, CODES, AND ORDINANCE. THE GENERAL CONTRACTOR AND SUB-CONTRACTORS SHALL PERFORM THEIR WORK IN COMPLIANCE WITH ALL APPLICABLE BUILDING CODES, LAWS, REGULATIONS, AND ORDINANCES. GENERAL CONTRACTOR AND ALL SUB-CONTRACTORS SHALL CAREFULLY READ AND FAMILIARIZE THEMSELVES WITH THE CODE COMPLIANCE DATA INCLUDED IN THE DRAWINGS AND SPECIFICATIONS.

1.09. NON-COMBUSTIBLE CONSTRUCTION TYPES: THE PROPOSED BUILDING STRUCTURE IS NON-COMBUSTIBLE IN ACCORDANCE WITH APPLICABLE CODES, AND THEREFORE REQUIREMENTS FOR NON-COMBUSTIBLE CONSTRUCTION TECHNIQUES. ALL NEW CONSTRUCTION SHALL BE IN COMPLIANCE WITH APPLICABLE REQUIREMENTS, INCLUDING WOOD BLOCKING, FURRING, FRAMING, SHEATHING, BACK-BORDERS, AND RELATED WORK. FIRE RETARDANT TREATED (FRT) IS PERMITTED WHERE ALLOWED BY CODE. SEE CODE COMPLIANCE DRAWINGS FOR DETAILED INFORMATION AND REQUIREMENTS.

1.10. TEMPORARY GUARDS: THE GENERAL CONTRACTOR SHALL INSTALL AND MAINTAIN TEMPORARY GUARDS AT ALL SLAB EDGES, PIT EDGES, ELEVATED PLATFORM EDGES, AND SIMILAR CONDITIONS WHERE REQUIRED BY OSHA, ANY APPLICABLE CODE OR ORDINANCE, AND AT MINIMUM ALL CHANGES IN ELEVATION IN EXCESS OF THIRTY INCHES (30") INCLUDING BOTH SIDES OF STAIRS AND LADDERS. TEMPORARY GUARDS MUST BE MAINTAINED UNTIL THE PERMANENT GUARDS ARE INSTALLED.

1.11. LIFE-SAFETY MEASURES DURING CONSTRUCTION: THE GENERAL CONTRACTOR SHALL COMPLY WITH ALL REQUIREMENTS OF OSHA, CODE, AND OTHER APPLICABLE REGULATORY AUTHORITIES.

1.12. MEANS OF EGRESS: THE GENERAL CONTRACTOR SHALL MAINTAIN CLEAR AND UNOBSTRUCTED MEANS OF EGRESS AT ALL TIMES DURING CONSTRUCTION, WITHOUT EXCEPTION.

1.13. CONSTRUCTION LOADS: THE GENERAL CONTRACTOR SHALL NEVER LOAD NEW OR EXISTING CONSTRUCTION BEYOND ITS DESIGN CAPACITY WITH STORED MATERIAL, CONSTRUCTION EQUIPMENT, TEMPORARY LOADS ASSOCIATED WITH MATERIAL MOVEMENT, HOISTING, OR STORAGE, OR SIMILAR CONDITIONS.

1.14. GENERAL CLEAN-UP: THE GENERAL CONTRACTOR SHALL INCLUDE ONGOING CLEAN-UP OF THE PROPERTY AND BUILDING, INCLUDING REMOVAL OF TRASH AND WASTE MATERIALS, ON A REGULAR BASIS DURING CONSTRUCTION. RECYCLING OF CONSTRUCTION WASTE IS ENCOURAGED.

1.15. OWNER FURNISHED EQUIPMENT: LOOSE FURNISHINGS, WORKSTATIONS, OFFICE EQUIPMENT, COPIERS, VENDING MACHINES, KITCHEN EQUIPMENT, AND SIMILAR ITEMS THAT ARE BOTH LABELED "OWNER FURNISHED" OR "OFFER," AND SHOWN DASHED OR IN GRAY-TONE SHALL BE CONSIDERED OWNER FURNISHED EQUIPMENT. OWNER FURNISHED EQUIPMENT IS SHOWN FOR THE GENERAL CONTRACTOR'S KNOWLEDGE AND UNDERSTANDING TO FACILITATE COORDINATION WITH THE OWNER'S WORK. THE GENERAL CONTRACTOR SHALL CAREFULLY REVIEW THE SCOPE OF WORK, AND REQUEST CLARIFICATION FROM THE ARCHITECT IN THE EVENT OF ANY UNCERTAINTY ABOUT THE DEFINITION OF OWNER FURNISHED WORK.

B. DIVISION 2 - EXISTING CONDITIONS

2.01. POSITIVE DRAINAGE AT BUILDING: SLOPE EXTERIOR GRADE AWAY FROM THE BUILDING IN ACCORDANCE WITH THE INTERIOR BUILDING CODE.
2.02. SITE PAVING EXPANSION AND CONTROL JOINTS: WHETHER SPECIFICALLY INDICATED OR NOT, FURNISH AND INSTALL CONTROL JOINTS IN ALL SITE CONCRETE PAVING FOR PEDESTRIAN TRAFFIC AT AN INTERVAL OF NO MORE THAN FIVE FEET (5') EACH WAY. IN ADDITION, FURNISH AND INSTALL CONTROL JOINTS AT NO MORE THAN THIRTY FOOT (30') INTERVAL, EACH WAY. ALL EXPANSION JOINTS, INCLUDING THOSE BETWEEN HORIZONTAL PAVING AND VERTICAL ABUTMENTS, SHALL RECEIVE SPECIFIED JOINT FILLER, AS SPECIFIED IN SECTION 07300.

C. DIVISION 3 - CONCRETE

3.01. SLAB-ON-GRADE: SEE SPECIFICATION SECTION 03300 FOR DETAILED REQUIREMENTS OF SLAB-ON-GRADE CONSTRUCTION, INCLUDING REQUIREMENTS FOR REINFORCING, CONCRETE AD MIXTURES, VAPOR BARRIER, AND SURFACE TREATMENTS (IF ANY). ALL SLAB-ON-GRADE CONSTRUCTION SHALL BE INSTALLED OVER MINIMUM FOUR INCH (4") THICK COMPACTED POROUS DRAINAGE LAYER.
3.02. SLAB EXPANSION AND CONTROL JOINTS: SEE STRUCTURAL DRAWINGS FOR REQUIRED SLAB EXPANSION AND CONTROL JOINTS. ALL EXPANSION JOINTS AND CONTROL JOINTS IN FLOOR SLABS, AND BETWEEN FLOOR SLABS AND VERTICAL ABUTMENTS SHALL RECEIVE TRAFFIC BEARING SEALANT JOINT MATERIAL.
3.03. CORE DRILLING-BUILDING: THE GENERAL CONTRACTOR SHALL NOTIFY THE ARCHITECT IN WRITING OF THE LOCATION AND DIMENSION OF ANY PROPOSED CORES THROUGH STRUCTURAL FLOOR SLABS, PRIOR TO COMMENCING CORE ACTIVITIES. CORE DRILLING IS STRICTLY PROHIBITED (SLEEVES ONLY) IN ANY POST-TENSIONED STRUCTURED FLOOR SLAB ASSEMBLIES.

D. DIVISION 4 - MASONRY

4.01. SEAL VENEER ANCHORS: ALL EXTERIOR VENEER SYSTEM ANCHORS SHALL BE SET IN FULL, FRESH BED OF TROWEL GRADE ARMORSTURE BARRIER COATING, OR DOW 795 OR EQUIVALENT AT THE PLANE OF THE AIR MOISTURE BARRIER.

E. DIVISION 5 - METALS

5.01. EMBEDDED STEEL: ALL MISCELLANEOUS STEEL ITEMS INCLUDING STEEL EDGE ANGLES, EMBEDDED PLATE, AND SIMILAR WORK SHALL BE GALVANIZED. THIS PROVISION DOES NOT APPLY TO REINFORCING STEEL, WHICH SHALL COMPLY WITH SPECIFICATION DIVISION 03300.

F. DIVISION 6 - WOOD, PLASTICS & COMPOSITES

6.01. WOOD IN CONTACT WITH CONCRETE OR MASONRY: ALL WOOD IN CONTACT WITH CONCRETE OR MASONRY CONSTRUCTION SHALL BE PRESURE TREATED (PT).
6.02. FIELD VERIFICATION: THE CASEWORK OR MILLWORK CONTRACTOR SHALL OBTAIN AND VERIFY ALL FIELD MEASUREMENTS AND CONDITIONS AFFECTING HIS WORK AND SHALL BE RESPONSIBLE FOR ALL DETAILS AND DIMENSIONS ASSURING PRECISION AND PROPER ASSEMBLY OF HIS PRODUCTS.
6.03. MILLWORK BASE: PROVIDE FINISHED BASE TO MATCH MATERIAL AND FINISH OF ADJACENT SCHEDULED WALL BASE, AT TOE-KICK AT ALL EXPOSED FRONT, SIDE, AND REAR FACES OF MILLWORK OR CASEWORK.
6.04. MILLWORK SPLASH: PROVIDE BACKSPLASH AT ALL COUNTERTOPS UNLESS OTHERWISE INDICATED ON PLAN. PROVIDE SIDESPLASH OF SAME MATERIAL, DIMENSION, AND FINISH EVERYWHERE A COUNTERTOP BACKSPLASH ABUTS A VERTICAL WALL SURFACE AT ONE OR MORE OF ITS SIDES UNLESS OTHERWISE INDICATED ON PLAN.

G. DIVISION 7 - THERMAL & MOISTURE PROTECTION

7.01. GENERAL SEALANTS: CONTINUOUSLY SEAL PERIMETER OF ALL DOOR AND WINDOW FRAMES, MILLWORK AND CASEWORK, TRIM, CABINETS, AND SIMILAR FIXED CONSTRUCTION. ALL VERTICAL SURFACE CONTROL AND EXPANSION JOINTS SHALL BE CONTINUOUSLY SEALED, BOTH SIDES OF JOINT.
7.02. SLOPE TO DRAIN: ALL ROOF SURFACES SHALL BE SLOPED TO DRAIN, WITH MINIMUM PITCH OF 1/4" PER LINEAR FOOT. PROVIDE TAPERED INSULATION, CRICKETS AS NECESSARY TO ASSURE THE MINIMUM SLOPE IS ACHIEVED.
7.03. WALK-PADS: FURNISH AND INSTALL COMPATIBLE ROOF WALK-PADS AT ALL MEMBRANE ROOF SURFACES THAT ARE TRAVELED TO ACCESS SERVICEABLE ROOFTOP EQUIPMENT SUCH AS HVAC UNITS, FANS, ELECTRICAL EQUIPMENT, AND SIMILAR EQUIPMENT REQUIRING SERVICE ACCESS.

7.04. EXPANSION JOINTS COVERS: ALL BUILDING EXPANSION JOINTS EXPOSED TO VIEW IN FLOOR, PARTITION, AND/OR CEILING ASSEMBLIES SHALL RECEIVE COLOR-COORDINATED PRE-FABRICATED EXPANSION JOINT COVER ASSEMBLY DESIGNED TO ALLOW THE REQUIRED MOVEMENT, AND TO PROVIDE UL APPROVED FIRE RATED ASSEMBLY WHERE REQUIRED.

H. DIVISION 6 - OPENINGS

8.01. FIRE DOORS AND FRAMES: ALL FIRE DOORS AND FRAMES SHALL BE LABELED BY AN APPROVED AGENCY PER NFPA 80, AND SHALL BE PERMANENTLY AFFIXED THERETO, AND THE LIFE OF THE LABEL AND THE ATTACHMENT THEREOF CAN REASONABLY BE EXPECTED TO EQUAL THE LIFE OF THE COMPONENT TO WHICH IT IS ATTACHED. LABELS MUST BE PROVIDED BY A MANUFACTURER THAT HAS BEEN APPROVED BY A LABORATORY OR ORGANIZATION TO PROVIDE TESTING AND FOLLOW-UP SERVICES FOR FIRE-RATED OPENING ASSEMBLIES. LABELS SHALL BE RAISED OR EMBOSSED ON METAL LABELS OR STAMPED INTO METAL FRAMES. PLASTIC OR PAPER LABELS ARE UNACCEPTABLE. THE LABEL MUST BE VISIBLE AND LEGIBLE AT ALL TIMES AND SHALL NOT BE PAINTED. FAILURE TO COMPLY WITH THIS REQUIREMENT WILL REQUIRE PAINTER TO REIMBURSE OWNER FOR COSTS OF RE-LABELING RATED DOORS AND FRAMES. ALL LABELS SHALL INCLUDE THE FIRE RESISTANCE RATING IN HOURS AND/OR MINUTES. LABELS ON FRAMES WITH TRANSOMS AND/OR Sidelights MUST IDENTIFY THAT THE OPENING ASSEMBLY INCLUDES SAME.
8.02. TEMPERED GLASS: PROVIDE TEMPERED SAFETY GLASS EVERYWHERE REQUIRED BY APPLICABLE CODE, INCLUDING ANY GLASS IN DOORS, OPERABLE WINDOWS, ADJACENT OPERABLE WINDOWS, WITHIN 36" OF THE ADJACENT FLOOR OR GRADE LEVEL, OR OTHERWISE WHERE REQUIRED BY CODE.

8.03. BLOCKING: FURNISH AND INSTALL BLOCKING IN METAL STUD FRAMES TO HOLD ALL PARTITIONS THAT ARE SCHEDULED TO RECEIVE DOOR BUMPERS STOPPING BLOCK DEVICES, AND SIMILAR DOOR RELATED DEVICES THAT WILL SUBSTANTIALLY OBSTRUCT DOOR MOVEMENT LOADS AND IMPACT.
8.04. HOLLOW METAL FRAMES: COORDINATE THE PERMIT DEPTH OF ALL HOLLOW METAL FRAMES WITH THE DEPTH OF PARTITION SCHEDULED TO RECEIVE DOOR OR WINDOW FRAME.

I. DIVISION 9 - FINISHES

9.01. INDOOR ENVIRONMENTAL CONDITIONS: NO INTERIOR SOFT CONSTRUCTION (IE: DRYWALL, CEILING, CARPET, MILLWORK, OR SIMILAR WORK THAT IS SUBJECT TO TEMPERATURE AND HUMIDITY INSTABILITY) SHALL COMMENCE, NOR SHALL MATERIALS BE STORED ON SITE, UNTIL STABLE INTERIOR ENVIRONMENTAL CONDITIONS ACCEPTABLE TO THE PRODUCT MANUFACTURER ARE PROVIDED AND IN PLACE FOR A DURATION SUFFICIENT TO ESTABLISH CONSISTENT AND ACCEPTABLE INDOOR TEMPERATURE AND HUMIDITY LEVELS. FAILURE TO PROVIDE AN INDOOR ENVIRONMENT IN STRICT COMPLIANCE WITH THE PRODUCT MANUFACTURER'S PRINTED REQUIREMENTS WILL SUBJECT THE INSTALLING CONTRACTOR TO FULL RESPONSIBILITY FOR ANY COSTS ASSOCIATED WITH RE-WORK DUE TO MOLD OR MILDEW GROWTH, WARPING, CUPPING, DE-LAMINATION, OR SIMILAR DETERIORATION OF THE STORED OR INSTALLED CONSTRUCTION.
9.02. FLOOR & WALL TILE: INSTALL FLOOR AND WALL TILE IN ALL SCHEDULED AREAS IN ACCORDANCE WITH APPLICABLE TILE COUNCIL OF AMERICA (TCA) METHOD.
9.03. FLOOR FINISH TRANSITIONS: PROVIDE FINISHED BASE TO MATCH MATERIAL & FINISH OF FLOOR FINISHES AT CENTERLINE OF DOOR IN CLOSED LOCATION. TRANSITION FLOOR MATERIAL UNDER CENTER OF DOORS & WHERE NOTED, PROVIDE SCHEDULED TRANSITION MATERIALS AT CHANGES IN FLOOR MATERIAL TYPE.
9.04. PARTITIONS: SEE PARTITION NOTES AND SPECIFICATIONS FOR REQUIREMENTS OF PARTITION CONSTRUCTION.
9.05. EQUIPMENT ACCESS DOORS: THE GENERAL CONTRACTOR SHALL PROVIDE PROPOSED LOCATION OF CEILING ACCESS DOORS TO THE ARCHITECT FOR APPROVAL. ACCESS DOORS SHALL BE PAINTED TO MATCH ADJACENT FINISH.
9.06. CASEWORK AND MILLWORK ANCHORAGE: COORDINATE INSTALLATION OF IN-WALL STEEL ANCHORAGE, GROUNDS, AND REQUIRED BLOCKING WITH OTHER TRADES FOR PRECISE LOCATION.

J. DIVISION 10 - SPECIALTIES

10.01. LOCKABLE CASEWORK: ALL CABINETS TO BE LOCKABLE WITH THE EXCEPTION OF UPPER & LOWER TYPICAL CLASSROOM & BREAK ROOM CABINETS. ALL TALL CABINETS & FILE DRAWERS TO BE LOCKABLE.
10.02. CASEWORK BASE: PROVIDE FINISHED BASE TO MATCH MATERIAL & FINISH OF ADJACENT SCHEDULED WALL BASE, AT TOE-KICK AT ALL EXPOSED FRONT, SIDE, & REAR FACES OF CASEWORK.
10.03. CASEWORK SPLASH: PROVIDE BACKSPLASH AT ALL COUNTERTOPS UNLESS OTHERWISE INDICATED ON PLAN. PROVIDE SIDESPLASH OF SAME MATERIAL, DIMENSION, AND FINISH EVERYWHERE A COUNTERTOP BACKSPLASH ABUTS A VERTICAL WALL SURFACE AT ONE OR MORE OF ITS SIDES UNLESS OTHERWISE INDICATED ON PLAN.

K. DIVISION 11 - EQUIPMENT

11.01. STRUCTURAL FLOOR COORDINATION: COORDINATE EXACT BOTTOM OF ELEVATOR SHAFT WITH PTTI REQUIREMENTS OF SELECTED ELEVATOR MANUFACTURER. EXACT LOCATION OF PUMP PUMP AS DICTATED BY SELECTED ELEVATOR MANUFACTURER. AREA BETWEEN BOTTOM OF SLAB OF ELEVATOR SHAFT & STRUCTURAL CONCRETE MAT FOOTING TO BE FORTUOUS FILL.
11.02. STRUCTURAL CONCRETE WALL COORDINATION: COORDINATE ALL REQUIRED ELEVATOR SHAFT WALL PENETRATIONS, EMBED LOCATIONS, SPECIAL HOISTWAY INFILL BRACKETS (IF REQUIRED FOR INSTALLATION IN SHAFT PROVIDED), ROUGH OPENINGS FOR DOORS, ETC. WITH SELECTED ELEVATOR MANUFACTURER.
11.03. STRUCTURAL CMU WALL COORDINATION: COORDINATE ALL REQUIRED ELEVATOR SHAFT WALL PENETRATIONS, EMBED LOCATIONS, SPECIAL HOISTWAY INFILL BRACKETS (IF REQUIRED FOR INSTALLATION IN SHAFT PROVIDED), ROUGH OPENINGS FOR DOORS, ETC. WITH SELECTED ELEVATOR MANUFACTURER.
11.04. ELECTRICAL COORDINATION: COORDINATE A MINIMUM QUANTITY (2) PER CAB, ELEVATOR DOCCONNECTIONS WITH SELECTED ELEVATOR MANUFACTURER.

L. DIVISION 12 - FURNISHINGS

12.01. LOCKABLE CASEWORK: ALL CABINETS TO BE LOCKABLE WITH THE EXCEPTION OF UPPER & LOWER TYPICAL CLASSROOM & BREAK ROOM CABINETS. ALL TALL CABINETS & FILE DRAWERS TO BE LOCKABLE.
12.02. CASEWORK BASE: PROVIDE FINISHED BASE TO MATCH MATERIAL & FINISH OF ADJACENT SCHEDULED WALL BASE, AT TOE-KICK AT ALL EXPOSED FRONT, SIDE, & REAR FACES OF CASEWORK.
12.03. CASEWORK SPLASH: PROVIDE BACKSPLASH AT ALL COUNTERTOPS UNLESS OTHERWISE INDICATED ON PLAN. PROVIDE SIDESPLASH OF SAME MATERIAL, DIMENSION, AND FINISH EVERYWHERE A COUNTERTOP BACKSPLASH ABUTS A VERTICAL WALL SURFACE AT ONE OR MORE OF ITS SIDES UNLESS OTHERWISE INDICATED ON PLAN.

M. DIVISION 13 - SPECIAL CONSTRUCTION (PRE-ENGINEERED METAL BUILDINGS)

13.01. STRUCTURAL FLOOR COORDINATION: COORDINATE EXACT BOTTOM OF ELEVATOR SHAFT WITH PTTI REQUIREMENTS OF SELECTED ELEVATOR MANUFACTURER. EXACT LOCATION OF PUMP PUMP AS DICTATED BY SELECTED ELEVATOR MANUFACTURER. AREA BETWEEN BOTTOM OF SLAB OF ELEVATOR SHAFT & STRUCTURAL CONCRETE MAT FOOTING TO BE FORTUOUS FILL.
13.02. STRUCTURAL CONCRETE WALL COORDINATION: COORDINATE ALL REQUIRED ELEVATOR SHAFT WALL PENETRATIONS, EMBED LOCATIONS, SPECIAL HOISTWAY INFILL BRACKETS (IF REQUIRED FOR INSTALLATION IN SHAFT PROVIDED), ROUGH OPENINGS FOR DOORS, ETC. WITH SELECTED ELEVATOR MANUFACTURER.
13.03. STRUCTURAL CMU WALL COORDINATION: COORDINATE ALL REQUIRED ELEVATOR SHAFT WALL PENETRATIONS, EMBED LOCATIONS, SPECIAL HOISTWAY INFILL BRACKETS (IF REQUIRED FOR INSTALLATION IN SHAFT PROVIDED), ROUGH OPENINGS FOR DOORS, ETC. WITH SELECTED ELEVATOR MANUFACTURER.
13.04. ELECTRICAL COORDINATION: COORDINATE A MINIMUM QUANTITY (2) PER CAB, ELEVATOR DOCCONNECTIONS WITH SELECTED ELEVATOR MANUFACTURER.

N. DIVISION 14 - CONVEYING SYSTEMS

14.01. STRUCTURAL FLOOR COORDINATION: COORDINATE EXACT BOTTOM OF ELEVATOR SHAFT WITH PTTI REQUIREMENTS OF SELECTED ELEVATOR MANUFACTURER. EXACT LOCATION OF PUMP PUMP AS DICTATED BY SELECTED ELEVATOR MANUFACTURER. AREA BETWEEN BOTTOM OF SLAB OF ELEVATOR SHAFT & STRUCTURAL CONCRETE MAT FOOTING TO BE FORTUOUS FILL.
14.02. STRUCTURAL CONCRETE WALL COORDINATION: COORDINATE ALL REQUIRED ELEVATOR SHAFT WALL PENETRATIONS, EMBED LOCATIONS, SPECIAL HOISTWAY INFILL BRACKETS (IF REQUIRED FOR INSTALLATION IN SHAFT PROVIDED), ROUGH OPENINGS FOR DOORS, ETC. WITH SELECTED ELEVATOR MANUFACTURER.
14.03. STRUCTURAL CMU WALL COORDINATION: COORDINATE ALL REQUIRED ELEVATOR SHAFT WALL PENETRATIONS, EMBED LOCATIONS, SPECIAL HOISTWAY INFILL BRACKETS (IF REQUIRED FOR INSTALLATION IN SHAFT PROVIDED), ROUGH OPENINGS FOR DOORS, ETC. WITH SELECTED ELEVATOR MANUFACTURER.
14.04. ELECTRICAL COORDINATION: COORDINATE A MINIMUM QUANTITY (2) PER CAB, ELEVATOR DOCCONNECTIONS WITH SELECTED ELEVATOR MANUFACTURER.

O. DIVISION 21 - FIRE SUPPRESSION

21.01. FIRE PROTECTION SYSTEMS: WHERE REQUIRED, INSTALL FIRE PROTECTION SYSTEMS IN STRICT ACCORDANCE WITH APPLICABLE CODES AND ORDINANCES, INCLUDING NFPA. ALL EQUIPMENT UTILIZED IN THE FIRE PROTECTION SYSTEM SHALL BE LISTED BY UNDERWRITERS LABORATORIES (UL).
21.02. FIRE PROTECTION SYSTEM DESIGN: WHERE DESIGN OF THE FIRE PROTECTION SYSTEM IS THE RESPONSIBILITY OF THE CONTRACTOR (AS REQUIRED BY A PERMITS OFFICER), REGISTERED FIRE PROTECTION ENGINEER AND/OR IS CERTIFIED BY THE NATIONAL FIRE PROTECTION ENGINEERING TECHNOLOGY AUTOMATIC SPRINKLER (NFPA) IN ACCORDANCE WITH THE NATIONAL INSTITUTE FOR CERTIFICATION IN ENGINEERING TECHNOLOGIES.

P. DIVISION 22 - PIPING


22.01. CONCEALED PIPING: ALL PIPING, DUCTWORK, ELECTRICAL RACEWAYS & CONDUITS SHALL BE CONCEALED IN THE CONSTRUCTION. THE GENERAL CONTRACTOR SHALL INCLUDE, IN THE BASE BID EQUIPMENT, ALL MATERIALS AND SUPPLIES NECESSARY TO CONCEAL THESE SYSTEMS WHETHER OR NOT THE FRAMES AND FURRING IS ILLUSTRATED IN THE DRAWINGS.
22.02. SECURE PIPING: ALL PIPING SHALL BE SECURED TO STRUCTURE.
22.03. GAS PIPING EXPOSED ON ROOF: WHERE GAS PIPING IS EXPOSED ON THE ROOF, PAINT SHALL BE AS FOLLOWS:
22.04. PLUMBING FIXTURES: CAREFULLY REVIEW THE DIMENSIONAL STANDARDS FOR INSTALLED PLUMBING FIXTURES. PLAN THE WORK TO ASSURE FULL COMPLIANCE OF CODE REQUIRED FIXTURE CLEARANCES.

Q. DIVISION 23 - HEATING, VENTILATION, & AIR-CONDITIONING


23.01. MEP DEVICE FIXTURE COORDINATION: COORDINATE LOCATIONS FOR DIFFUSERS, AND RETURN AIR GRILLES TO THE GREATEST EXTENT POSSIBLE IN ORDER TO MAINTAIN LIGHTING LAYOUT INDICATED IN THE DRAWINGS. MEP & FP CONTRACTORS SHALL COORDINATE WORK WITH OTHER DISCIPLINES PRIOR TO INSTALLATION. ALL ELECTRICAL ITEMS INDICATED IN OR ON CABINETS OR MILLWORK SHALL BE SUPPLIED, INSTALLED AND COORDINATED BY THE ELECTRICAL CONTRACTOR, UNLESS OTHERWISE NOTED.
23.02. CENTER CEILING DEVICES: CENTER LIGHTS, SUPPLY DIFFUSERS, RETURN GRILLES, SPRINKLER HEADS, ETC. IN CEILING PANELS IF NOT OTHERWISE INDICATED.
23.03. ELECTRICAL BOXES IN RATED PARTITIONS: WHERE ELECTRICAL BOXES ARE INSTALLED IN FIRE-RATED METAL STUD PARTITIONS, INSTALL BOXES NO LARGER THAN SIXTEEN SQUARE INCHES (16 IN²) IN AREA, AND DO NOT EXCEED ONE HUNDRED SQUARE INCHES (100 IN²) OF METALLIC BOX PER ONE HUNDRED SQUARE FEET (100 SF) OF FIRE-RATED WALL AREA. WHERE ELECTRICAL REQUIREMENTS DICTATE A HIGHER RATION, TREAT THE ELECTRICAL BOXES WITH CODE APPROVED METHOD TO ASSURE CONTINUOUS RATING. FURTHER, DO NOT INSTALL ELECTRICAL BOXES BACK-TO-BACK IN THE SAME STUD CAVITY WITHOUT APPROVED FIRE-RATED TRANSITION.
23.04. ELECTRICAL DEVICES IN OR NEAR MILLWORK: CAREFULLY LOCATE ELECTRICAL BOXES FOR DEVICES IN OR NEAR MILLWORK AND/OR CASEWORK TO ASSURE COORDINATED INSTALLATION. LOCATE ELECTRICAL DEVICES ABOVE COUNTERTOP SUCH THAT THE DEVICE COVER PLATE WILL NOT INTERFERE WITH SCHEDULED BACKSPLASH OR SIDESPLASH.

R. DIVISION 26 - ELECTRICAL

26.01. MEP DEVICE FIXTURE COORDINATION: COORDINATE LOCATIONS FOR DIFFUSERS, AND RETURN AIR GRILLES TO THE GREATEST EXTENT POSSIBLE IN ORDER TO MAINTAIN LIGHTING LAYOUT INDICATED IN THE DRAWINGS. MEP & FP CONTRACTORS SHALL COORDINATE WORK WITH OTHER DISCIPLINES PRIOR TO INSTALLATION. ALL ELECTRICAL ITEMS INDICATED IN OR ON CABINETS OR MILLWORK SHALL BE SUPPLIED, INSTALLED AND COORDINATED BY THE ELECTRICAL CONTRACTOR, UNLESS OTHERWISE NOTED.
26.02. CENTER CEILING DEVICES: CENTER LIGHTS, SUPPLY DIFFUSERS, RETURN GRILLES, SPRINKLER HEADS, ETC. IN CEILING PANELS IF NOT OTHERWISE INDICATED.
26.03. ELECTRICAL BOXES IN RATED PARTITIONS: WHERE ELECTRICAL BOXES ARE INSTALLED IN FIRE-RATED METAL STUD PARTITIONS, INSTALL BOXES NO LARGER THAN SIXTEEN SQUARE INCHES (16 IN²) IN AREA, AND DO NOT EXCEED ONE HUNDRED SQUARE INCHES (100 IN²) OF METALLIC BOX PER ONE HUNDRED SQUARE FEET (100 SF) OF FIRE-RATED WALL AREA. WHERE ELECTRICAL REQUIREMENTS DICTATE A HIGHER RATION, TREAT THE ELECTRICAL BOXES WITH CODE APPROVED METHOD TO ASSURE CONTINUOUS RATING. FURTHER, DO NOT INSTALL ELECTRICAL BOXES BACK-TO-BACK IN THE SAME STUD CAVITY WITHOUT APPROVED FIRE-RATED TRANSITION.
26.04. ELECTRICAL DEVICES IN OR NEAR MILLWORK: CAREFULLY LOCATE ELECTRICAL BOXES FOR DEVICES IN OR NEAR MILLWORK AND/OR CASEWORK TO ASSURE COORDINATED INSTALLATION. LOCATE ELECTRICAL DEVICES ABOVE COUNTERTOP SUCH THAT THE DEVICE COVER PLATE WILL NOT INTERFERE WITH SCHEDULED BACKSPLASH OR SIDESPLASH.

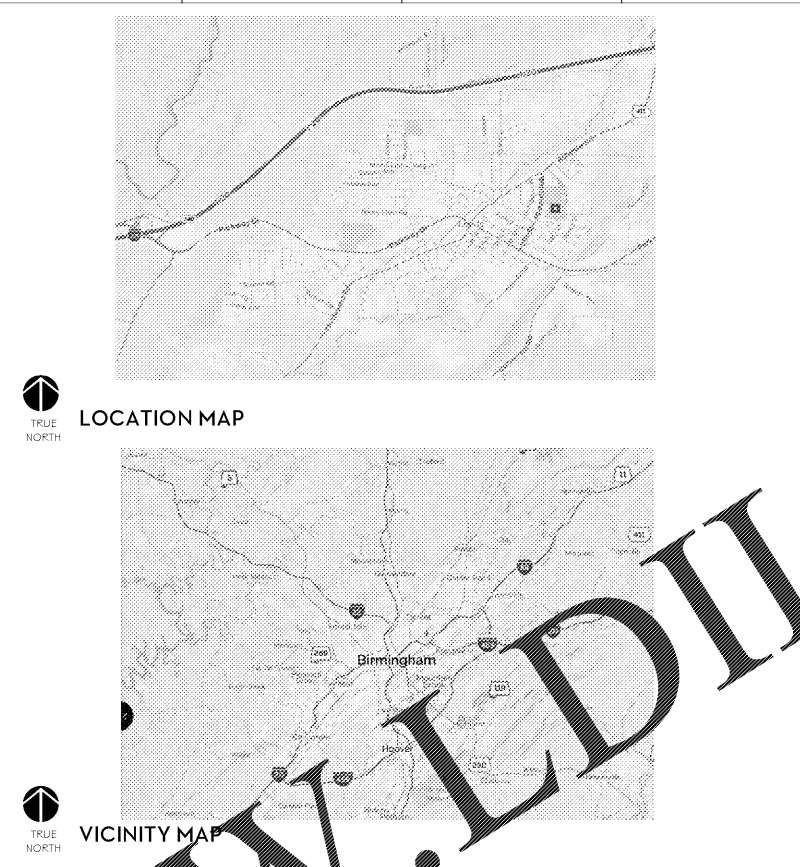

ANNOTATION SYMBOLS

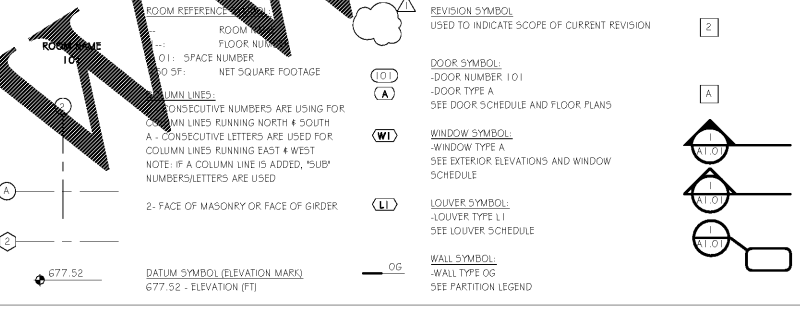

ABBREVIATIONS AND ACRONYMS

Table listing abbreviations and acronyms used in the drawings, such as AC (acre), ACC (accessible), ACCI (American Concrete Institute), etc.

INDEX OF DRAWINGS

Table listing drawing sheets, including G1.01 INDEX & GENERAL INFORMATION, 1.0 CIVIL, 3.0 ARCHITECTURE, 4.0 STRUCTURAL, 7.0 ELECTRICAL, and 15.

Vertical sidebar containing project information: GOODWYN MILLS CAWOOD, ISSUES DATE, BATTING CAGES FOR LEEDS CITY SCHOOLS, LEEDS BOARD OF EDUCATION, GMC # ABH16000, and INDEX & GENERAL INFORMATION G1.01 sheet.