GENERAL NOTES:

1. ELECTRICAL CONTRACTOR TO PROVIDE CONDUIT, OUTLET/BACK BOX AND PULL STRING TO ABOVE ACCESSIBLE CEILING FOR ALL DEVICES, PANELS AND OTHER ELECTRICAL EQUIPMENT LOCATED IN WALL OR HARD CEILING SPACES.
2. ALL SECURITY SYSTEM PANELS, DEVICES, CAMERAS, SPEAKERS, AND ASSOCIATED WIRING SUPPLIED AND INSTALLED BY WAWA SECURITY CONTRACTOR.
3. CONNECTION BETWEEN SECURITY CAMERA SYSTEM AND FIRE ALARM SYSTEM PANEL SHALL BE A 2, GAUGE 2 PAIR.
4. ELECTRICAL CONTRACTOR SHALL PROVIDE (1) 18-2 AND (1)RG-59 COAX CABLE TO EACH SECURITY CAMERA FROM CAMERA POWER SUPPLY. PROVIDE 2 WHITE 18-2 CONDUCTORS FOR POWER SUPPLY.
5. PHONE LINES PROVIDED BY OTHERS, E.C. TO PROVIDE CONDUIT, BOX AND PULL STRING TO ACCESSIBLE ABOVE CEILING SPACE.
6. EXTERIOR WALL MOUNTED CAMERAS (NOT UNDER CANOPIES) TO BE MOUNTED AT HEIGHT OF 14 FEET.

KEYNOTES: (X)

1. SECURITY CONTRACTOR TO MOUNT OUTSIDE [illegible] VIEWING [illegible] EXACT LOCATION OF [illegible] MANAGER. REFER TO SHEET A9.2.
2. SECURITY CONTRACTOR SHALL MOUNT SECURITY SPEAKER ABOVE OFFICE DOOR SECURED TO WALL OR [illegible] STUD, 18 GAUGE/ 1 PAIR.
3. TRASH ENCLOSURE SECURITY TIME RELEASE BUTTON MOUNTED IN OFFICE, SECOND SWITCH MOUNTED TO THE RIGHT OF CORE [illegible] DENING [illegible] TIME DELAY NEEDED WITH BAS SYSTEM.
4. DELIVERY DOOR SECURITY RELEASE BUTTON MOUNTED IN OFFICE [illegible] SECURITY KEYPAD, SECOND SWITCH MOUNTED TO THE LEFT OF [illegible] IN FIRST CABINET.
   MOUNT SECURITY PANELS 66" FROM FLOOR. FIELD COORDINATE EXACT LOCATION WITH WAWA PROJECT MANAGER.
   FOR SELF SERV WALK-IN CAMERA, PROVIDE O/S TYPE RATED FOR COOLER TEMPERATURE.

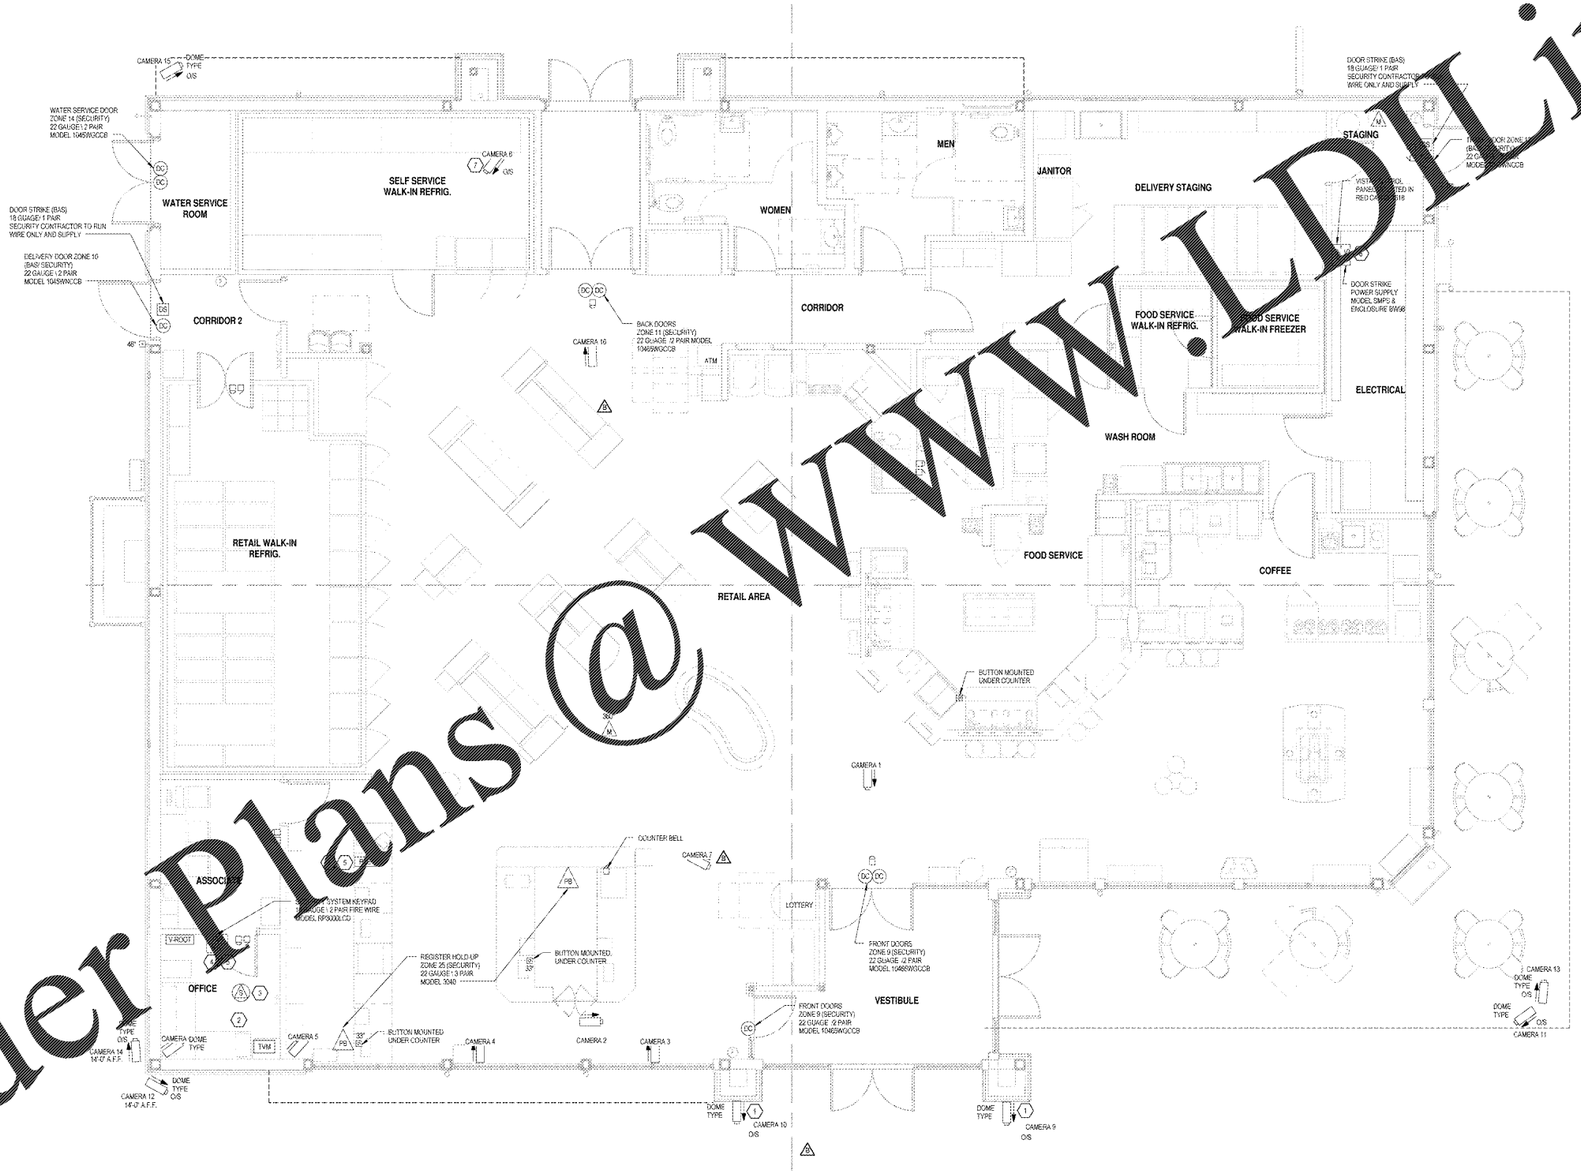

1 SECURITY SYSTEM DEVICE PLAN
E10 1/4" = 1'-0"

LEGEND

	PUSH BUTTON BUZZER (EXTERIOR)
	PUSH BUTTON BELL (INTERIOR)
	BUZZER (EXTERIOR) / BELL (INTERIOR)
	CHIME
ASP	SECURITY SYSTEM PANEL
ASK	SECURITY SYSTEM KEYPAD
V-ROOT	PETROLEUM ALARM
DC	DOOR CONTACT
MD	MOTION DETECTOR
PB	PANIC BUTTON
PBL	PANIC BUTTON WITH LEAD
SS	SECURITY SPEAKER
DPS	DOOR STRIKE POWER SUPPLY
DS	DOOR STRIKE
RTE	REQUEST TO ENTER
	CAMERA (SHOWING DIRECTION)
O/S	CAMERA (OUTSIDE RATED FOR TEMPERATURE AND WEATHER)
TVM	MONITOR FOR CAMERAS (CCTV)

Order Plans @ WWW.LDI.inc.com

Cantel & Peterson Engineers Planners
Certificate of Authorization # EC13000276
Professional Engineering Business
1 Harvard Avenue, Pensacola, FL 32514
Ph. 850.478.1560 Fax 850.478.1031
www.cpi.com

CLIENT NAME
WAWA
260 WEST BALTIMORE PIKE
WAWA, PENNSYLVANIA 19063

PROJECT NAME
WAWA F85FB 2017.01 STORE #5254-OKE
OKEECHOBEE RD. & JENKINS RD
FT. PIERCE, FLORIDA

SHEET TITLE
SECURITY PLAN

Revision Schedule		
No.	Description	Date
	PERMIT SET	05/30/2017
a	REV 2017.01	07/26/2017
b	PRELIM REVIEW SET	07/26/2017
	BID SET	08/30/2017

PROJECT NO. 2160009
DATE 05-30-2017
DRAWN MLB
CHECKED JPM

E10