

Table with 2 columns: REVISIONS, DESCRIPTION. Includes fields for DATE, NO., and DRAWN BY/ CHECKED BY.


DRAWN BY: MN CHECKED BY: SDH

ROOF FRAMING PLAN

DATE: 6-23-17

SHEET NUMBER: S2

WALL STUD SIZE AND SPACING DOES NOT INCLUDE BRICK / MASONRY CLADDING

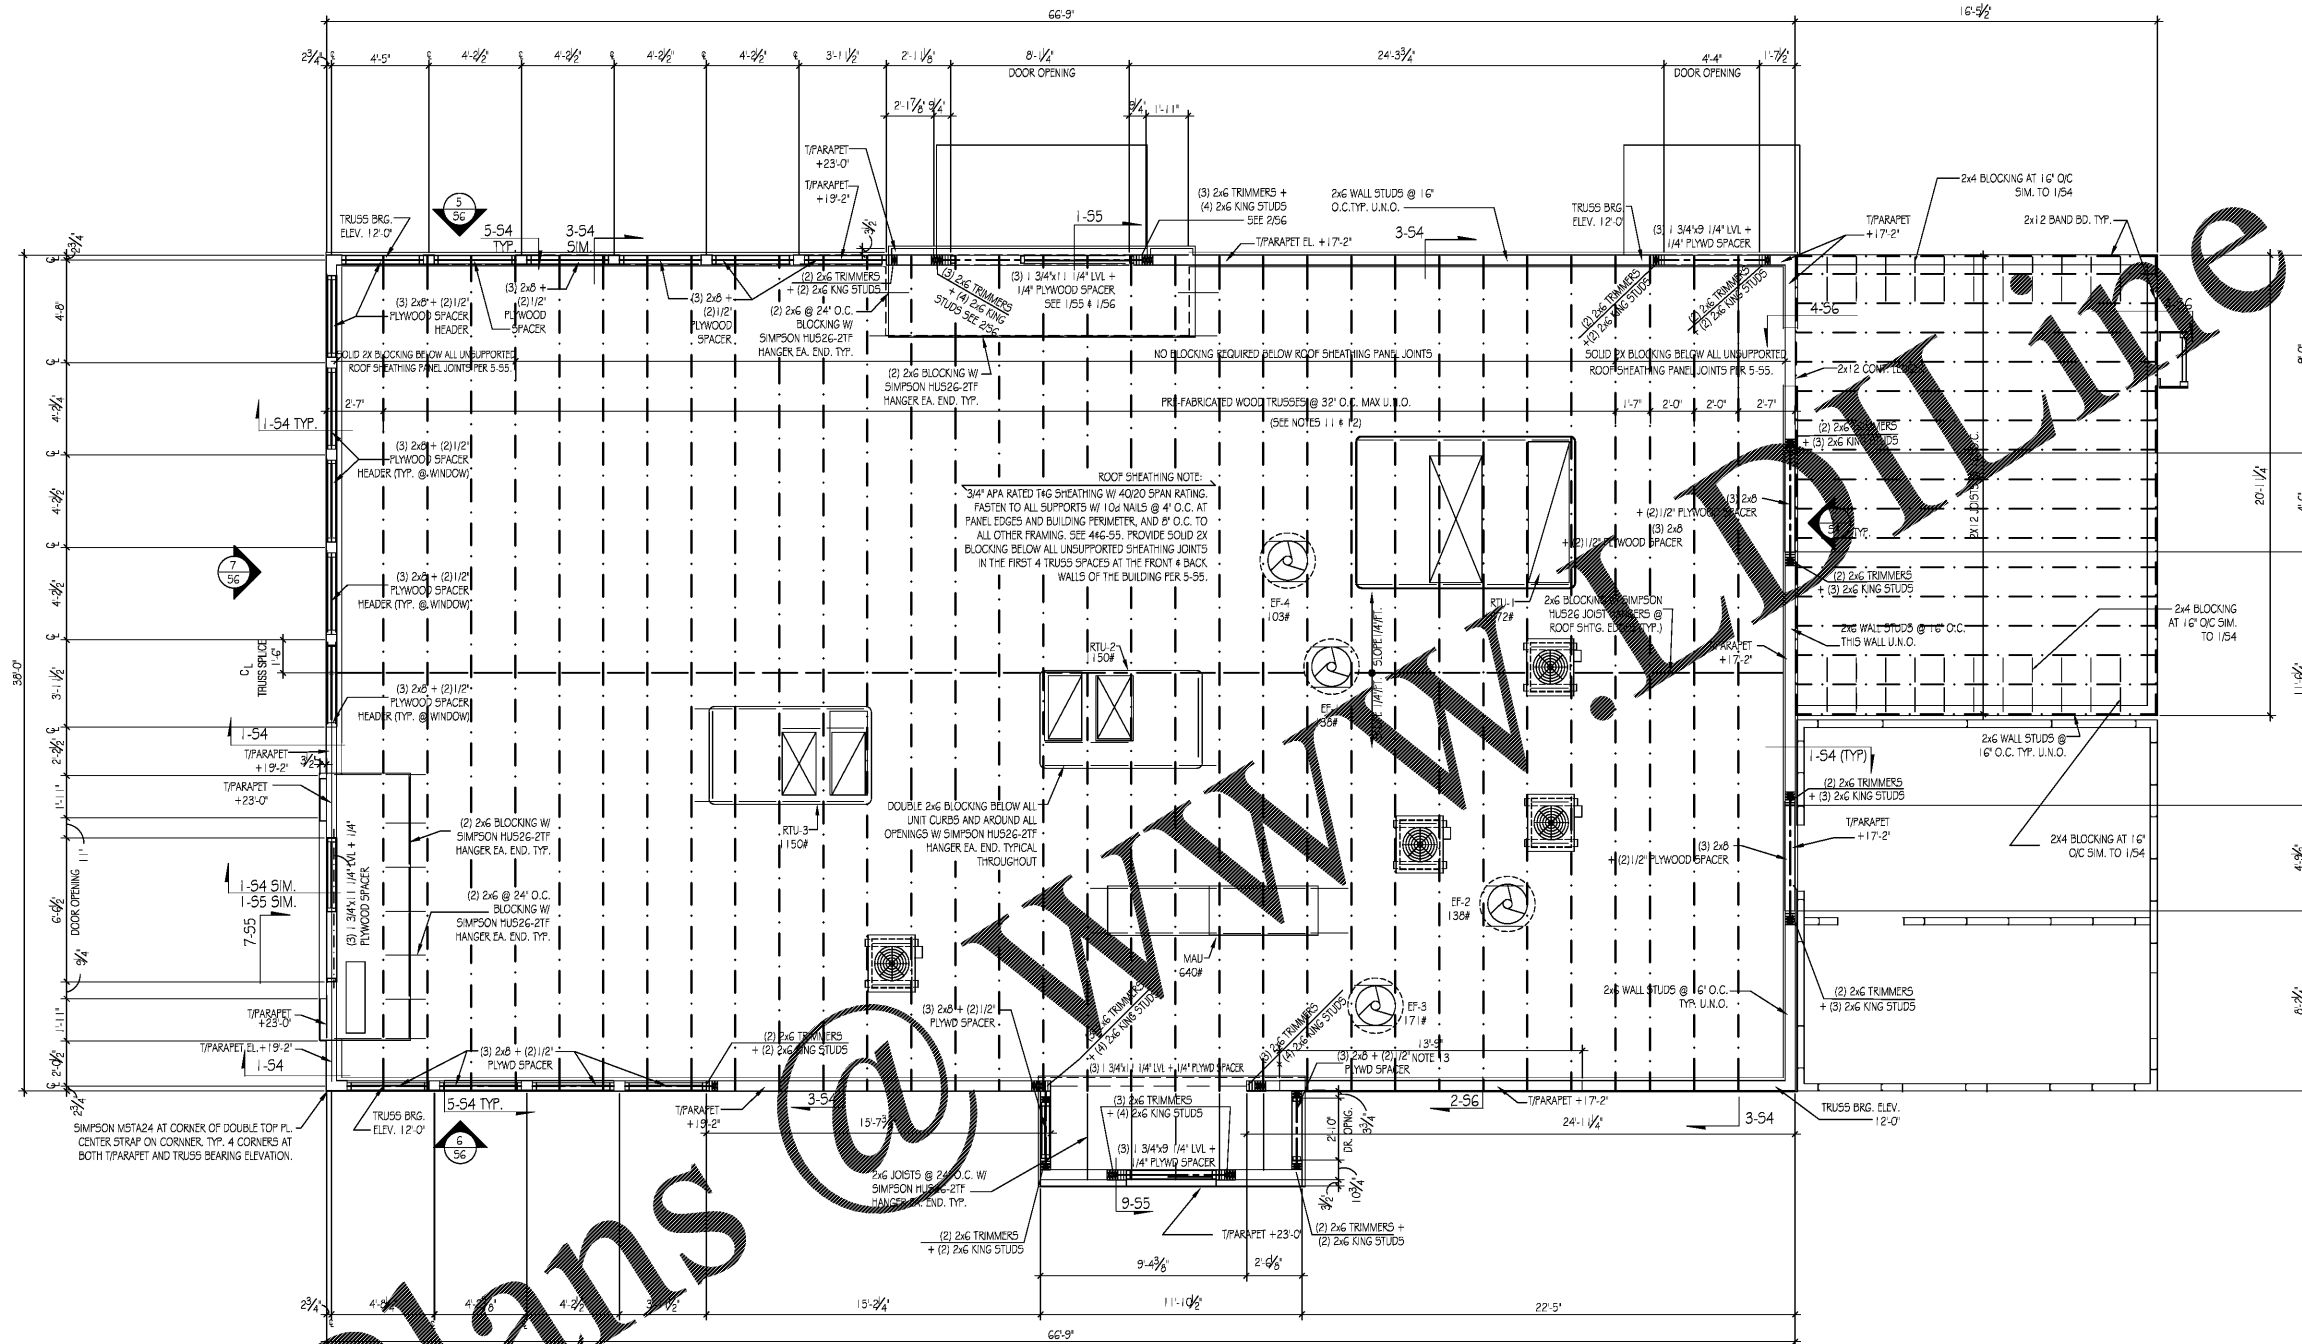


ROOF SHEATHING NOTE: 3/4" APA RATED T&G SHEATHING W/ 4000 SPAN RATING. FASTEN TO ALL SUPPORTS W/ 10d NAILS @ 4" O.C. AT PANEL EDGES AND BUILDING PERIMETER, AND 8" O.C. TO ALL OTHER FRAMING. SEE 446-55. PROVIDE SOLID 2X BLOCKING BELOW ALL UNSUPPORTED SHEATHING JOINTS IN THE FIRST 4' TRUSS SPACES AT THE FRONT & BACK WALLS OF THE BUILDING PER 5-55.

ROOF FRAMING PLAN

- 1. SEE SHEET 57 FOR GENERAL STRUCTURAL NOTES.
2. DIMENSIONS ARE TO OUTSIDE FACE OF STUD FRAMING (TYP.)
3. SEE FOUNDATION PLAN FOR SHEARWALL LAYOUT AND DETAILS ON 10Q53
4. WALL SHEATHING TO BE 1/2" SHEATHING W/ 32/16 GAGN RAY NAIL SHEATHING TO ALL FRAMING W/ 10d NAILS @ 8" O.C. U.N.O. SHEARWALL NOTES. ALL SHEATHING IN CONTACT WITH THE FOUNDATION WALLS SHALL BE PRESERVATIVE-TREATED MATERIAL. ALL WALL SHEATHING SHALL BE CONTINUOUS OVER THE WALL FRAMING AT ALL SHEAR WALLS.
5. PROVIDE 2X BLOCKING BEHIND ALL PANEL JOINTS IN SHEARWALLS. U.N.O.
6. REF. 5-54 FOR TYP. FRAMING ELEV. FOR EXTERIOR OPENINGS
7. REF. 48-54 FOR TYP. CORNER OF TRAIT, NON-LOAD BRG. WALLS TO THE ROOF TRUSSES.
8. REF. 5-54 FOR TYP. WALL TOP PLATE SPLICE 9. REF. 10Q54 FOR PARAPET STEP DOWN ELEV.
10. REF. 5-54 FOR TYP. HEADER DETAIL

- 11. SHOP DRAWINGS INCLUDING LAYOUT DRAWINGS, SPECIFICATIONS AND DESIGN CALCULATIONS FOR THE ROOF TRUSSES AND LAMINATED MEMBERS SHALL BE SUBMITTED FOR APPROVAL PRIOR TO ANY FABRICATION.
NOTES:
1.) SHOP DRAWINGS SHALL BE CERTIFIED BY A REGISTERED PROFESSIONAL ENGINEER. (FAXED OR REPRODUCED DOCUMENTS ARE NOT ACCEPTABLE)
2.) G.C. SHALL ALLOW A MINIMUM OF (5) WORKING DAYS FOR REVIEW AND APPROVAL BY THE ARCHITECT/ENGINEER.
12. ROOF TRUSSES SHALL BE DESIGNED FOR ANY SPECIAL LOADING SUCH AS CONCENTRATED LOADS FROM HANGING PARTITIONS OR HVAC EQUIPMENT (SEE PLAN FOR LOCATION AND LOADS).
13. THIS PORTION OF WALL CONSTRUCTED W/ 5 1/2"x16GA x 1 5/8" WIDE G60 GALV. MTL STUDS @ 12" OC SEE SECTIONS 1 THRU 3-56 SEE ARCH. DWGS. FOR EXTENT.
14. REFER TO BRICK LINTEL SCHEDULE ON SHEET 53.

G.C. SHALL SUBMIT ENGINEER SHOP DWGS. FOR APPROVAL PROIR TO ANY CONSTRUCTION.
ROOF NOT DESIGNED FOR PONDING. SEE ARCHITECTURAL DRAWINGS FOR DRAIN REQ'MNTS.
EXTREME CARE SHALL BE USED IN ERECTING ROOF TRUSSES.

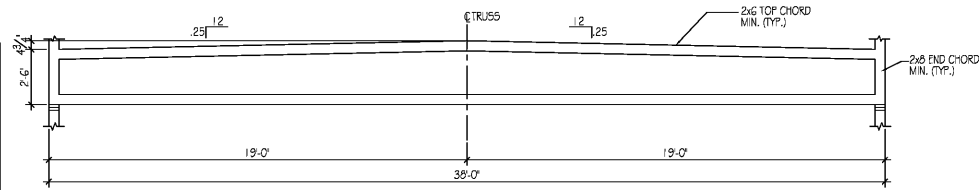

ROOF FRAMING PLAN NOTES

2 NOTES

3

TRUSS PROFILE

SCALE: 1/4"=1'-0" 4

