LUMINAIRE SCHEDULE

QTY.	MARK	LUMINAIRE WATTAGE	MANUF.	CATALOG NUMBER	DESCRIPTION	MOUNTING	POWER SUPPLY QTY.	POWER SUPPLY TYPE	UL WET LISTED
5	D9	74	EPA	FHR2205BS35WF/6464	2x2 LED, CRACKED ICE, 8000LM, 3250K, ICECUBE, 1 CIRCUIT	LAY-IN (GRID)	2	LED DRIVER	
9	D12	46	EPA	FHR2205BS30WF/6464	2x2 LED, CRACKED ICE, 5000LM, 3250K, ICEDHP, 1 CIRCUIT	LAY-IN (GRID)	1	LED DRIVER	
8	D14	35	LITHONIA	2GTL2-40LRW120277EZ1LP835GLRSPONAPX	2x2 LED, PRISMATIC, 4038LM, 3500K, 1 CIRCUIT	LAY-IN (GRID)	1	LED DRIVER	
4	E10	27	BEACON	TRV-D24NB-27/4WT3UNIVWHT	TYPE III DN DISTRIBUTION LED WALLPACK WHITE COLOR	WALL MTD.	1	LED DRIVER	X
9	E11	136	BEACON	TRV-D80NB-136/4WT3UNIVWHT	TYPE III DN DISTRIBUTION LED WALLPACK WHITE COLOR	WALL MTD.	1	LED DRIVER	X
8	E12	55	BEACON	TRV-D24NB-55/4WT3UNIVWHT	TYPE III DN DISTRIBUTION LED WALLPACK WHITE COLOR	WALL MTD.	1	LED DRIVER	X
1	E13	80	BEACON	TRV-D36NB-82/4WT3UNIVWHT	TYPE III DN DISTRIBUTION LED WALLPACK WHITE COLOR	WALL MTD.	1	LED DRIVER	X
5	E14	27	BEACON	TRV-U24NB-27/4WT3UNIVWHT	TYPE III UP DISTRIBUTION LED WALLPACK WHITE COLOR	WALL MTD.	1	LED DRIVER	X
9	EE1	55	BEACON	CLO12ANB-55/4WT5GNUNIVSQWHT	55W LED RECESSED CLG. NARROW DISTRIBUTION	RECESSED			
29	G1	38	LITHONIA	2GTL4-40LRW120277EZ1LP835GLRSPONAPX	2x4 LED, PRISMATIC, 5200LM, 3500K, 1 CIRCUIT (HIGH POWER)	LAY-IN (GRID)	1	LED DRIVER	
9	G2	27	LITHONIA	2GTL4-30LRW120277EZ1LP835GLRSPONAPX	2x4 LED, PRISMATIC, 3430LM, 3500K, 1 CIRCUIT (LOW POWER)	LAY-IN (GRID)	1	LED DRIVER	
4	GG1	36	LITHONIA	2GTL7-44LRW120277EZ1LP835GLRSPONAPX	2x4 LED, PRISMATIC, 5200LM, 3500K, 1 CIRCUIT (HIGH POWER)	LAY-IN (FLANGE)	1	LED DRIVER	
2	GG2	27	LITHONIA	2GTL7-43LRW120277EZ1LP835GLRSPONAPX	2x4 LED, PRISMATIC, 3430LM, 3500K, 1 CIRCUIT (LOW POWER)	LAY-IN (FLANGE)	1	LED DRIVER	
19	H5	29	EPA	FHR2205BS35WF/6464	2x2 LED, CRACKED ICE, 3000LM, 3250K, ICEDHP, 1 CIRCUIT	LAY-IN (GRID)	1	LED DRIVER	
3	H8	17	LITHONIA	2GTL2-20LRW120277EZ1LP835GLRSPONAPX	2x2 LED, PRISMATIC, 2287LM, 3500K, 1 CIRCUIT	LAY-IN (GRID)	1	LED DRIVER	
2	HH8	17	LITHONIA	2GTL7-22DLRW120277EZ1LP835GLRSPONAPX	2x2 LED, PRISMATIC, 2287LM, 3500K, 1 CIRCUIT	LAY-IN (FLANGE)	1	LED DRIVER	
1	J5	39	LITHONIA	6TL4-53LRW120277EZ1LP835GLRSPONAPX	1x4 LED, PRISMATIC, 3401LM, 3500K, 1 CIRCUIT	LAY-IN (GRID)	1	LED DRIVER	
5	N2	16	EPA	FVT-12-01-LED-835-LT	2' FVT, 3500K, IP DRIVER, 2000LM, MOUNTING BRACKET	SURFACE	1	LED DRIVER	X
2	N4	34	EPA	FVT-14-02-LED-835-LT	4' FVT, 3500K, IP DRIVER, 3800LM, MOUNTING BRACKET	SURFACE	1	LED DRIVER	X
31	N8	68	EPA	FVT-18-02-LED-835-LT	8' FVT, 3500K, IP DRIVER, 7600LM, MOUNTING BRACKET	SURFACE	2	LED DRIVER	X
18	P1		AMERILUX	GESZ SERIES TRACK	SINGLE CIRCUIT TRACK - WHITE (4', 8', & 12' LENGTHS - SEE PLAN FOR QTY.)	TRACK @ 14'-0"			
24	Q11	18	AMERILUX	HORNET-1P-A14-15-LED-WT-TN1-120-WF-3000-97-SN-WT	LED WHITE TRACK HEAD, FLOOD (45°), 3000 K, 97 CRI, GEN. SNOOT	TRACK MTD.	1	LED DRIVER	
39	Q13	46	AMERILUX	C4TV-A14-46-LED-WT-TN1-120-FL-3000-97-SN-WT	LED WHITE TRACK HEAD, FLOOD (25°), 3000 K, 97 CRI, GEN. SNOOT	TRACK MTD.	1	LED DRIVER	
2	R1	112	COLUMBIA	CS6-212-EB120-GLW/CSR44	8 FOOT, 4-LAMP (TANDUM), T8, 32W, FLUORESCENT STRIP WASSYMETRIC REFLECTOR	SURFACE/OPEN C.G.		ELECTRONIC	
150	R14	196	LITHONIA	TWSL-2400DLM-SBL-MVOLT-GZ10-32K-80CRI-UPL-SPD-GLR- CS93WL15-WH-NAPX	8' TWSL, 3250K, LOUVERED, UPLIGHT, 2400LM, 80CRI, DIM, WHITE CORD	SURFACE/OPEN CLG	2	LED DRIVER	
7	R15	142	LITHONIA	TWSL-1400DLM-SBL-MVOLT-GZ10-32K-80CRI-UPL-SPD-GLR- CS93WL15-WH-NAPX	8' TWSL, 3250K, LOUVERED, UPLIGHT, 1400LM, 80CRI, DIM, WHITE CORD	SURFACE/OPEN CLG	2	LED DRIVER	
30	R20	45	EPA	FST-8-050-35-L	8' FST, 3500K, 5000LM, LENSED	SURFACE	2	LED DRIVER	
2	RR1	62	COLUMBIA	CS4-232-EB120-GLW/CSR44	4 FOOT, 2-LAMP T8, 32W, FLUORESCENT STRIP W/SLECT BALLAST AND ASSYMETRIC REFLECTOR	SURFACE/OPEN C.G.		ELECTRONIC	
4	RR11	99	LITHONIA	MSL-12000LM-SBL-MVOLT-GZ10-32K-80CRI-UPL-SPD-GLR- CS93WL15-WH-NAPX	4' MSL, 3250K, LOUVERED, UPLIGHT, 12000lm, 80CRI, DIM, WHITE CORD	SURFACE/OPEN CLG	2	LED DRIVER	
8	R21	66	EPA	FST-8-065-35-L	8' FST, 3500K, 8500LM, LENSED	SURFACE	2	LED DRIVER	
1	RR12	71	LITHONIA	MSL-7000LM-SBL-MVOLT-GZ10-32K-80CRI-UPL-SPD-GLR- CS93WL15-WH-NAPX	4' MSL, 3250K, LOUVERED, UPLIGHT, 7000lm, 80CRI, DIM, WHITE CORD	SURFACE/OPEN CLG	2	LED DRIVER	
1	RR17	22.3	EPA	FST-4-025-35-L	4' FST, 3500K, 2500LM LENSED	SURFACE	1	LED DRIVER	
5	T49	18.5	JUNO	C22R-236-WH-F Remodeler Can, White Trim	6" RECESSED MEDIUM BASE CAN, WHITE OPEN TRIM, LAMP INCLUDED	RECESSED	1	LED DRIVER	
9	T52	14	GREENCREATIVE	14CDLA/830/277V, LENSED	4" RECESSED CAN DOWNLIGHT, 3000K, 600lm, WHITE, LOW SETTING	RECESSED	1	LED DRIVER	
2	T53	21	GREENCREATIVE	21CDLA/830/277V, LENSED	6" RECESSED CAN DOWNLIGHT, 3000K, 700lm, WHITE, LOW SETTING	RECESSED	1	LED DRIVER	
8	T54	21	GREENCREATIVE	21CDLA/835/277V, LENSED	6" RECESSED CAN DOWNLIGHT, 3500K, 1500lm, WHITE, HIGH SETTING	RECESSED	1	LED DRIVER	
21	T55	27	GREENCREATIVE	27CDLA/835/277V, LENSED	8" RECESSED CAN DOWNLIGHT, 3500K, 2000lm, WHITE, HIGH SETTING	RECESSED	1	LED DRIVER	
10	T56	45	INDY	LRM640LM36KMVOLTG38OCRIE2TPCSSPF	6" RECESSED CAN DOWNLIGHT, 3600K, 4000lm, DIM, SILVER/WHITE	RECESSED	1	LED DRIVER	
2	T58	9	BASELITE	SCP164BST40INCOPAL	LED DECORATIVE PENDANT	PENDANT	1	LED DRIVER	
#	U		----	SUPPLIED WITH HOOD	----	----	NA	NA	
16	X3	0.7	LITHONIA	LQWSW2R12G2/277	LED EXIT FIXTURE	SURFACE	1	LED DRIVER	
2	YZ	18.5	LITHONIA	DSA6D160HDWB	DOCK LIGHT, 60° FOLDING ARM, MEDIUM BASE, LAMP INCLUDED	WALL BRACKET +96"	1	LED DRIVER	
2	YY1	53	HUBBELL	FWL-S2	ATW WALL WASH LED - WHITE	CEILING MOUNT	NA	LED DRIVER	X
					INDICATES FIXTURES CONNECTED TO EMERGENCY CIRCUITS				

NOTES:
1. ALL SUSPENDED FIXTURES (INCLUDING BUT NOT LIMITED TO LAY-IN TYPE) TO BE SECURED WITH AIRCRAFT CABLE IN EXPOSED AREAS AND CEILING WIRE IN CONCEALED AREAS.
2. CONTRACTOR SHALL USE #12 GA. MIN. OR MANUFACTURER SUPPLIED/APPROVED CABLE OR WIRE.
3. ALL TYPE 'E' FIXTURES TO BE INSTALLED WITH THROUGH BOLTS.
# INDICATES FIXTURE SUPPLIED BY HOOD MANUFACTURE, LAMP SUPPLIED BY ELECTRICAL CONTRACTOR

ELECTRICAL SYMBOL SCHEDULE

SYMBOL	MANUFACTURER CAT. NO.	DESCRIPTION	MOUNTING
$	HUBBELL 1221-1/SS1	SWITCH, 20 AMP SINGLE POLE "1" RATED	+48" (WITHIN 10" OF DOOR)
$2	HUBBELL 1222-1/SS1	SWITCH, 20 AMP DPST "1" RATED	+48" (WITHIN 10" OF DOOR)
$3	HUBBELL 1223-1/SS1	SWITCH, 20 AMP THREE WAY "1" RATED	+48" (WITHIN 10" OF DOOR)
$m	HUBBELL TC SUET APPLICATION	SWITCH, MOTOR RATED TO SUIT APPLICATION (20 A. MIN.)	AS REQUIRED
$T	LEGRAND PNS 1251-1	SWITCH, 20 A SPDT/DPDT/3-WAY MOMENTARY CONTACT	+48" (WITHIN 10" OF DOOR)
$P	HUBBELL HBL1221-PL/SS1	SWITCH WITH PILOT LIGHT	100" A.F.F., OR AS NOTED
$PL	HUBBELL HBL1221-PL/SS1	SWITCH WITH PILOT LIGHT - FOR FAN CONTROL	48" A.F.F., OR AS NOTED
ⓒ ⓒ	HUBBELL 5362-1/SS8	20 AMP 3W DUPLEX RECEPTACLE	18" / 48" A.F.F., OR AS NOTED
ⓒ WP	HUBBELL GFTR20-1/WP26M	20 AMP GFCI DUPLEX RECEPT, WEATHERPROOF	18" / 48" A.F.F., OR AS NOTED
ⓒ GFCI	HUBBELL GR5362-1C/SS8	20 AMP 3W I.G. RECEPT.(ORANGE)	18" / 48" A.F.F., OR AS NOTED
ⓒ IG	HUBBELL 5362R/SS8	20 AMP RED DUPLEX RECEPT. (NON-I.G.)	18" / 48" A.F.F., OR AS NOTED
ⓒ ⓒ	HUBBELL 2-5362-1/SS82	2-20 AMP 3W DUPLEX RECEPT.	18" / 48" A.F.F., OR AS NOTED
ⓒ GFCI ⓒ	HUBBELL 2-GR5362-1C/SS82	TWO (2) 20A 3W I.G. RECEPT. (ORANGE)	18" / 48" A.F.F., OR AS NOTED
ⓒ IG ⓒ	HUBBELL 2-5362R/SS82	2-20 AMP 3W RED DUPLEX RECEPT. (NON-I.G.)	18" / 48" A.F.F., OR AS NOTED
ⓒ	HUBBELL HBL5362-1/HBL5366C/SS7	15 AMP 3W 125V STRAIGHT BLADE (ORANGE) (IG)	48" A.F.F., OR AS NOTED
ⓒ	HUBBELL SEE NOTE BELOW	15 AMP 3W 120V STRAIGHT BLADE (CORD & PLUG) (IG)	HUNG FROM CEILING
ⓒ	HUBBELL HBL5369C/9' STC CORD	20 AMP 3W 120V STRAIGHT BLADE (CORD & PLUG)	6'-0" 3#12 STO CORD
ⓒ	HUBBELL USB20ACSI/WP261	20 AMP 3W 125V DUPLEX RECEPTACLE W/TYPE A/A'C' USB PORTS	18" A.F.F., OR AS NOTED
ⓐ	HUBBELL HBL5362-1/HBL5309/SS720	30 AMP 3W 125V STRAIGHT BLADE WITH S.S. COVER	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL HBL5661/HBL5666CA/HBL6017/HBL7423WD	15 AMP 3W 250V STRAIGHT BLADE	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL HBL5481/HBL5466CA/HBL6017/HBL7423WD	20 AMP 3W 250V STRAIGHT BLADE	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL HBL9330/HBL9321/SS723L	30 AMP 3W 250V STRAIGHT BLADE	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL HBL9367/HBL9368/SS703	50 AMP 3W 250V STRAIGHT BLADE	AS NOTED
ⓐ	HUBBELL HBL8410/HBL8411C/SS7	20 AMP 4W 125/250V STRAIGHT BLADE	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL HBL9430A/HBL9432C/SS701	30 AMP 4W 125/250V STRAIGHT BLADE	10'-0" 4#10 STO CORD
ⓐ	HUBBELL HBL9450A/HBL9452C/SS701	50 AMP 4W 125/250V STRAIGHT BLADE	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL HBL8430A/HBL8432C/SS701	30 AMP 4W 3# 250V STRAIGHT BLADE	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL HBL8430A/HBL8432C/SS701	30 AMP 4W 3# 250V STRAIGHT BLADE	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL HBL8460A/HBL8462C/SS701	60 AMP 4W 3# 250V STRAIGHT BLADE	6'-0" 4#6 STO CORD
ⓐ	HUBBELL SEE NOTE BELOW	20 AMP 3W 125V TWIST LOCK (IG) (CORD & PLUG)	HUNG FROM CEILING
ⓐ	HUBBELL HBL3310	20 AMP 3W 125V TWIST LOCK	POWER POLE
ⓐ	HUBBELL SEE NOTE BELOW	20 AMP 3W 125V TWIST LOCK (CORD & PLUG)	HUNG FROM CEILING
ⓐ	HUBBELL HBL2810/HBL2811/SS720	30 AMP 3W 125V TWIST LOCK W/S.S COVER	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL SEE NOTE BELOW	20 AMP 3W 125V TWIST LOCK (CORD & PLUG)	HUNG FROM CEILING
ⓐ	HUBBELL SEE NOTE BELOW	20 AMP 3W 125/250V TWIST LOCK (CORD & PLUG)	HUNG FROM CEILING
ⓐ	HUBBELL HBL3320/HBL3321/HBL6031/HBL7425WDA	30 AMP 3W 250V TWIST LOCK	6'-0" 3#12 STO CORD
ⓐ	HUBBELL HBL2820/HBL2821/SS720	30 AMP 3W 250V TWIST LOCK	6'-0" 3#10 STO CORD (+48" A.F.F.)
ⓐ	HUBBELL SEE NOTE BELOW	30 AMP 3W 250V TWIST LOCK	HUNG FROM CEILING
ⓐ	HUBBELL HBL2820/HBL2821/HBL6031/HBL7425WDA	30 AMP 3W 250V TWIST LOCK	6'-0" 3#10 STO CORD
ⓐ	HUBBELL SEE NOTE BELOW	30 AMP 3W 250V TWIST LOCK	HUNG FROM CEILING
ⓐ	HUBBELL HBL3771/HBL3783C/HBL7715C/HBL7774WD	50 AMP 3W 250V TWIST LOCK	6'-0" 3#8 STO CORD
ⓐ	HUBBELL HBL8410/HBL8411/SS720	20 AMP 4W 125/250V TWIST LOCK	6'-0" 4#12 STO CORD
ⓐ	HUBBELL SEE NOTE BELOW	20 AMP 4W 125/250V TWIST LOCK	HUNG FROM CEILING
ⓐ	HUBBELL HBL2720/HBL2721	30 AMP 4W 125/250V TWIST LOCK	10'-0" 4#10 STO CORD
ⓐ	HUBBELL HBL9430A/HBL9432C/SS701	30 AMP 4W 125/250V TWIST LOCK	10'-0" 4#10 STO CORD
ⓐ	HUBBELL HBL2420/HBL2421/SS720	20 AMP 4W 3# 250V TWIST LOCK	48" A.F.F., OR AS NOTED
ⓐ	HUBBELL SEE NOTE BELOW	20 AMP 4W 3# 250V TWIST LOCK	HUNG FROM CEILING
ⓐ	HUBBELL HBL2720/HBL2721/HBL7425WDA	30 AMP 4W 3# 250V TWIST LOCK	6'-0" 4#10 STO CORD
ⓐ	HUBBELL SEE NOTE BELOW	30 AMP 4W 3# 250V TWIST LOCK	HUNG FROM CEILING
ⓐ	HUBBELL SEE NOTE BELOW	30 AMP 4W 3# 600V TWIST LOCK	HUNG FROM CEILING
ⓐ	HUBBELL SEE NOTE BELOW	30 AMP 5W 3# 250V TWIST LOCK	HUNG FROM CEILING
ⓐ	HUBBELL SEE NOTE BELOW	60 AMP 5W 3# 250V TWIST LOCK	HUNG FROM CEILING
ⓐ	HUBBELL SEE NOTE BELOW	100 AMP 5W 3# 250V TWIST LOCK	48" A.F.F. OR AS NOTED
ⓙ	HUBBELL OUTLET BOX/83181	JUNCTION BOX	18" A.F.F. OR AS NOTED
⊘	EXHAUST OR SUPPLY FAN, INSTALLED BY OTHERS, WIRED BY ELECTRICAL CONTRACTOR		
⊘	MOTOR - HP SIZES AS INDICATED		
⊠	MOTOR STARTER/VFD/LIS CONNECTION - SEE SPECIFICATIONS		
⊟	FUSED DISCONNECT SWITCH SIZED FOR APPLICATION		
▬	ELECTRICAL PANEL		
◈ ◈	REFRIGERATION SYSTEM NUMBER		
F	REFRIG. CASE FAN TERMINAL BOX CONNECTION		
L	REFRIG. CASE LIGHT TERMINAL BOX CONNECTION		
H	REFRIG. CASE ANTI-SWEAT TERMINAL BOX CONNECTION		
P	REFRIG. CASE PROBE TERMINAL BOX CONNECTION		
D	REFRIG. CASE DEFROST TERMINATION TERMINAL BOX CONNECTION		
S	REFRIG. SYSTEM SOLENOID		
P	REFRIG. SYSTEM PROBE TERMINAL BOX CONNECTION - TO BE INSTALLED		
H M	E.M.S. CONTROL HUMIDASTAT - SUPPLIED BY PUBLIX, INSTALLED BY CONTRACTOR	AT ELEV. 8'-2" TO CENTER	
T M	E.M.S. CONTROL THERMOSTAT - SUPPLIED BY PUBLIX, INSTALLED BY CONTRACTOR	AS NOTED	
V	CEILING MTD VOLUME CONTROL - SEE INSTALLATION DETAIL	CEILING MTD	
V	VOLUME CONTROL - WALL MTD WITH ½°C TO CEILING SPACE	48" OR AS NOTED	
TC	TIME CLOCK - WALL MTD WITH ½°C TO CEILING SPACE		

NOTE: LEVITON AND PASS & SEYMOUR (P&S) ARE APPROVED EQUALS

BOOT COVERS NOT REQUIRED ON RECEPTACLE SIDE OF EQUIPMENT EXCEPT FOR SEAFOOD AND MEAT

	20A-1W-125V	20A-3W-125V	20A-3W-250V	30A-3W-125V	30A-3W-250V	30A-4W-125/250V	30A-4W-3#-250V	30A-5W-125/250V	50A-3W-125V	50A-3W-250V	100A-5W	
RECEPTACLE	HBL1201	HBL2320	HBL2420	HBL2430	HBL2820	HBL2720	HBL2730	HBL2950	HBL2750	HBL2760	HBL5100SW	RECEPTACLE
CORD (GRAY)	12/3 STO	12/3 STO	12/4 STO	10/4 STO	10/3 STO	10/4 STO	8/4 STO	10/4 STO	8/3 STO	6/3 STO	6/4 SJ	CORD (GRAY)
COVER (BLACK)	HBL4032	HBL4032	HBL4038	HBL4038	HBL4038	HBL4038	HBL4038	HBL4038	HBL4038	HBL4038	(NONE)	COVER (BLACK)
CONNECTOR BODY	HBL1351	HBL2310	HBL2410	HBL2410	HBL2810	HBL2710	HBL2710	HBL2810	HBL2710	HBL2710	(NONE)	CONNECTOR BODY
PLUG (2 REQUIRED)	HBL2311	HBL2320	HBL2420	HBL2430	HBL2820	HBL2720	HBL2730	HBL2820	HBL2720	HBL2760	HBL5100SW (PAINT BLACK)	PLUG (2 REQUIRED)
COVER (2 REQUIRED - BLACK)	HBL2331	HBL2330	HBL2430	HBL2430	HBL2830	HBL2730	HBL2730	HBL2830	HBL2730	HBL2760	HBL5100SW (PAINT BLACK)	COVER (2 REQUIRED - BLACK)
	HBL2331	HBL2330	HBL2430	HBL2430	HBL2830	HBL2730	HBL2730	HBL2830	HBL2730	HBL2760	(NONE)	

	30A-5W-125/250V	15A-3W-120V
RECEPTACLE	HBL2850	5526R
CORD (GRAY)	10/3 STO	12/3 STO
COVER (BLACK)	HBL4038	HBL4024
CONNECTOR BODY	HBL2853	HBL5266C
PLUG (2 REQUIRED)	HBL2851	HBL5266C
COVER (2 REQUIRED - BLACK)	HBL4035	HBL4023

	20A-1W-125/250V	20A-3W-120V	15A-3W-120V	30A-4W-600V	30A-3W-250V	30A-3W-250V	60A-3W-250V	100A-5W	
RECEPTACLE	HBL2620	5547G	HBL2718G	HBL3771	(NONE)	HBL5100SW	RECEPTACLE		
CORD (GRAY)	10/3 STO	12/3 STO	8/4 STO	6/3 STO	6/3 SO	6/3 SO	(NONE)	CORD (GRAY)	
COVER (BLACK)	HBL4033	HBL4024	HBL7717C	HBL7717C	(NONE)	HBL5100SW (PAINT BLACK)	(NONE)	COVER (BLACK)	
CONNECTOR BODY	HBL2853	HBL4726C	HBL2744C	HBL3760C	(NONE)	HBL5100SW (PAINT BLACK)	ADD'L (1 REQ'D)	CONNECTOR BODY	
PLUG (2 REQUIRED)	HBL2852	HBL4720C	HBL2760C	HBL7760C	(NONE)		(NONE)	PLUG (2 REQUIRED)	
COVER (2 REQUIRED - BLACK)	HBL4032	HBL4073	HBL7760C					COVER (2 REQUIRED - BLACK)	

GENERAL ELECTRICAL NOTES

1. WALK-IN FREEZERS AND COOLERS
   PROVIDE AND INSTALL A SUITABLE LENGTH OF S.T.O. CORD FROM EACH PRE-WIRED JUNCTION BOX OF EVAPORATOR COIL TO POWER RECEPTACLE CORD TO BE EQUIPPED WITH A HUBBELL #7311 CAP AND SUITABLE FOR CONNECTION TO A #7300 RECEPTACLE.
2. ENTRANCE DOORS
   (A) CONNECT 115 VOLT CIRCUIT TO DOOR HEADER CONNECT PER DOR MANUFACTURERS INSTRUCTIONS.
   (B) CONCEAL CONDUIT IN DOOR FRAME.
3. CONTROLS
   (A) CONTRACTOR TO PROVIDE AND INSTALL ALL CONDUIT AND CONDUCTORS FROM THERMOSTATS, FIRESTAT, HUMIDISTAT AS SHOWN ON DRAWINGS.
   (B) CONTRACTOR TO MAKE FINAL CONNECTIONS OF CONDUCTORS.
4. CEILING
   CONTRACTOR TO REFER TO REFLECTED CEILING PLAN FOR EXACT LOCATION OF LIGHTING FIXTURES, AIR CONDITIONING DIFFUSERS, SPRINKLER SYSTEM, ETC.
5. FACADE SIGN
   (A) SIGN CONTRACTOR TO BRING LEADS THRU FACADE WALL FOR CONNECTION BY ELECTRICIAN.
   (B) ELECTRICAL CONTRACTOR TO PROVIDE JUNCTION BOX FOR EACH LETTER AND CONNECT TO PANEL "S".
6. ALL DEVICE COVER PLATES TO BE 305 STAINLESS STEEL.
7. NO ALUMINUM CONDUIT OR CONDUCTORS WILL BE ACCEPTED. MINIMUM CONDUCTOR IN CONDUIT TO BE 3#12 ½"C WITH GROUNDING CONDUCTOR. MINIMUM UNDERGROUND OR UNDERSLAB CONDUIT TO BE ¾"C.
8. ALL LIGHTING FIXTURES AND LAMPS SHALL BE FURNISHED BY PUBLIX AND INSTALLED AND WIRED BY CONTRACTOR.
9. ALL SUPPLY AND EXHAUST FANS TO BE FURNISHED AND INSTALLED BY OTHERS WIRED AND CONNECTED BY ELECTRICAL CONTRACTOR.
10. FIRE ALARM
    (A) INSTALL ALL CONDUIT AND OUTLET BOXES AS SHOWN ON DRAWING.
    (B) ALL FIRE ALARM EQUIPMENT WILL BE FURNISHED, INSTALLED AND CONNECTED BY FIRE ALARM CONTRACTOR.
    (C) FIRE ALARM SYSTEM SHALL MEET ALL LOCAL REQUIREMENTS, NFPA NO. 72 AND ADA.
11. EMERGENCY GENERATOR
    (A) CONTRACTOR TO INSTALL AND CONNECT 400KW GENERATOR AND TRANSFER SWITCHES AS FURNISHED BY PUBLIX.
    (B) GENERATOR WILL BE A 400KW NATURAL GAS L.P. GAS DRIVEN GENERATOR 120/208 VOLT, 3 PHASE, 4 WIRE OUTPUT, SEE SPECIFICATIONS.
    (C) GENERATOR AND TRANSFER SWITCH ARE TO BE INSTALLED IN LOCATION AS SHOWN ON DRAWINGS AND TO MEET ALL LOCAL AND NATIONAL CODES.
12. DO NOT USE MACHINE ROOM ROOF STRUCTURE FOR SUPPORTING OF ANY ELECTRICAL EQUIPMENT, SUCH AS CONDUIT OR LIGHTING FIXTURES, USE UNI-STRUT WELDED TO OR CONNECTED TO BEAMS.
13. CONTRACTOR TO PROVIDE PULL CORD IN ALL EMPTY CONDUITS, ELECTRICAL, TELEPHONE, COMMUNICATIONS, ETC.) FOR FUTURE USE, TERMINATE CORD WITH SUITABLE SIZE WASHER TO PREVENT SLIPPAGE AND PROVIDE BLANK COVERS FOR ALL BOXES NOT USED. ALL CONDUITS TO HAVE BUSHINGS TO PREVENT CABLING DAMAGE.
14. ALL CONDUIT ROUTING SHOWN SOLID TO BE FED CONCEALED ABOVE CEILING. ALL CONDUIT ROUTING SHOWN WITH DASH LINES TO BE CONCEALED WITHIN WALLS OR 12" (MIN.) BENEATH SLABS.
15. ALL CIRCUITS TO INCLUDE EQUIPMENT GROUND CONDUCTOR SIZED PER ARTICLE 250 OF THE ADOPTED VERSION OF N.E.C. (INSULATED GROUND (IG) CONDUCTOR WHERE REQUIRED, TO BE GREEN WITH YELLOW STRIP.
16. ALL RECEPTACLES DESIGNATED 'WP' (OR USE IN WET LOCATIONS) SHALL BE OF WEATHER RESISTANT TYPE PER NEMA 5-20R (5-15R AS BASIC).
17. ALL DEVICE MOUNTING HEIGHTS TO BE CENTERED MEASURED FROM FINISH FLOOR TO TOP OF DEVICE U.O.N.

AREAS OF HORIZONTAL RUNS BY TRADES

ELECTRICAL: TOP OF STEEL GIRDER AND JOISTS OR BELOW TOP OF STEEL WHERE EXPOSED IN THIS PROJECT TYPE, IMMEDIATELY BENEATH TOP OF JOIST WHERE AND PASSING BETWEEN STEEL JOIST WEBBING. (THE INSTALLATION SHALL BE IN ACCORD WITH NEC 300.4(E))

REFRIGERATION: 32 IN. TO 36 IN. BELOW TOP OF STEEL GIRDER AND JOISTS WHERE EXPOSED IN THIS PROJECT TYPE, IMMEDIATELY BENEATH BOTTOM CHORD OF STEEL JOIST GIRDERS AND JOISTS.

PLUMBING: 8 IN. TO 12 IN. BELOW BUILDING WHERE EXPOSED IN THIS PROJECT TYPE AND JOISTS. 8 IN. BELOW BOTTOM CHORD OF STEEL GIRDER AND JOISTS.

AIR CONDITIONING: 36 IN. BELOW ROOF DECK TO TOP OF DUCT BELOW WHERE EXPOSED IN THIS PROJECT TYPE, IMMEDIATELY BENEATH AND PARALLEL UNDER BOTTOM CHORD OF STEEL JOIST GIRDERS AND JOISTS AS POSSIBLE WHILE LEAVING ROOM FOR INSULATION LINERS.

IF DEVIATION FROM THESE AREAS IS INDICATED, SUCH DEVIATION MUST BE APPROVED UPON BY JOB SUPERINTENDENT AND PUBLIX REPRESENTATIVE.

BAKERY AREA
SCALE: ½" = 1'-0"

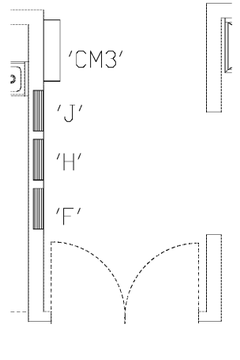

PASSAGE A
SCALE: ½" = 1'-0"

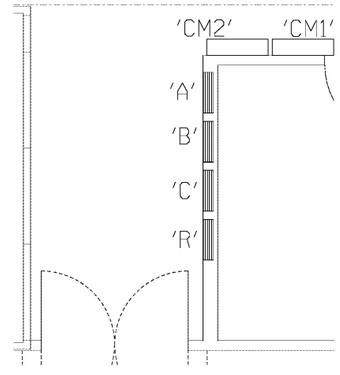

PASSAGE B
SCALE: ½" = 1'-0"

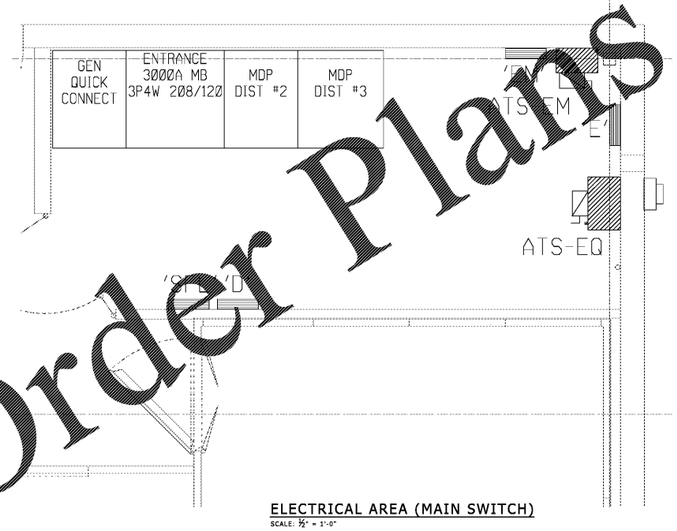

ELECTRICAL AREA (MAIN SWITCH)
SCALE: ½" = 1'-0"

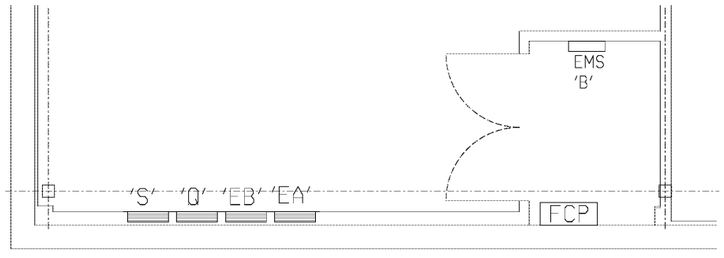

LOUNGE AREA
SCALE: ½" = 1'-0"

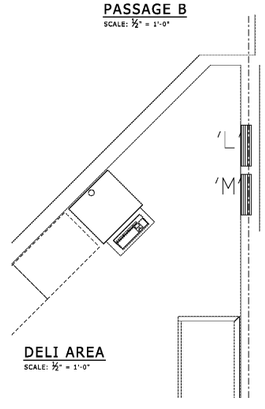

DELI AREA
SCALE: ½" = 1'-0"

Order Plans @ WWW.Line.com

Publix SUPER MARKETS
CORPORATE OFFICES, FACILITIES DESIGN
BOX 407, LAKELAND, FL 33802
(863) 688-1188
PHYSICAL ADDRESS:
3300 PUBLIX CORPORATE PARKWAY
LAKELAND, FL 33811-1331
PUBLIX FACILITIES DESIGN DEPARTMENT
ARCHITECTS
DAVID M. GEE, AIA
ARCHITECT FL #12913
DAVID A. [illegible]
ARCHITECT FL #[illegible]
GA. REG. [illegible]
SC. REG. [illegible]
AL. REG. [illegible]
TN. REG. [illegible]
NC. REG. [illegible]
VA. REG. [illegible]
JOHN C. [illegible], PE
FL REG. [illegible]
PAUL C. HARMAN, PE
STRUCTURAL - FL REG. 67799
GA. REG. 027340
AL. REG. 31750
AL REG. 34955
TN. REG. 109852
SC. REG. 31750
VA. REG. 0402039922
JOHN J. CARAMALIS, PE
MECHANICAL - FL REG. 63889
GA. REG. 0000[illegible]
SC. REG. 16857
AL. REG. 25081
TN. REG. 119557
NC. REG. 0000[illegible]
ANTHONY CLEMENTI, PE
MECHANICAL - FL REG. 56781
GA. REG. 0000[illegible]
SC. REG. 33951
AL REG. 33669
TN. REG. 117382
NC. REG. 039642
VA. REG. 0402064137
RAYMOND J. SIRIANNI, PE
ELECTRICAL - FL REG. 68253
GA. REG. [illegible]
SC. REG. 19743
AL. REG. 25565
TN. REG. 128038
NC. REG. 039642
VA. REG. 0402050379
NORMAN MEIER, PE
ELECTRICAL - FL REG. 89422
GA. REG. 31492
SC. REG. 25290
AL REG. 28079
© COPYRIGHT 2017
PUBLIX SUPER MARKETS, INC.
THESE CONSTRUCTION DOCUMENTS ARE THE PROPERTY OF PUBLIX SUPER MARKETS, INC. AND ARE NOT TO BE COPIED OR REUSED FOR ANY SPECIF