




Order Plans

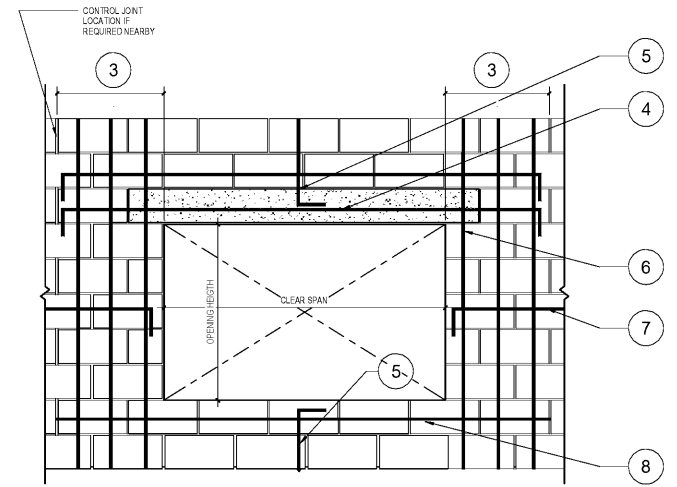

TYP ELEVATED OPENING

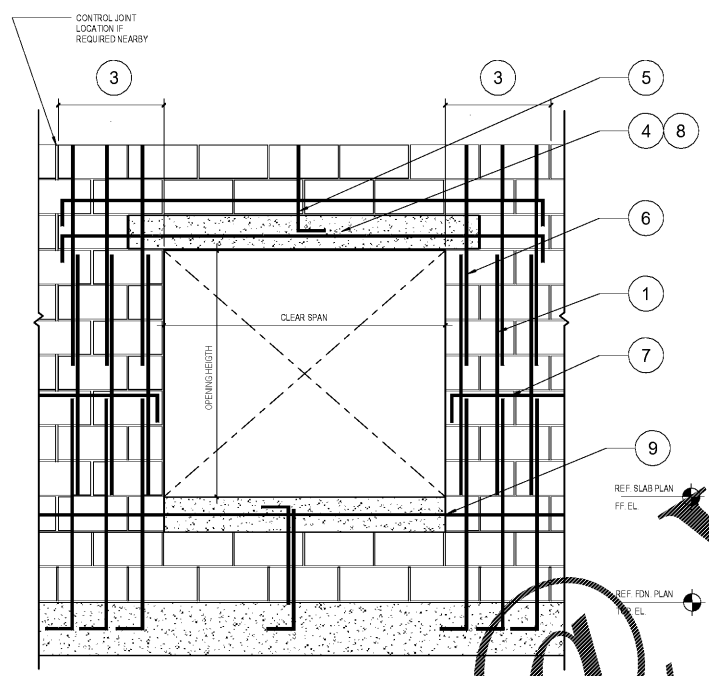


TYPICAL MASONRY WALL OPENING DIAGRAM AND SCHEDULE

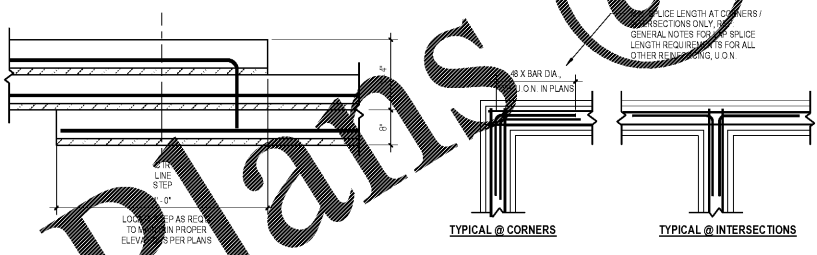


STEEPED BOND-BEAM

CONTINUITY CORNER, TYP.


- NOTES**
1. SPLICES IN VERT. REINF. REF. CMU WALL REINF. DIAGRAM
 2. BOND BEAM, REF. CMU WALL REINF. DIAGRAM
 3. * EXTEND GROUTED LINTEL AND REINF. THROUGH ALL FULL JAMB WIDTHS WITH STANDARD 90° HOOKS @ ENDS
 4. USE CAST-IN-PLACE PRECAST LINTELS ONLY FOR BOTTOM COURSE OF LINTEL BEAMS OVER OPENINGS, 8" BRG EA. END
 5. VERT. WALL REINF. PER REQUIRED SPACING WITH STANDARD 90° DEGREE HOOK
 6. ALL VERT. BARS AT DOOR JAMBS TO BE FULL HEIGHT
 7. WHERE HORIZONTAL REINF. IS TERMINATED BY OPENING OR CONTROL JOINT PROVIDE STANDARD 90° HOOK WITH VERT. WALL REINF. IN THE END CELL
 8. MIN. (1) #5 AT 8" CMU, (2) #5 AT 12" CMU, BOTTOM OF THE OPENING ABOVE GRADE UP TO 12" CLEAR SPAN UNLESS OTHERWISE NOTED (1) #5 CONTINUOUS IN K.O. COURSE AT FF. EL.
 9. * FOR SEISMIC DESIGN CATEGORY "D", EXTEND GROUTED LINTEL AND REINF. 24" MIN. AT ALL OPENINGS ABOVE AND BELOW

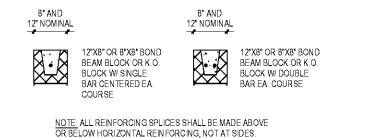


MASONRY BOND BEAM

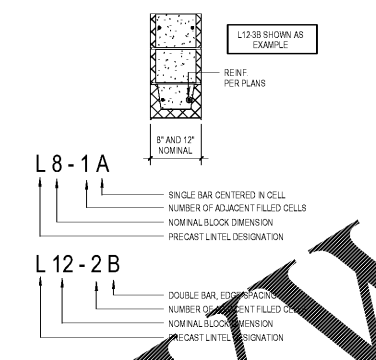


LINTELS

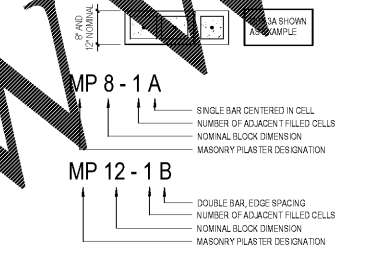


MASONRY PILASTER DESIGNATION

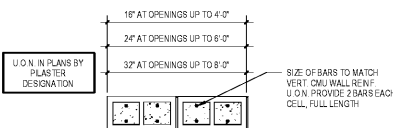


JAMBS

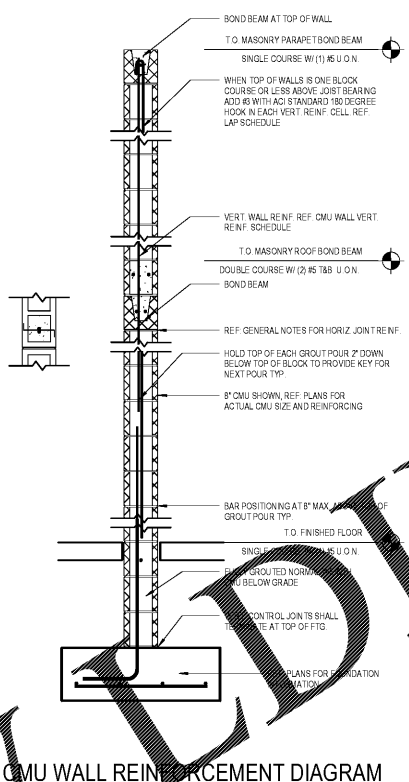


CMU WALL REINFORCEMENT DIAGRAM

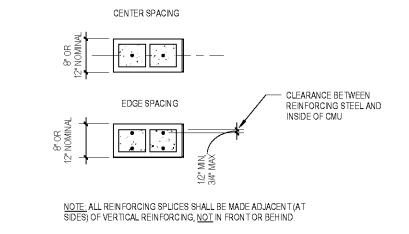

MASONRY VERT. REINF. PLACEMENT

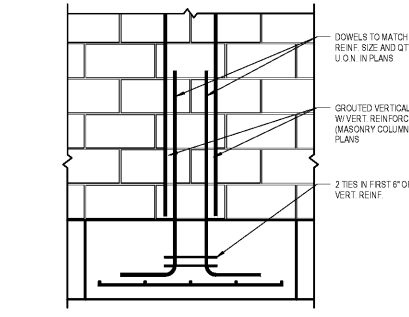


MASONRY WALL PILASTER

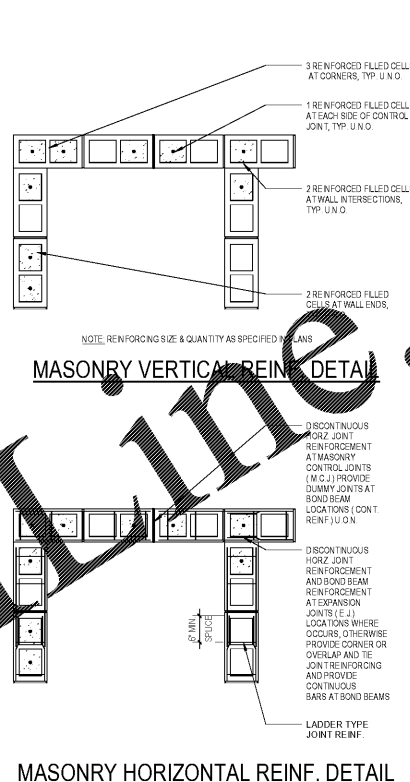


MASONRY VERTICAL REINF. DETAIL

MASONRY HORIZONTAL REINF. DETAIL

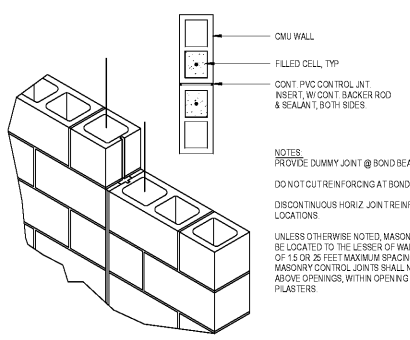

MASONRY CONTROL JOINT

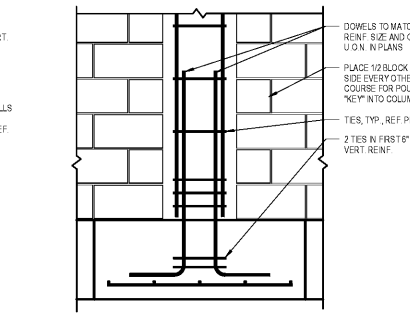

CONCRETE WALL COLUMN

General Lintel & CMU Information
SCALE: 3/4" = 1'-0"

1975 Prospect Ave.
Orlando, FL 32814
P (407) 661-9100
F (407) 661-9101
www.r.p.a.com

Calaci & Reto
Architects Engineers

WindCrest Companies
605 E. Robinson Street, Suite 340
Orlando, Florida 32801

Publix/Retail @ Lake Crossing
South Lake Drive & Platt Springs Road
Lexington, South Carolina



Revision Schedule	
No.	Description
A	100% Public Submission
B	100% Public Submission
C	100% Public Submission

S004