


LUMINAIRE SCHEDULE										
QTY.	MARK	LUMINAIRE WATTAGE	MANUF.	CATALOG NUMBER	DESCRIPTION	MOUNTING	BALLAST		LAMP	
							QTY.	TYPE	QTY.	TYPE
8			DUAL-LIFE	CEVEG30	EMERGENCY LIGHTING WALLPACK W/BATTERY BACKUP	SURFACE			1	LAMP INCLUDED
91	G	112	COLLUMBA	4P24-4320-RAA12 125-4EU-GLR	2x4 4-LAMP, 32W TR FLUORESCENT TROFFER (ACRYLIC DIFFUSER)	LAY-IN / GRID	1	ELECTRONIC	4	F032/835/W/ECO
7	J1	62	COLLUMBA	EW44 232-ESLH120-GLR	1x4 2-LAMP, 32W TR FLUORESCENT WRAPAROUND (ACRYLIC DIFFUSER)	SURFACE			2	F032/835/W/ECO
15	X1	12	PRE-SOCCLETTE	PEIHL-3-R-EC-W-1-COR	LED EXT FIXTURE	SURFACE	NA	LED DRIVER	1	INCLUDED
3	RR	62	COLLUMBA	PB-284-232-EU-GLR-4PK (TYPE RR)	4 FOOT, 2-LAMP TR, 32W, FLUORESCENT STRIP W/ELECT BALLAST	SURFACE	1	ELECTRONIC	2	F032/835/W/ECO
* 8	E10	27	BEACON	TRV-D2448-274K/75/UM/59HT	TYPE-R DISTRIBUTOR LED WALLPACK WHITE COLOR	WALL MTD.	NA	LED DRIVER	2	27W 4000K LED
* 9	E12	55	BEACON	TRV-D2448-554K/75/UM/59HT	TYPE-R DISTRIBUTOR LED WALLPACK WHITE COLOR	WALL MTD.	NA	LED DRIVER	2	55W 4000K LED

* INDICATES UNLISTED FIXTURE SUITABLE FOR WET/DAMP LOCATION TO COMPLY WITH N.E.C. 410-4

- NOTES**
- ROUTE HOMERUN VIA LIGHTING CONTACTOR.
 - EC SHALL ROUTE HOMERUN FOR TENANT LIGHTING CIRCUIT AS SHOWN ON 'TENANT LIGHTING CONTROL DIAGRAM'.
- GENERAL NOTES**
- FIXTURE WHIPS SHALL BE ASSEMBLED WITH 1/2" MC CABLE AND SHALL BE OF SUFFICIENT LENGTH TO ALLOW RELOCATION OF ANY TYPE 'A' AND 'AE' LIGHT FIXTURES A MINIMUM OF ONE TILE IN ANY DIRECTION.
 - ALL EXPOSED CONDUIT SHALL BE LOCATED WITHIN JOIST SPACE AREA OR ATTACHED DIRECTLY TO THE JOIST. CONDUIT SHALL NOT BE SUSPENDED FROM STRUCTURE.
 - CONTRACTOR SHALL COORDINATE LOCATION AND MOUNTING HEIGHT OF ALL EXTERIOR SOFFIT LIGHTS AND WALLPACKS WITH ARCHITECTURAL DRAWINGS AND DETAIL.
 - EXTEND UNCONTROLLED 'HOT' CONDUCTOR TO ALL EMERGENCY LIGHTS, EXIT LIGHTS, AND NIGHT LIGHTS.

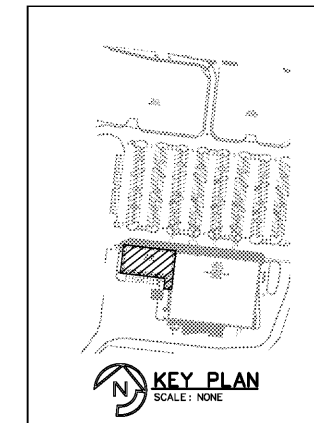

1925 Prospect Ave.
Orlando, FL 32814
P (407) 661-9100
F (407) 661-9101
www.p.e.com

CLIENT NAME
WindCrest Companies
605 E. Robinson Street, Suite 340
Orlando, Florida 32801

PROJECT NAME
Publix/Retail @ Lake Crossing
South Lake Drive & Platt Springs Road
Leesburg, South Carolina

DATE
03/17/17

REVISION

No.	Description	Date
A	100% Final Submission	03/17/17
B	100% Public Review	05/17/17
C	100% Final Submission	06/10/17

DESIGNED BY
SW

CHECKED BY
CS

Job Number: 51207
Colwill Engineering
Consulting Engineers, Inc.
Engineering Business No. CO 2507-PE
3750 East Adams Drive, Tampa, Florida 33606
Tel: 813-841-0800 Fax: 813-841-0400
© 2017 ALL RIGHTS RESERVED

E300