


1. SEE SHEET S8 FOR GENERAL STRUCTURAL NOTES.
2. DIMENSIONS ARE TO FACE OF STUDS.
3. DENOTES SHEAR WALL. SEE FOUNDATION PLAN.
4. WALL SHEATHING TO BE 1/2" SHEATHING W/ 32/16 SPAN RATING. OSB MUST BE USED FOR ALL SHEAR WALLS. OSB OR PLYWOOD MAY BE USED FOR REMAINDER OF WALLS. NAIL SHEATHING W/ 10d NAILS @ 6:12 SPACING U.N.C.
5. PROVIDE 2x BLOCKING BEHIND ALL PANEL JOINTS IN SHEARWALLS. U.N.C.
6. SEE DETAIL 5/54 FOR CANOPY BLOCKING DETAIL.
7. PROVIDE SOLID BLOCKING AND UPLIFT BRIDGING FOR JOISTS @ 6'-0" O.C.
8. FOR SHEAR WALL NOTES SEE S6.

GENERAL NOTES SCALE: 1


- (1) 2x6 POST - SEE DETAIL
- (2) WOOD PLATED TRUSSES @ 32" O.C. - BOTTOM CHORD LEVEL, TOP CHORD SLOPED 1/4" PER FOOT (HJI) SIDE 45° (PLAN NORTH)
- (3) WOOD PLATED TRUSSES SPACING VARIES FROM 4" PER FEET TO 32" O.C. (PLAN NORTH)
- (4) BLOCKING @ 6" O.C. BELOW TOWER PERIMETER WALLS BETWEEN TRUSSES. PROVIDE BLOCKING W/ SIMPSON L2B2.
- (5) DESIGN TRUSS TOP CHORD FOR 750 PLF AXIAL FORCE. DESIGN TRUSS TOP CHORD FOR 450 PLF AXIAL FORCE.
- (6) PROVIDE 2x6 BLOCKING @ 5'-0" O.C. W/ CONT. SIMPSON CS22 STRAP ALONG TOP. ATTACH TRUSS TOP CHORD W/ SIMPSON A21.
- (7) DESIGN TRUSS TOP CHORD FOR 3K AXIAL (FACTORED) FORCE.
- (8) (3) 2x8 S.Y.P. HEADER.
- (9) (3) 2x12 S.Y.P. HEADER.
- (10) (3) 1.75x8.25 2.0E LVL HEADER.

CONSTRUCTION NOTES SCALE: 2


SCALE: 1/4"=1'-0" 7 NOT USED SCALE: 3

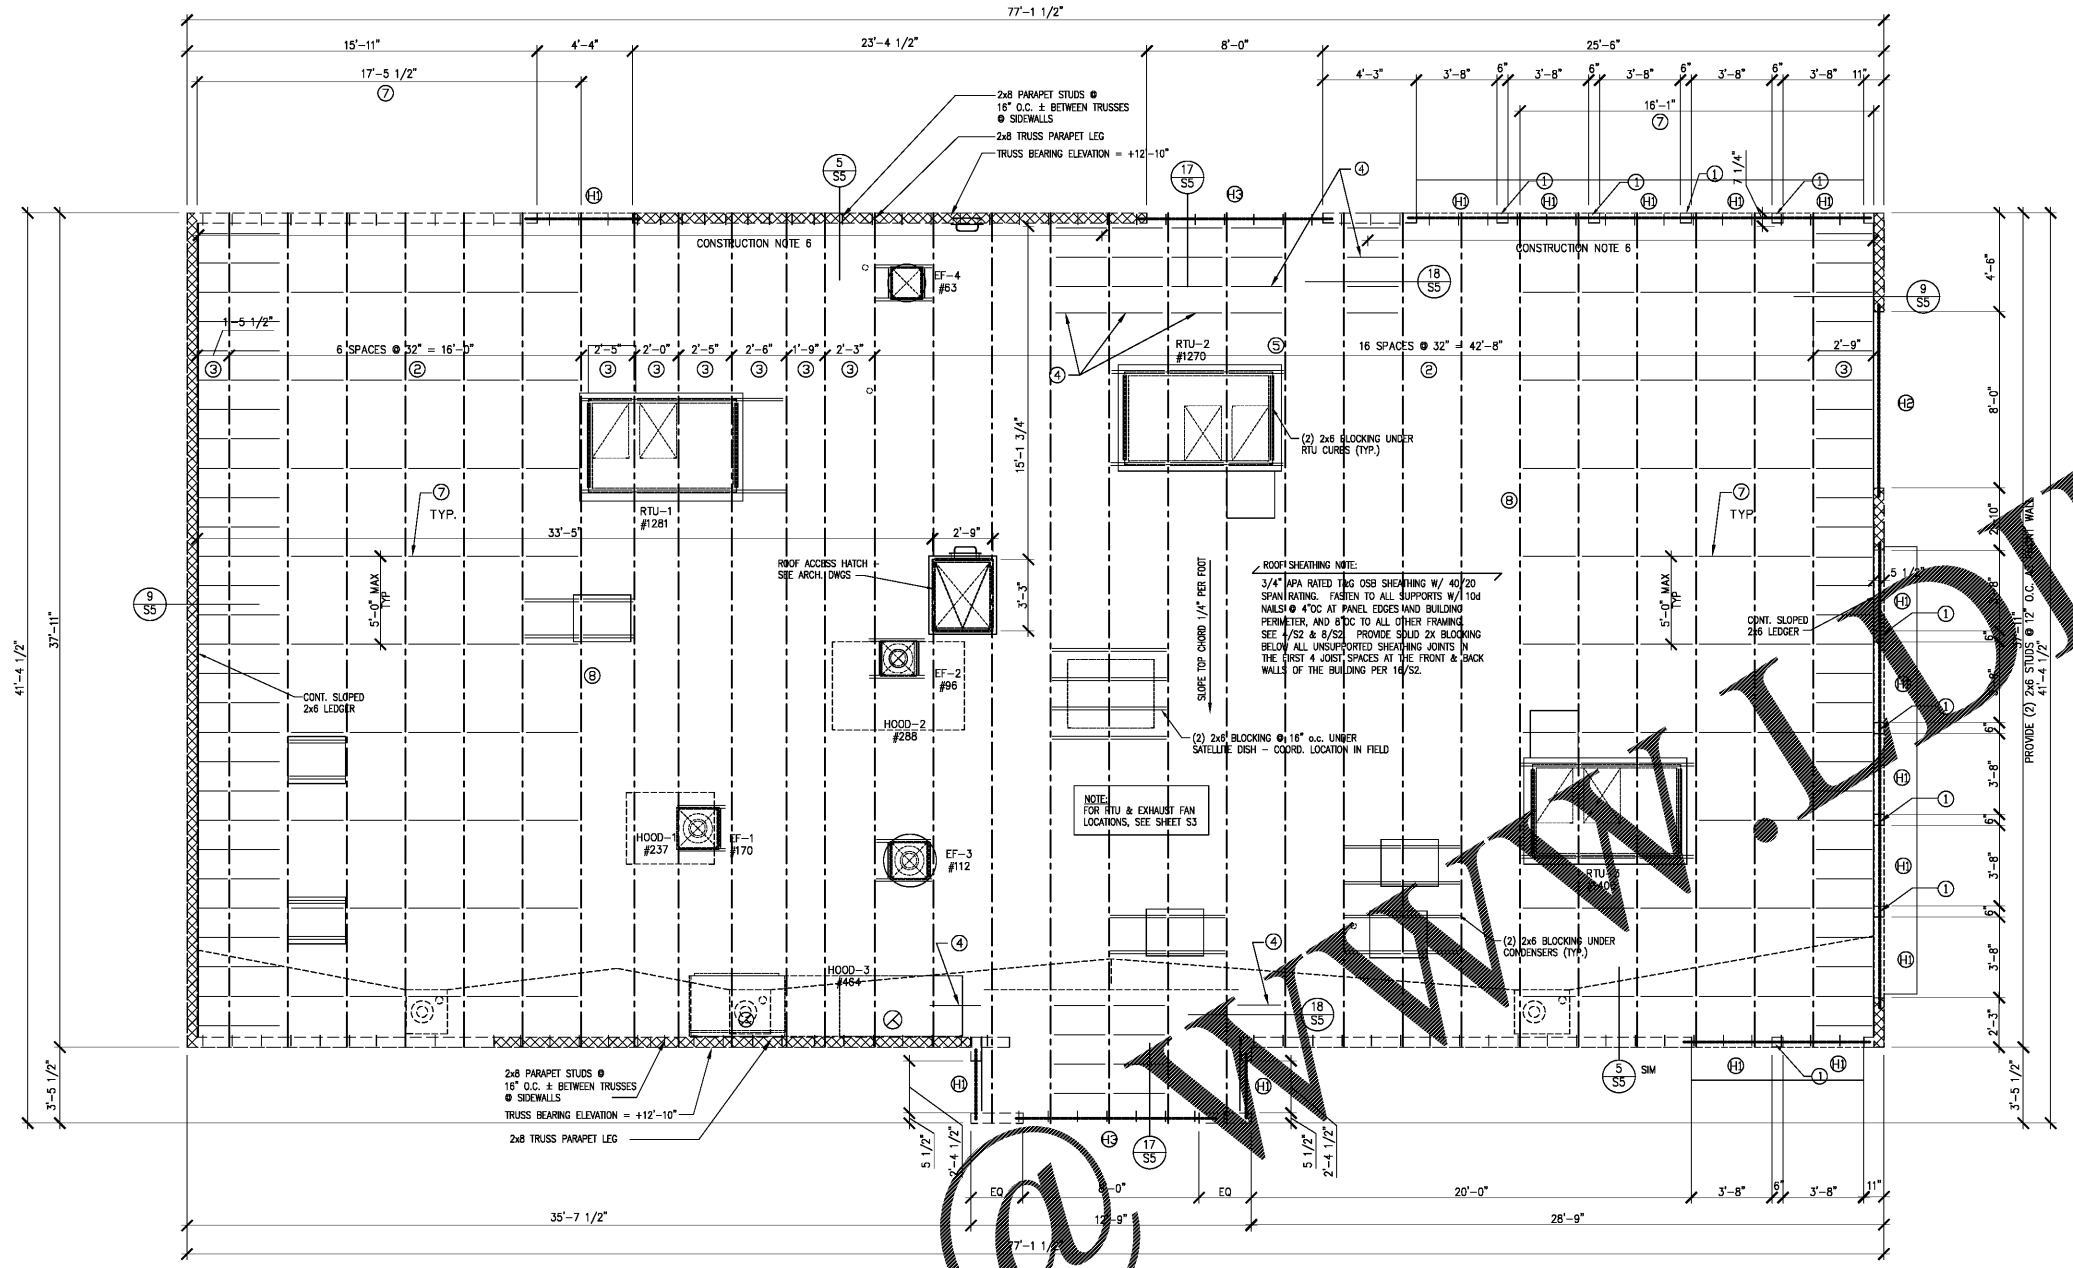


ROOF FRAMING PLAN SCALE: 1/4"=1'-0" 7 NOT USED SCALE: 3

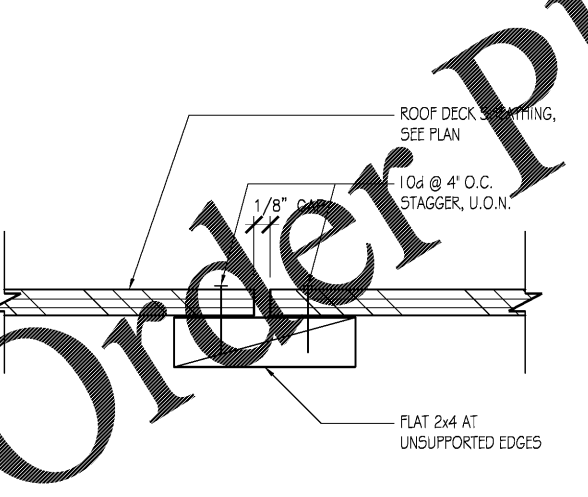


ROOF BLOCKING DETAIL SCALE: N.T.S. 16

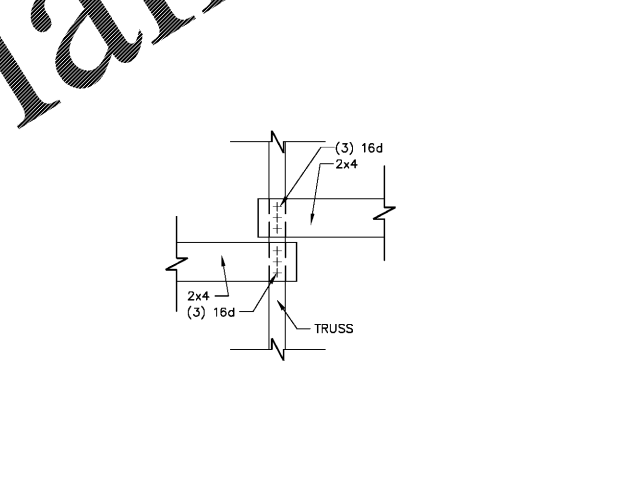

TYPICAL BRIDGING SCALE: N.T.S. 12

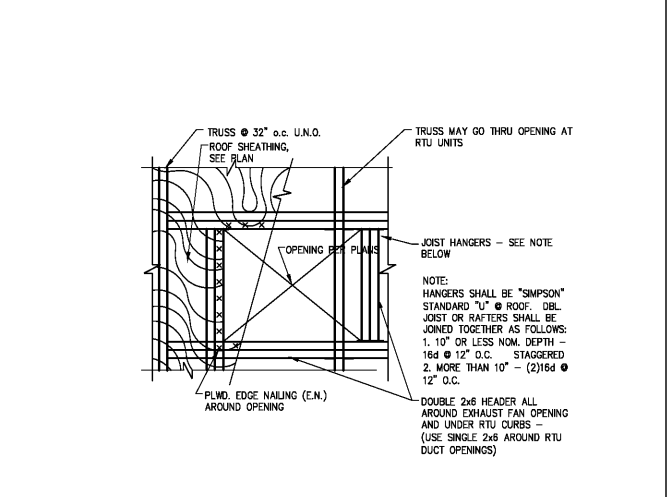

ROOF OPENING DETAIL SCALE: N.T.S. 8

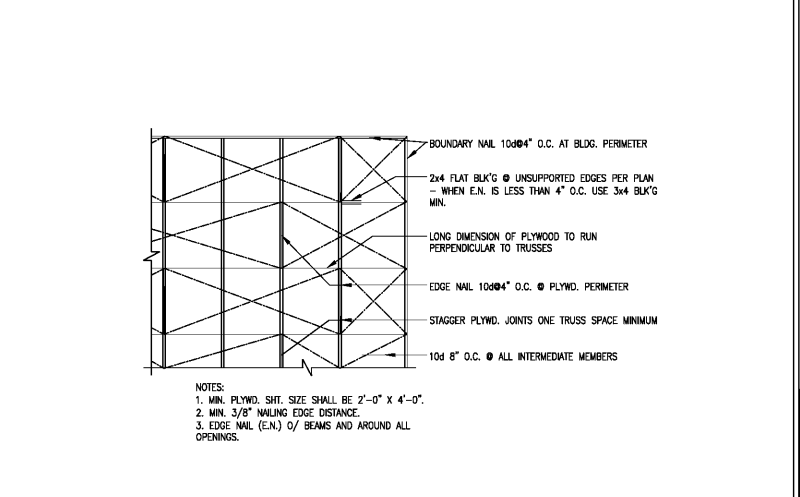

ROOF NAILING DETAIL SCALE: N.T.S. 4

NO.	REVISIONS	DATE
	DESCRIPTION	

ROOF FRAMING PLAN

CHECKED BY: CHECKED BY #2: APPROVED BY:

DATE: 2-28-17

SHEET NUMBER: S2