

CPI CAROLINA PRODUCTS, INC. 1132 E. AM DR. CHARLOTTE, NC 28211 PHONE: (704) 364-3029 FAX: (704) 367-1333

REVISIONS: REVISION 1: REVISION 2: REVISION 3:


SHEET DESCRIPTION:

FIELD CONNECTIONS TO TERMINAL BLOCKS

PROJECT OVERVIEW:

PROJECT NAME: HARDEE'S PROJECT CITY: BATESBURG-LEESVILLE, SC

CPI PROJECT INFORMATION: CPI PROJECT #: 21525A DATE: 4/10/17 DRAWN BY: FEA SHEET: 1.1



HARDEE'S TAKE PROTOTYPE BATESBURG-LEESVILLE, SOUTH CAROLINA 29064


REVISIONS table with columns for NO., DATE, DESCRIPTION

MECHANICAL CONTROLS table with columns for DRAWN BY, CHECKED BY, IMPROVED BY

CKE SITE ID: DATE: 2-28-17


SHEET NUMBER: M5

- NOTES: 1. TO MICROSWITCH IN ANSUL FOR CHAIN BROILER HOOD... 2. TO MICROSWITCH IN ANSUL FOR OVEN HOOD... 3. TO MICROSWITCH IN ANSUL FOR FLAT GRILLE HOOD... 4. TO MICROSWITCH IN ANSUL FOR FRENCH FRYER HOOD... 5. TO DRY CONTACT IN KITCHEN RTU... 6. TO DRY CONTACT IN SALES RTU... 7. TO DRY CONTACT IN DINING RTU...

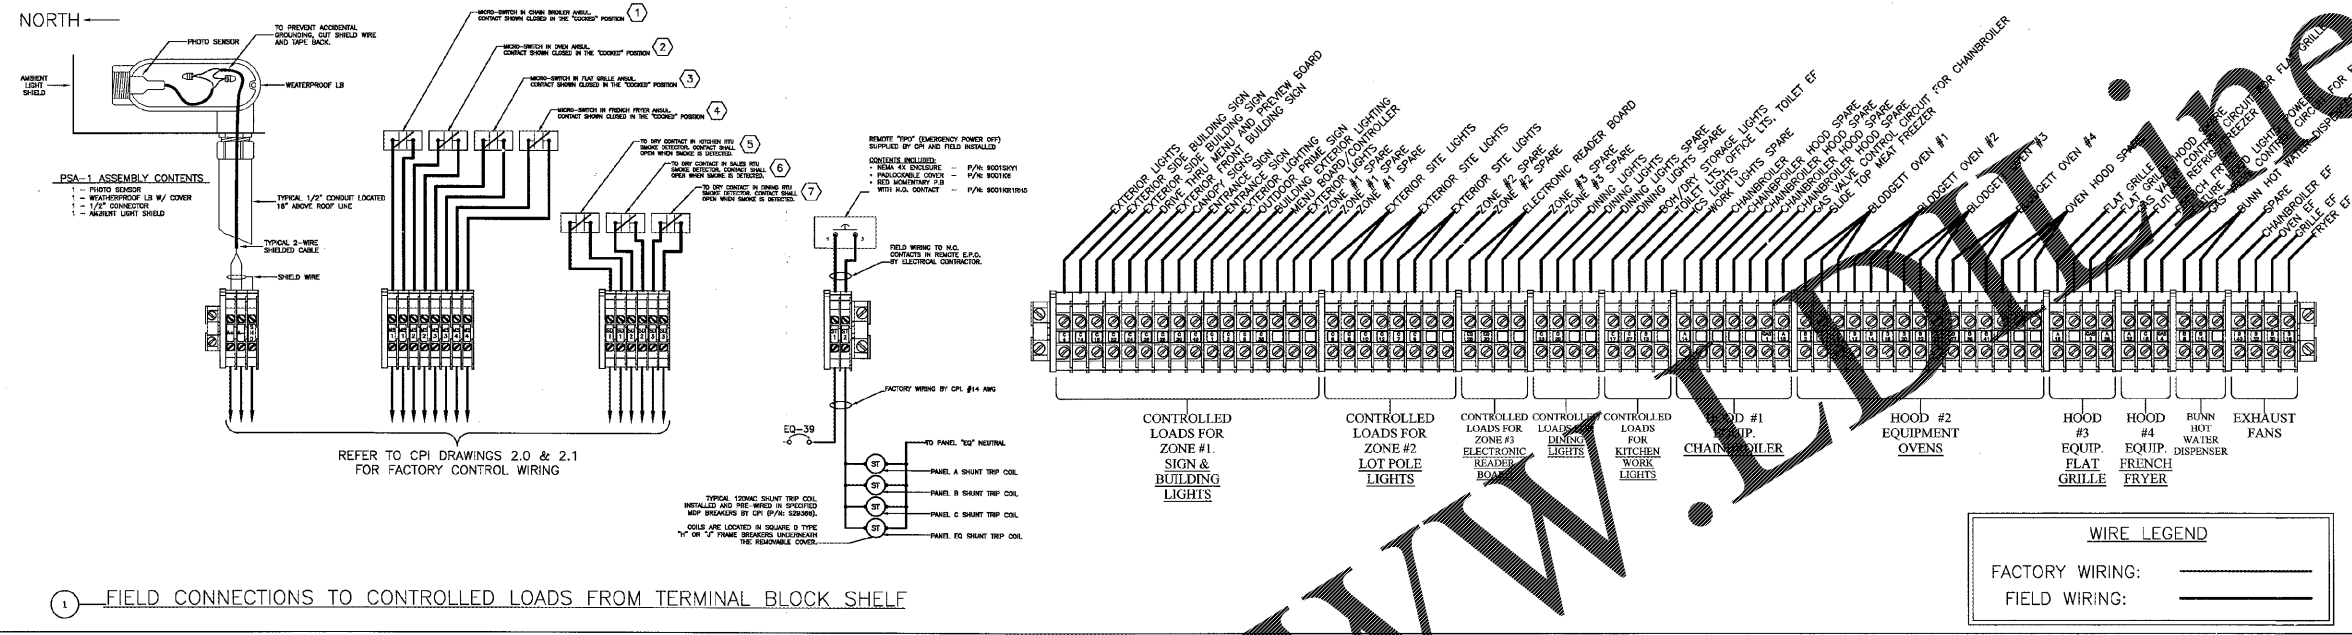


1 FIELD CONNECTIONS TO CONTROLLED LOADS FROM TERMINAL BLOCK SHELF

CPI-TERMINAL BLOCK LABELING table with columns for TERMINAL NAME and DESTINATION AT RTU

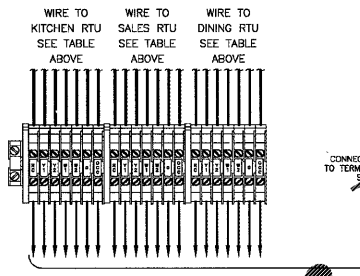


2 FIELD CONNECTIONS TO TERMINAL BLOCKS

IMPORTANT SENSOR WIRING NOTE: ALL SENSOR WIRING SHALL BE SHIELDED TWISTED PAIR (STP) 22 AWG MINIMUM AND HAVE A VOLTAGE RATING GREATER THAN OR EQUAL TO THE RATING OF THIS SWITCHGEAR SECTION.

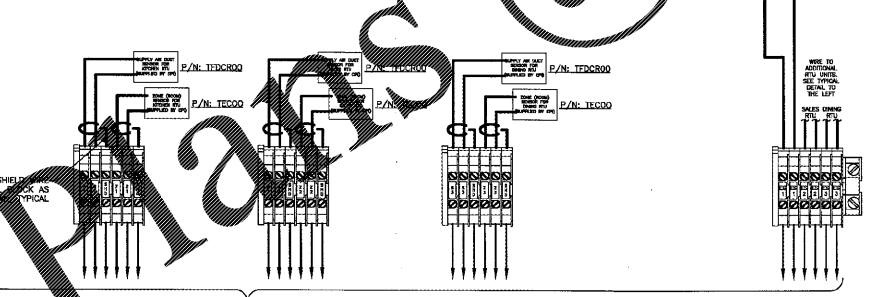

SPECIAL FIELD NOTE: THIS SHEET'S DETAIL IS SPECIFIC TO A YORK... FIELD WIRING CONNECTIONS AND TERMINALS IF OTHER... ARE USED.

VERY IMPORTANT NOTE: THE PUMP DOWN DETAIL SHOWN DEPICTS A COOLER/FREEZER WITH AN ELECTRONIC CONTROL BOARD... IF A MECHANICAL CONTROL SYSTEM IS USED, THE WIRING MAY NEED TO TERMINATE ON THE COMMON AND NORMALLY CLOSED CPI TERMINAL BLOCKS...

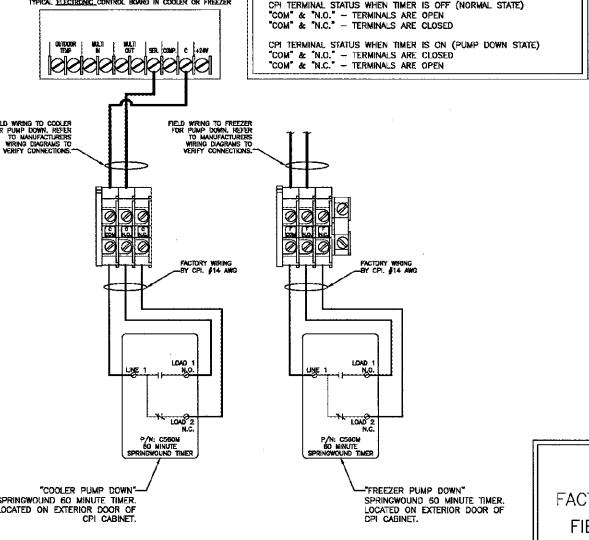

WIRE LEGEND: FACTORY WIRING: FIELD WIRING:

Order Plans @