


Architectural
DESIGNERS
 ARCHITECTS & ENGINEERS
 2200 CARROLLWOOD MILL RD. SUITE 100
 MEADOWSVILLE, NORTH CAROLINA 27040
 PH: 919 558 7250 FAX: 919 584 9289
 A Division of L&H Associates



StarHendees
 CHARBROILERS & EQUIPMENT
 HARDEE'S T24KE PROTOTYPE
 143 CHURCH STREET
 BATESBURG/LEESVILLE, SOUTH CAROLINA 29024

NO.	REVISIONS DESCRIPTION	DATE

DRAWN BY: _____ CHECKED BY: _____ APPROVED BY: _____
--

CHEK SITE ID: _____

DATE: 2-28-17

SHEET NUMBER: **H4**

REVISIONS	
DESCRIPTION	DATE

CAPTIVE

National Accounts
 417 North St. Logansport, IN 46847 PHONE: (855) 534-4822 FAX: (974) 722-7213 EMAIL: dan@captivair.com

HARDEE'S T31-MT 4F BATESBURG/LEESVILLE SC
 BATESBURG/LEESVILLE, SC,

DATE: 2/24/2017


DWG.#: 2933344

DRAWN BY: RDR

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 4

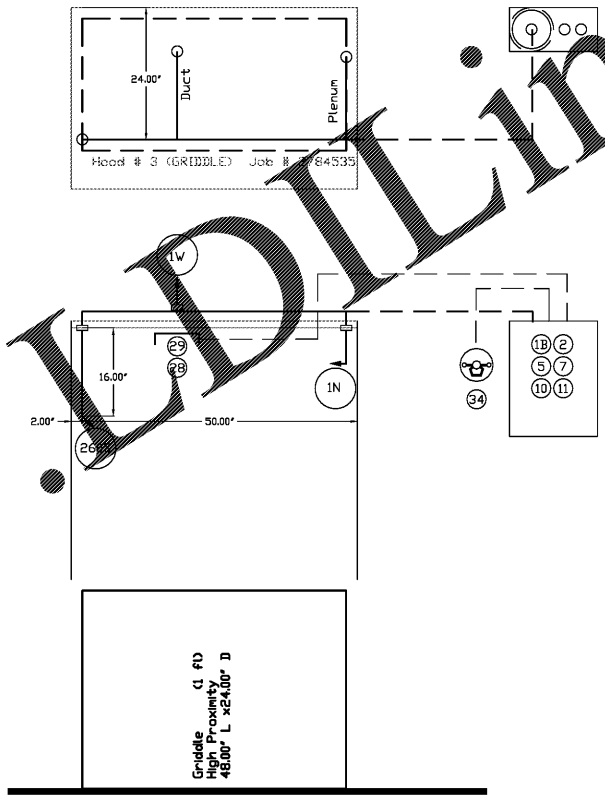


- NOTES**
- FIELD PIPE DROPS AS SHOWN
 - SLEEVING, ELBOWS, TEES, AND NOZZLES SUPPLIED BY CAS
 - RELOCATE NOZZLES IF FLOW PATTERN IS BLOCKED BY SHELVING, SALAMANDERS, ETC.
 - MAXIMUM 9 ELBOWS IN SUPPLY LINE.
 - MINIMUM 72 INCHES OF AGENT LINE FROM TANK TO FIRST NOZZLE.
 - IF APPLICABLE, PRE-PIPED CHARBROILER DROPS ARE SHIPPED LOOSE.
 - FACTORY PIPING EXTENDS A MAXIMUM OF 6" ABOVE THE TOP OF THE HOOD.
 - APPLIANCE DIMENSIONS LISTED REPRESENT THE COOKING SURFACE SIZE, NOT THE OVERALL APPLIANCE SIZE.
 - THIS FIRE SYSTEM COMPLIES WITH U.L. 300 REQUIREMENTS

Drawn By:
 System Size: ANSUL-3.0 Total FP required: 4
 Hood # 3 4' 4.00' Long x 33' Wide x 47' High
 Riser # 1 Size: 8" Dia.
 Hood # 3 Metal Blow-Off Caps included.

LEGEND - FIRE CABINET ANSUL SYSTEM

- 1A 1.5 GALLON TANK
- 1B 3 GALLON TANK
- 2 DEM AUTOMAN RELEASE
- 3 DEM REGULATED RELEASE
- 4 DEM REGULATED ACTUATOR
- 5 ANSULEX LIQUID AGENT (3 GAL.)
- 6 ANSULEX LIQUID AGENT (1.5 GAL.)
- 7 CARTRIDGE (101-20)
- 8 CARTRIDGE (101-10)
- 9 CARTRIDGE (101-30)
- 9A CARTRIDGE (LT-A-101-30)
- 9B DOUBLE TANK CARTRIDGE
- 10 TEST LINK
- 11 DOUBLE MICROSWITCH
- 12 HOSE ASSEMBLY
- 1100 DUCT NOZZLE (430913)
- 2W DUCT NOZZLE (419337)
- 1W NOZZLE ASSEMBLY (419336)
- 1F NOZZLE ASSEMBLY (419333)
- 1N NOZZLE ASSEMBLY (419335)
- 1/2N NOZZLE ASSEMBLY (419334)
- 3N NOZZLE ASSEMBLY (419338)
- 245 NOZZLE ASSEMBLY (419340)
- 230 NOZZLE ASSEMBLY (419339)
- 2120 NOZZLE ASSEMBLY (419342)
- 290 NOZZLE ASSEMBLY (419342)
- 260 NOZZLE ASSEMBLY (419341)
- 28 DETECTOR BRACKET
- 29 LOW TEMP FUSIBLE LINK
- 30 HIGH TEMP FUSIBLE LINK
- MGV MECHANICAL GAS VALVE
- EGV ELECTRICAL GAS VALVE
- 34 REMOTE MANUAL PULL STATION
- S SWIVEL ADAPTER

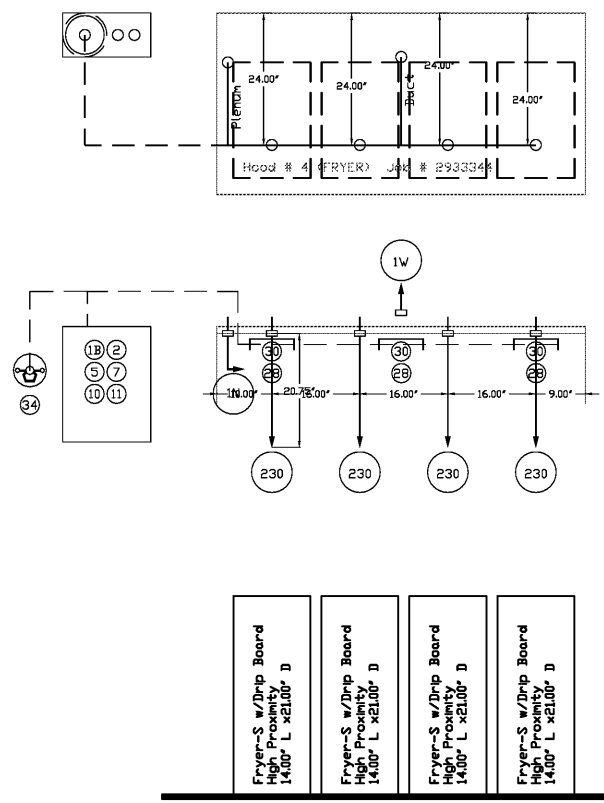

- NOTES**
- FIELD PIPE DROPS AS SHOWN
 - SLEEVING, ELBOWS, TEES, AND NOZZLES SUPPLIED BY CAS
 - RELOCATE NOZZLES IF FLOW PATTERN IS BLOCKED BY SHELVING, SALAMANDERS, ETC.
 - MAXIMUM 9 ELBOWS IN SUPPLY LINE.
 - MINIMUM 72 INCHES OF AGENT LINE FROM TANK TO FIRST NOZZLE.
 - IF APPLICABLE, PRE-PIPED CHARBROILER DROPS ARE SHIPPED LOOSE.
 - FACTORY PIPING EXTENDS A MAXIMUM OF 6" ABOVE THE TOP OF THE HOOD.
 - APPLIANCE DIMENSIONS LISTED REPRESENT THE COOKING SURFACE SIZE, NOT THE OVERALL APPLIANCE SIZE.
 - THIS FIRE SYSTEM COMPLIES WITH U.L. 300 REQUIREMENTS

Job #: 2933344
 Job Name: HARDEE'S T31-MT 4F BATESBURG/LEESVILLE SC
 Drawn By: RDR
 System Size: ANSUL-3.0 Total FP required: 10
 Hood # 4 4' 7.00' Long x 33' Wide x 47' High
 Riser # 1 Size: 8" Dia.
 Hood # 4 Metal Blow-Off Caps included.

THIS DRAWING IS PROVIDED FOR REFERENCE ONLY. HOOD CONTRACTOR SHALL SELECT AND CERTIFY ALL EXHAUST/M.U. AIR FANS. ALL SYSTEMS SHALL MEET ALL APPLICABLE REQUIREMENTS OF STATE AND LOCAL CODES AND OTHER REQUIREMENTS AS SHOWN IN DESIGN DRAWINGS.

Order Plans @ www.LDLine.com