

SYSTEM COMMISSIONING:
 DOCUMENTS CERTIFYING THAT THE INSTALLED LIGHTING CONTROLS MEET DOCUMENTED PERFORMANCE CRITERIA OF SECTION C405 ARE TO BE PROVIDED TO THE BUILDING OWNER WITHIN 90 DAYS FROM THE DATE OF RECEIPT OF THE CERTIFICATE OF OCCUPANCY, PER IECC 2015 CHAPTER 4.
 FUNCTIONAL TESTING SHALL BE PERFORMED (WHERE APPLICABLE) PER SECTIONS C408.3.1 OCCUPANT SENSOR CONTROLS, C408.3.2 TIME-SWITCH CONTROLS, AND C408.3.13 DAYLIGHT RESPONSIVE CONTROLS.
 FULL REPORT OF TESTING SHALL BE PROVIDED TO REGISTERED DESIGN PROFESSIONAL AT TIME OF COMPLETION.

AUDIO/VIDEO			
EQUIPMENT	MANUFACTURER MODEL NO.	VOLTS/PH/Hz	NOTES
AM/FM RECEIVER	SONY ST RDH100	120/1/60	4
SPEAKERS	YAMAHA NS-AW50	120/1/60	145
TV	LG 43" LED TV L340C	120/1/60	2,3,4,6
DVD PLAYER	SONY DVP8R500H	120/1/60	4

NOTES:
 1. UNIT SHALL BE TWO-WAY 70 WATT SPEAKER, MOUNT ON WALL TIGHT TO CEILING.
 2. UNIT SHALL BE SUSPENDED FROM STRUCTURE ABOVE BY GENERAL CONTRACTOR.
 3. TV BRACKET REFER TO DETAIL ON SHEET A11.
 4. TO BE PROVIDED BY OWNER AND INSTALLED BY GENERAL CONTRACTOR.
 5. GC TO PROVIDE SPEAKER CABLE.
 6. SPLITTER AND CABLES FOR TV INSTALLATION PROVIDED BY OWNER.

NOTE
 CONTRACTORS SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING THEIR BID. ANY CHANGES REQUIRED DUE TO INCORRECT EXISTING INFORMATION WILL BE THE CONTRACTORS RESPONSIBILITY.
 ALL EQUIPMENT SHALL BE UNDERWRITER'S LABORATORIES, INC. LABELS (UL) LISTED.
 NO COMBUSTIBLE MATERIALS SHALL BE INSTALLED IN THE CEILING FLENUM. ALL EQUIPMENT AND MATERIALS INSTALLED IN THE FLENUM CEILING AREAS SHALL BE APPROVED FOR THE PURPOSE BY UL AND THE APPLICABLE CODE AUTHORITY.
 NO CONDUITS SHALL BE INSTALLED IN THE FLOOR SLAB. SAW CUTTING THE SECOND LEVEL FLOOR SLAB IS PROHIBITED. ONLY CORE-DRILLING IS PERMITTED WITH THE PERMISSION OF THE LANDLORD. CONDUIT ON THE FIRST LEVEL SLAB SHALL BE ROUTED UNDERGROUND AND NOT IN THE SLAB.
 PROVIDE ALL TEMPORARY WIRING AS REQUIRED WITHIN THE PREMISES. PROVIDE ALL REQUIRED SERVICES, PANELED DISCONNECT MEANS, TRANSFORMERS AND OVERCURRENT PROTECTION (OCP) AREA, OUTLET PANELS, ETC. SHALL NOT BE USED FOR PERMANENT WIRING. PROVIDE TEMPORARY WIRING WITH GROUND FAULT PROTECTION AS REQUIRED BY CODE AND LOCAL JURISDICTIONAL AUTHORITY.

KEYED NOTES


- DEDICATED QUADRI-PLEX RECEPTACLE FOR CASH REGISTER MOUNT BELOW DRAUER.
- J-BOXES WITH 1/4" CONDUIT AND FULLSTRING STUBBED ABOVE CEILING FOR SPEAKER WIRES AND TV CABLES.
- J-BOX MOUNTED ON CEILING FOR TV CABLES. LOCATE BEHIND TV RE: ARCHITECTURAL ELEVATIONS.
- DUPLEX RECEPTACLE - CENTERLINE HEIGHT TO BE 48" OR PER CODE.
- RUN PHONE LINE IN 1/2" EMT CONDUIT. PHONE LINE SHALL TERMINATE AT TELEPHONE MOUNTING BOARD SEE NOTE 6.
- PROVIDE 1-1/2" EMT CONDUIT FROM ABOVE CEILING TO BELOW COUNTER TERMINATE IN 1/2" METAL BOX. RUN FLOOR CONDUIT IN 1/2" LEAD FLEXIBLE CONDUIT INSIDE OF 1-1/2" EMT CONDUIT TO SEPARATE FROM PHONE AND DATA LINES.
- DATA LINE IN 1-1/2" EMT CONDUIT. PHONE LINES SHALL TERMINATE AT TELEPHONE MOUNTING BOARD SEE NOTE 6.
- RUN CONDUIT IN CABINET. VERIFY EXACT REQUIREMENTS.
- ELECTRICIAN TO CONNECT J-BOXES FOR OWNER FURNISHED LIGHTING IN CABINETRY.
- WALL PLATE TO BE A LEVITON MODEL #80703 (BLACK). RECEPTACLE TO BE A LEVITON MODEL #BR20-3.
- WALL PLATE TO BE A LEVITON MODEL #82003 (ALMOND). RECEPTACLE TO BE A LEVITON MODEL #BR20-A.
- NEW WALL SENSOR TO BE LOCATED BY MECHANICAL CONTRACTOR ENSURE THAT WALL SENSOR IS NOT LOCATED NEAR NIGHT LIGHTS. ELECTRICAL CONTRACTOR SHALL PROVIDE J-BOX AND FULLSTRING TO ABOVE CEILING.
- TELEPHONE BOARD: 2'X4'X3/4" PLYWOOD, MOUNTED VERTICALLY BETWEEN 3'-0" & 7'-0" AFF. WITH (1) #6 CU GROUND FOR FUTURE USE MOUNTED ABOVE 2'X4'X3/4" PLYWOOD WITH (1) #6 CU GROUND PER TELE. CO. REQUIREMENTS.
- DUPLEX RECEPTACLE - CENTERLINE HEIGHT TO BE 48" RE: ARCH. ELEVATIONS FOR EXACT LOCATION AND ORIENTATION.

ADA NOTE
 LIGHT SWITCHES, ELECTRICAL OUTLETS, AND OTHER ENVIRONMENTAL CONTROLS SHALL HAVE OPERABLE PARTS TO THE CONTROLS LOCATED NO HIGHER THAN 48" AND NO LOWER THAN 15".


FIRE ALARM NOTE
 PROVIDE ALL FIRE ALARM DEVICES IN TENANT SPACE AS LOCAL CODE REQUIRES. FIELD VERIFY EXISTING CONDITIONS AND REUSE EXISTING EQUIPMENT IF ABLE. TIE TENANT'S SYSTEM INTO LANDLORD'S SYSTEM WHEN APPLICABLE. ENSURE TENANT'S SYSTEM IS COMPATIBLE WITH LANDLORD'S SYSTEM PRIOR TO INSTALLATION. VERIFY FINAL CONNECTION REQUIREMENTS WITH LANDLORD.
 IF REQUIRED DUCT SMOKE DETECTOR IS INSTALLED BY THE MECHANICAL CONTRACTOR AND CONNECTED TO THE FIRE ALARM PANEL BY THE ELECTRICAL CONTRACTOR REF TO MECHANICAL DRAWINGS FOR MORE INFORMATION.

GENERAL CONTRACTOR SHALL INSTALL SOUND SYSTEM, INCLUDING ALL AV CABLING.

- SOUND SYSTEM NOTES:**
- VERIFY MOUNTING LOCATION OF TV SETS WITH ARCHITECTURAL DRAWINGS.
 - DVD PLAYER/AMPLIFIER TO BE LOCATED IN STOCKROOM.
 - VERIFY LOCATION OF ALL SPEAKERS AND TV OUTLETS WITH OWNERS REPRESENTATIVE.
 - SPEAKER CABLE TO BE RADIO SHACK MEGA CABLE #718-1213

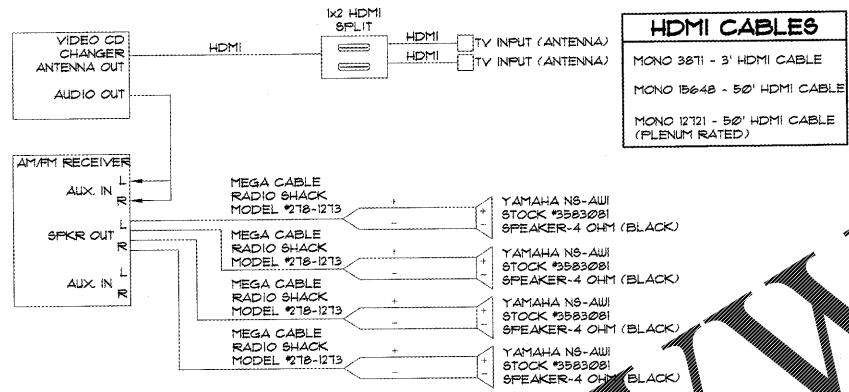

2 SOUND SYSTEM WIRING DIAGRAM
 1/4" = 1'-0"

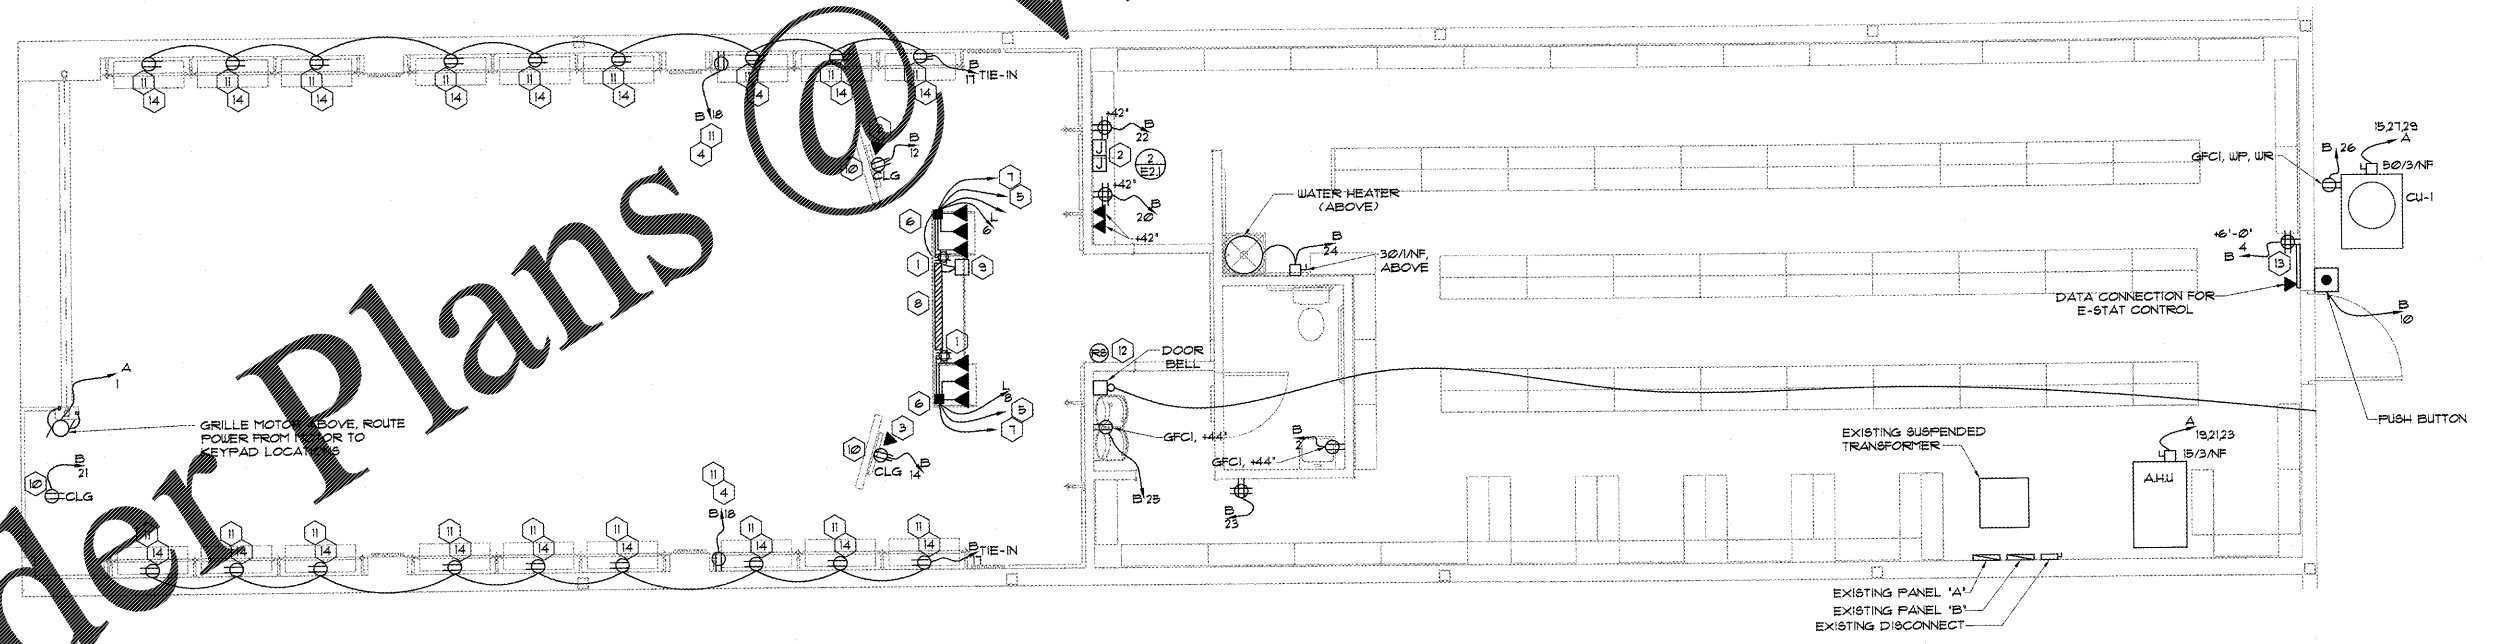

1 POWER PLAN
 1/4" = 1'-0"

Architect:
 Kevin L. Cooper Architect
 316 South 1st Street
 Rogers, AR 72756
 (479) 633-8181 fax (479) 633-9204

Engineer/Other:
 JOHN D. PERQUIS
 LICENSE No. 67173
 STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 9/2/17

CORE STATES GROUP
 1700 Industrial Dr.
 Rogers, AR 72756
 Phone (479) 986-4400
 Fax (479) 986-4401

Owner:
 GENESCO
 GENESCO CONSTRUCTION DIVISION
 GENESCO PARK, SUITE 604
 P.O. BOX 731
 NASHVILLE, TENNESSEE 37202-0731
 615-367-7003 FAX: 615-367-7845

Project:
 JOURNEYS

SPACE # 1540
 WESTLAND MALL
 HIALEAH, FLORIDA

Sheet Contents:
 POWER PLAN

Drawing Data:
 Drawn By: MRS
 Checked By: ASW
 Revisions:

Date: 09/08/2017

E2.1
 Copyright © 2017

Order Plans

WWW.LDLINE.COM