


© copyright 2017, CSM ARCHITECTS, INC. THESE DIMENSIONS / FEET AS INSTRUMENTS OF SERVICE, AND SHALL REMAIN THE SOLE PROPERTY OF THE ARCHITECT. THEY ARE NOT TO BE REPRODUCED IN ANY FORM WITHOUT WRITTEN CONSENT OF THE ARCHITECT.

PROJECTS: 1904-SD\A210.dwg  
21 SEP 2017 10:04:54 AM  
Bt: mgriffin

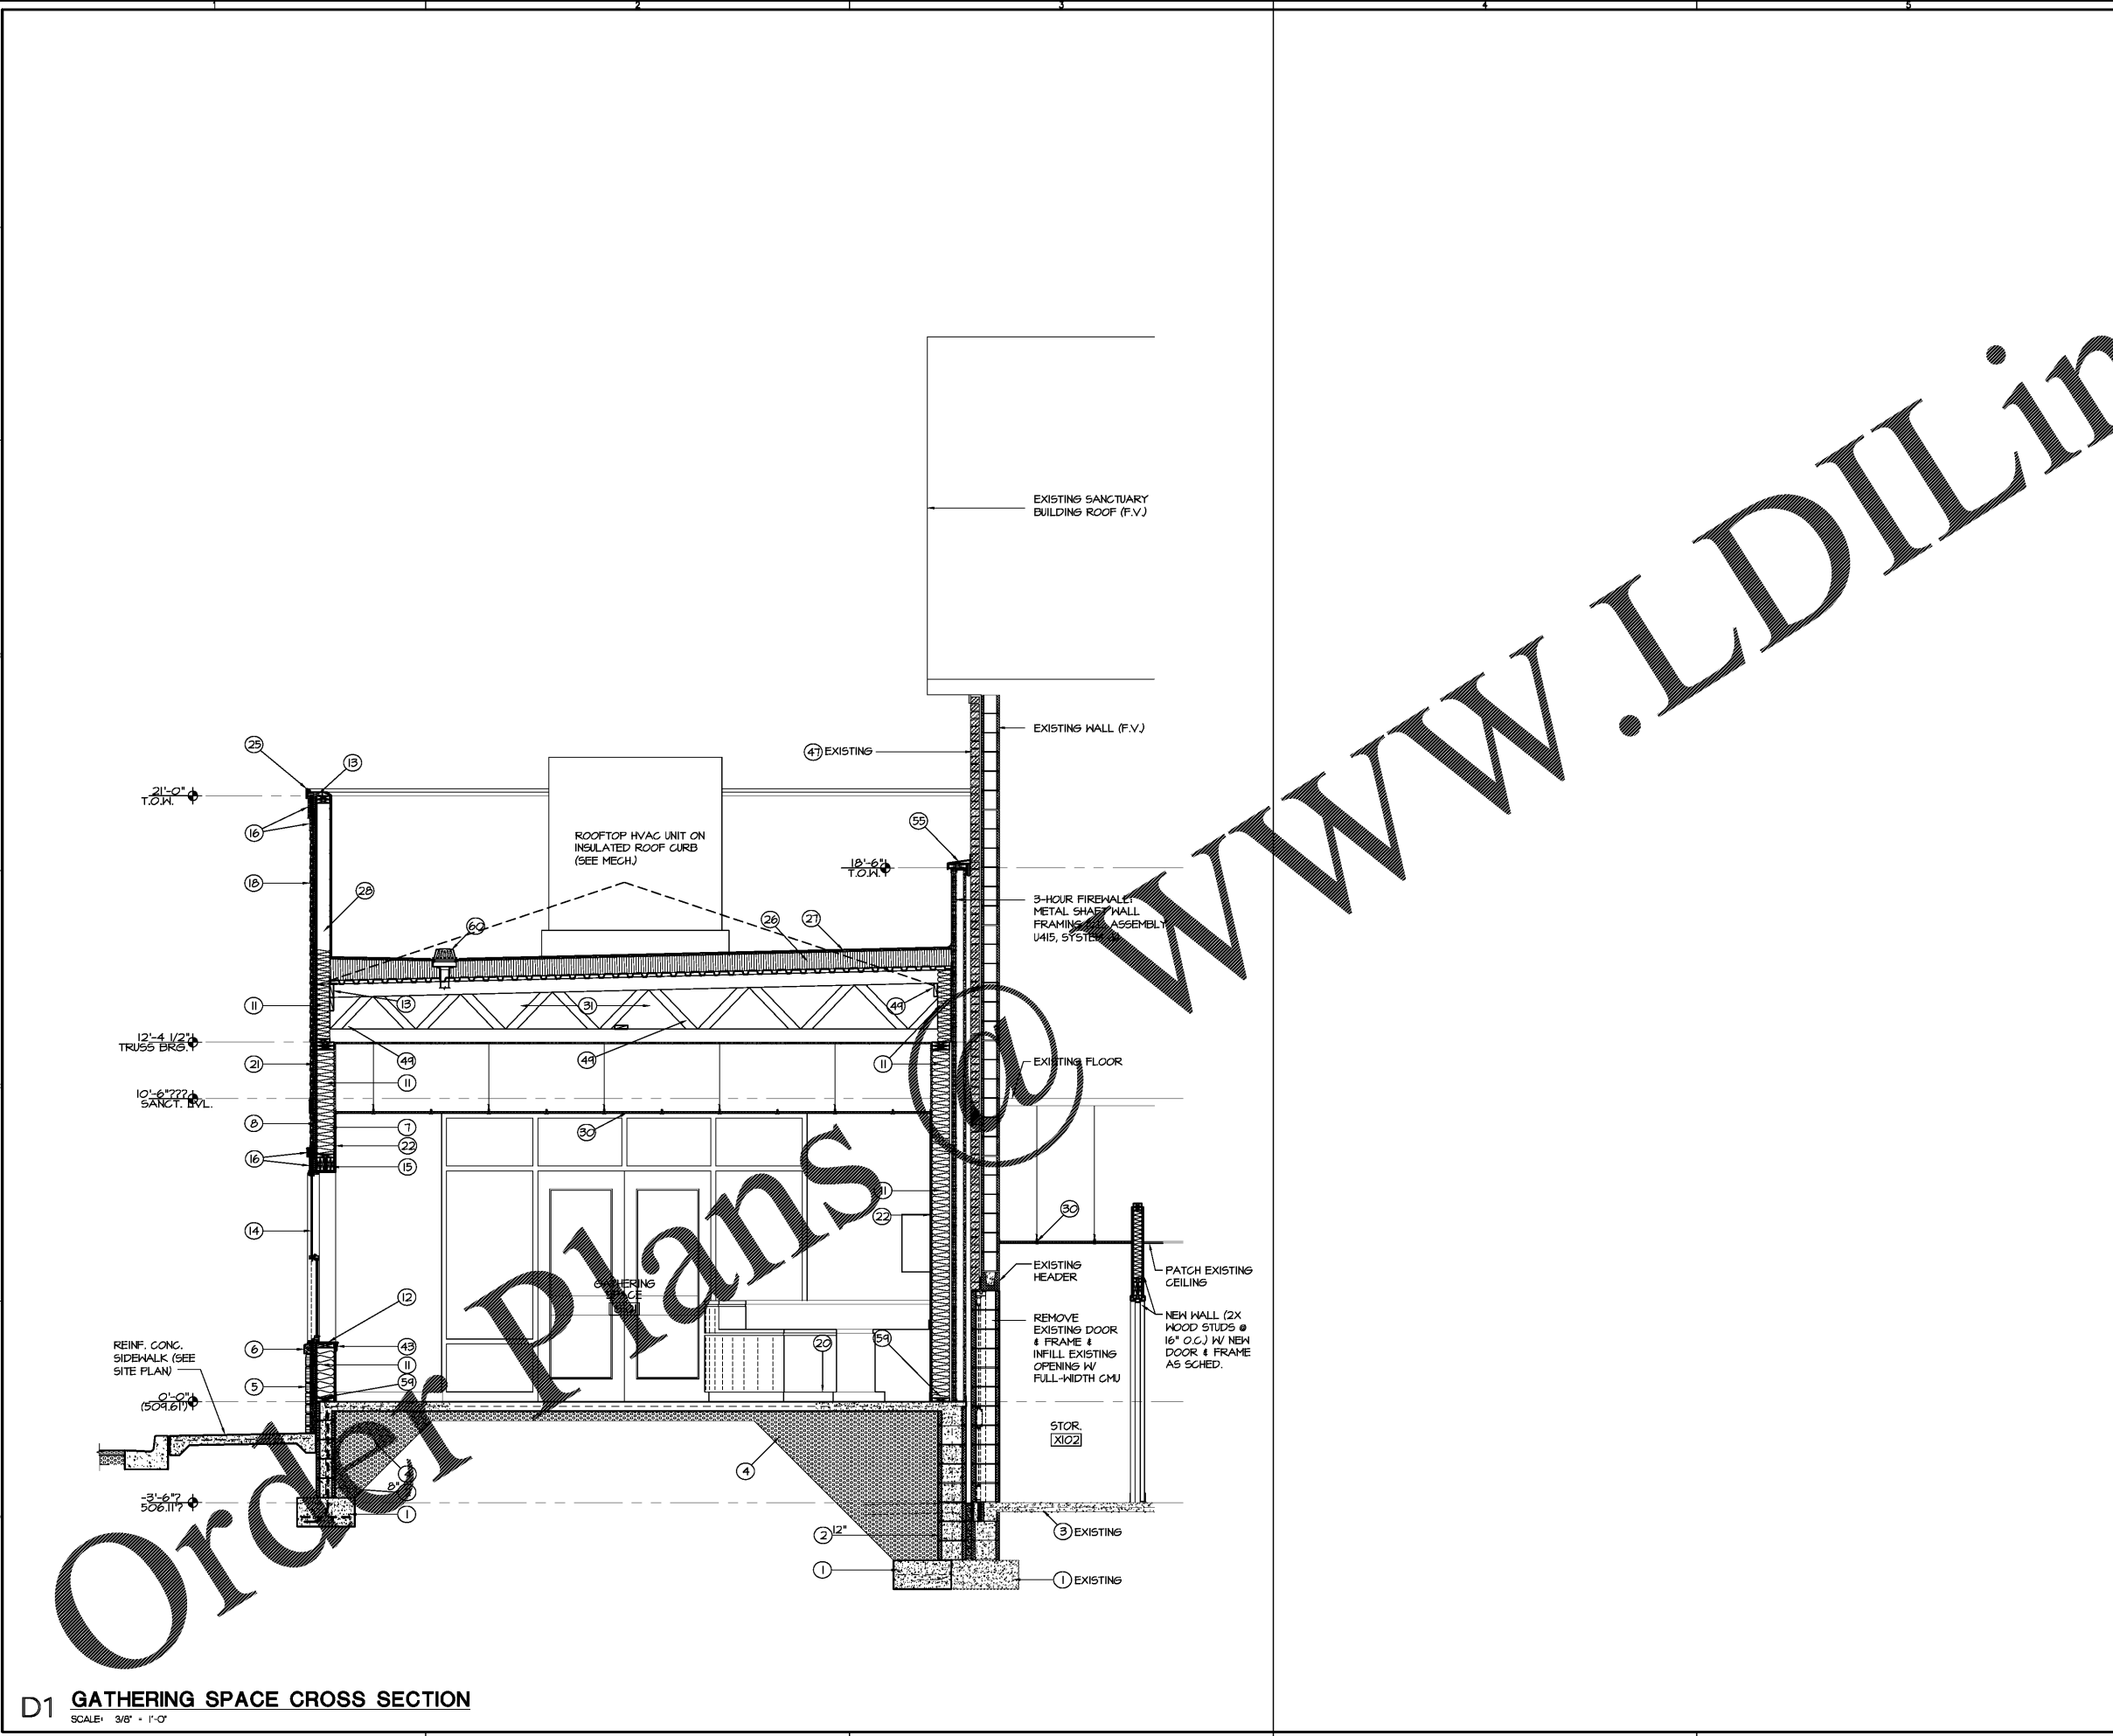

- ### SECTION KEYNOTES
- ① REINFORCED CONCRETE FOOTING (SEE STRUCT.)
  - ② REINFORCED CMU FOOTING WALL
  - ③ REINFORCED CONCRETE SLAB ON VAPOR BARRIER
  - ④ COMPACTED GRANULAR FILL ON FILTER FABRIC
  - ⑤ MANUFACTURED STONE VENEER ON GALVANIZED METAL LATH WITH RAIN SCREEN ON TWO LAYERS OF 30# FELT (BALUST)
  - ⑥ CAST STONE WATER TABLE WITH FLASHPANEL INTEGRAL DRIP EDGE
  - ⑦ 2x6 P.T. HOOD FRAMING @ 16" O.C.
  - ⑧ 1" EXTERIOR STRUCTURAL PLYWOOD SHEATHING ON FACE OF HOOD FRAMING (SEE STRUCT.)
  - ④ 5/8" EXTERIOR GYPSUM SHEATHING
  - ⑩ GALVANIZED METAL SCREED
  - ⑪ FIBERGLASS BATT INSULATION
  - ⑫ FINISHED HOOD SILL
  - ⑬ P.T. HOOD NAILER
  - ⑭ WINDOW AS SCHEDULED (PRICE AS COMMERCIAL SINGLE-HUNG VINT WINDOW W/ INSECT SCREEN)
  - ⑮ BRICK FRAMING HEADER
  - ⑯ FIBER CEMENT TRIM
  - ⑰ STARTER FLASHING
  - ⑱ FIBER CEMENT CLADDING
  - ⑲ STEEL BEAM (SEE STRUCT.)
  - ⑳ BASE AS SCHEDULED
  - ㉑ 1" POLYISOCYANURATE RIGID INSULATION BOARD W/ VAPOR-PERMEABLE BUILDING WRAP ON FACE OF INSULATION
  - ㉒ 5/8" INTERIOR GYPSUM BOARD (FIRE-RATED ON UNDERSIDE OF ROOF/FLOOR FRAMING)
  - ㉓ GALVANIZED STEEL ANGLE (SEE STRUCT.)
  - ㉔ PREFIN. ALUM. STARTER FLASHING W/ P.T. HOOD STARTER STRIP
  - ㉕ PREFINISHED ALUMINUM SNAP-ON FASCIA TRIM
  - ㉖ POLY ISO. ROOF INSULATION ON GALVANIZED METAL DECKING (SEE STRUCT.)
  - ㉗ FULLY-ADHERED ROOF MEMBRANE ON 1/2" GYPSUM COVER BOARD
  - ㉘ PREFINISHED THRU-WALL SCUFFER
  - ㉙ PREFINISHED ALUMINUM DOWNEPOUT
  - ㉚ LAY-IN CEILING AS SCHEDULED
  - ㉛ PREFABRICATED WOOD TRUSS @ 24" O.C. (SEE STRUCT.)
  - ㉜ 2X WOOD FLOOR JOISTS @ 16" O.C. (SEE STRUCT.)
  - ㉝ ARCHITECTURAL WOODWORK (PLASTIC LAMINATED ON PARTICLE BOARD SUBSTRATE EXCEPT @ NET CONDITIONS WHERE WATER-RESISTANT MDF TO BE PROVIDED)
  - ㉞ ATTIC BAFFLES ANCHORED TO ADJACENT TRUSSES/FRAMING
  - ㉟ GUARD RAIL
  - ⓫ HAND RAIL
  - ⓬ PREFIN. ALUM. GUTTER
  - ⓭ PREFAB. RIDGE VENT ASSEMBLY; LEAVE 2" GAP, MIN. IN ROOF DECKING AT ROOF RIDGE
  - ⓮ ALUMINUM THRESHOLD AS SCHEDULED
  - ⓯ ISOLATION JOINT W/ SEALANT
  - ⓰ 1 1/2" Ø HANDRAIL ON WALL BRACKETS @ 5'-0", MAX.
  - ⓱ 3/4" T&G PLYWOOD DECKING SCREWED & GLUED TO FRAMING
  - ⓲ WOOD TRIM APRON (PAINTED)
  - ⓳ SEAL EDGE/PERIMETER
  - ⓴ P.T. WOOD SUB-FASCIA
  - ⓵ LVL BEAM (SEE STRUCT.)
  - ⓶ BRICK VENEER
  - ⓷ THRU-WALL FLASHING
  - ⓸ CONTINUOUS LATERAL BRACING (SEE STRUCT.)
  - ⓹ BOLLARD AS SCHEDULED
  - ⓺ 1" STRUCTURAL INSULATED SHEATHING
  - ⓻ ARCHITECTURAL ASPHALT SHINGLES ON ROOF UNDERLAYMENT ON T&G P.T. ROOF DECKING
  - ⓼ DOOR AND FRAME AS SCHEDULED
  - ⓽ PREFINISHED ALUMINUM DRIP EDGE
  - ⓾ PARAPET GAP W/ INTEGRAL FIRE BARRIER & EXPANSION JOINT
  - ⓿ SELF ADHERED UNDERLAYMENT
  - ⓿ FIBER CEMENT SOFFIT PANELS SECURED TO FRAMING (VENTED)
  - ⓿ F.R. WOOD BLOCKING / NAILERS ANCHORED IN PLACE
  - ⓿ ANCHOR SILL PLATE TO CONCRETE SLAB W/ "J" BOLTS @ 32" O.C. MAX. (SEE STRUCT.)
  - ⓿ ROOF DRAIN ASSEMBLY
  - ⓿ CMU AS SCHEDULED
  - ⓿ FOOTING DRAIN (PERFORATED HDPE PIPE (IN FILTER SOCK); CONNECT TO STORM PIPING)
  - ⓿ WOOD LVL FLOOR JOIST @ 12" O.C. (SEE STRUCT.)
  - ⓿ FOAM INSULATION
  - ⓿ REINFORCED CMU BOND BEAM/INTEL (SEE STRUCT.)
  - ⓿ 3/8" GYP. BD. ON 1/2" MTL. FURRING CHANNEL @ 16" O.C.

D1 GATHERING SPACE CROSS SECTION  
SCALE: 3/8" = 1'-0"

SCHEMATIC DESIGN - FOR PRICING ONLY - Not for Construction

Corley Timothy Sweeney McCormac  
ARCHITECTS, INC.  
THREE RIVERCHASE OFFICE PLAZA / SUITE 124 / HOOPER, ALABAMA 35244  
T 205.443.3790 W ctsmarchitects.com

GATHERING SPACE CROSS SECTION

09-29-17 1904 ALABAMA

FIRST BAPTIST CHURCH  
CHILDREN'S ADDITION  
HAYDEN.

REVISED:

A214