


KEYNOTES

- 1 INSTALL A SINGLE EMERGENCY POWER CUTOFF CONTROL TO REMOVE AC POWER FROM SITE DISPENSING EQUIPMENT. (THE CONTROL IS AN ADDITION SAFETY FEATURE AND NOT A SUBSTITUTE FOR NEC/NFPA30 CIRCUIT BREAKER REQUIREMENTS.)
 - * LABEL THE EMERGENCY POWER CUTOFF SWITCH AND INSTRUCT OWNER TO KEEP AREA CLEAR OF OBSTACLES.
- 2 CONNECT INSULATED GROUNDING CONDUCTOR FROM THE DISPENSER POWER PANEL TO THE SITE GROUNDING ELECTRODE. SIZE PER NEC.
- 3 INSTALL POWER BREAKERS TO EACH CIRCUIT LEADING TO THE DISPENSING UNIT AND STP. THEY MUST BE CAPABLE OF SIMULTANEOUSLY DISCONNECTING HOT AND NEUTRAL CONDUCTORS.
- 4 REFER TO INSTALLATION ADDENDA FOR SPECIFIC PRODUCT FIELD WIRING CONNECTIONS. CAP ALL UNUSED WIRES. LOCAL AND NEC MAY APPLY.
- 5 INSTALL CONDUIT PER NEC FOR HAZARDOUS LOCATIONS.
- 6 WIRES - ALL WIRES ARE 12AWG (STANDARD) UNLESS OTHERWISE NOTED. PUMP / DISP. GROUND - WIRE IS 12 AWG (STANDARD).

POWER LOADING AND DISTANCE RUN MAY REQUIRE LARGER WIRE SIZE.
- 7 NOT USED
- 8 STP ISOLATION RELAY BOXES ARE MANDATED BY THE NEC (ARTICLE 514.13 - PROVISIONS FOR MAINTENANCE AND SERVICE OF DISPENSING EQUIPMENT) AND ARE REQUIRED TO:
 - A. ALLOW SERVICE OF ONE UNIT SAFELY WITHOUT REMOVING POWER FROM ALL DISPENSING EQUIPMENT.
 - B. PREVENT DAMAGE TO EQUIPMENT FROM CROSS-PHASING. DAMAGE CAUSED BY CROSS-PHASING IS NOT COVERED BY WARRANTY.
- 9 GILBARCO STP ISOLATION BOX PA0287 IS NOT AVAILABLE FOR 220/230/240VAC UNITS. (THIS IS AN OWNER SUPPLIED ITEM.)
- 10 FOR STPs GREATER THAN 1-1/2HP (SINGLE OR THREE PHASE) CONNECT TO MOTOR CONTACTOR COIL OF SEPARATE STP RELAY BOX.

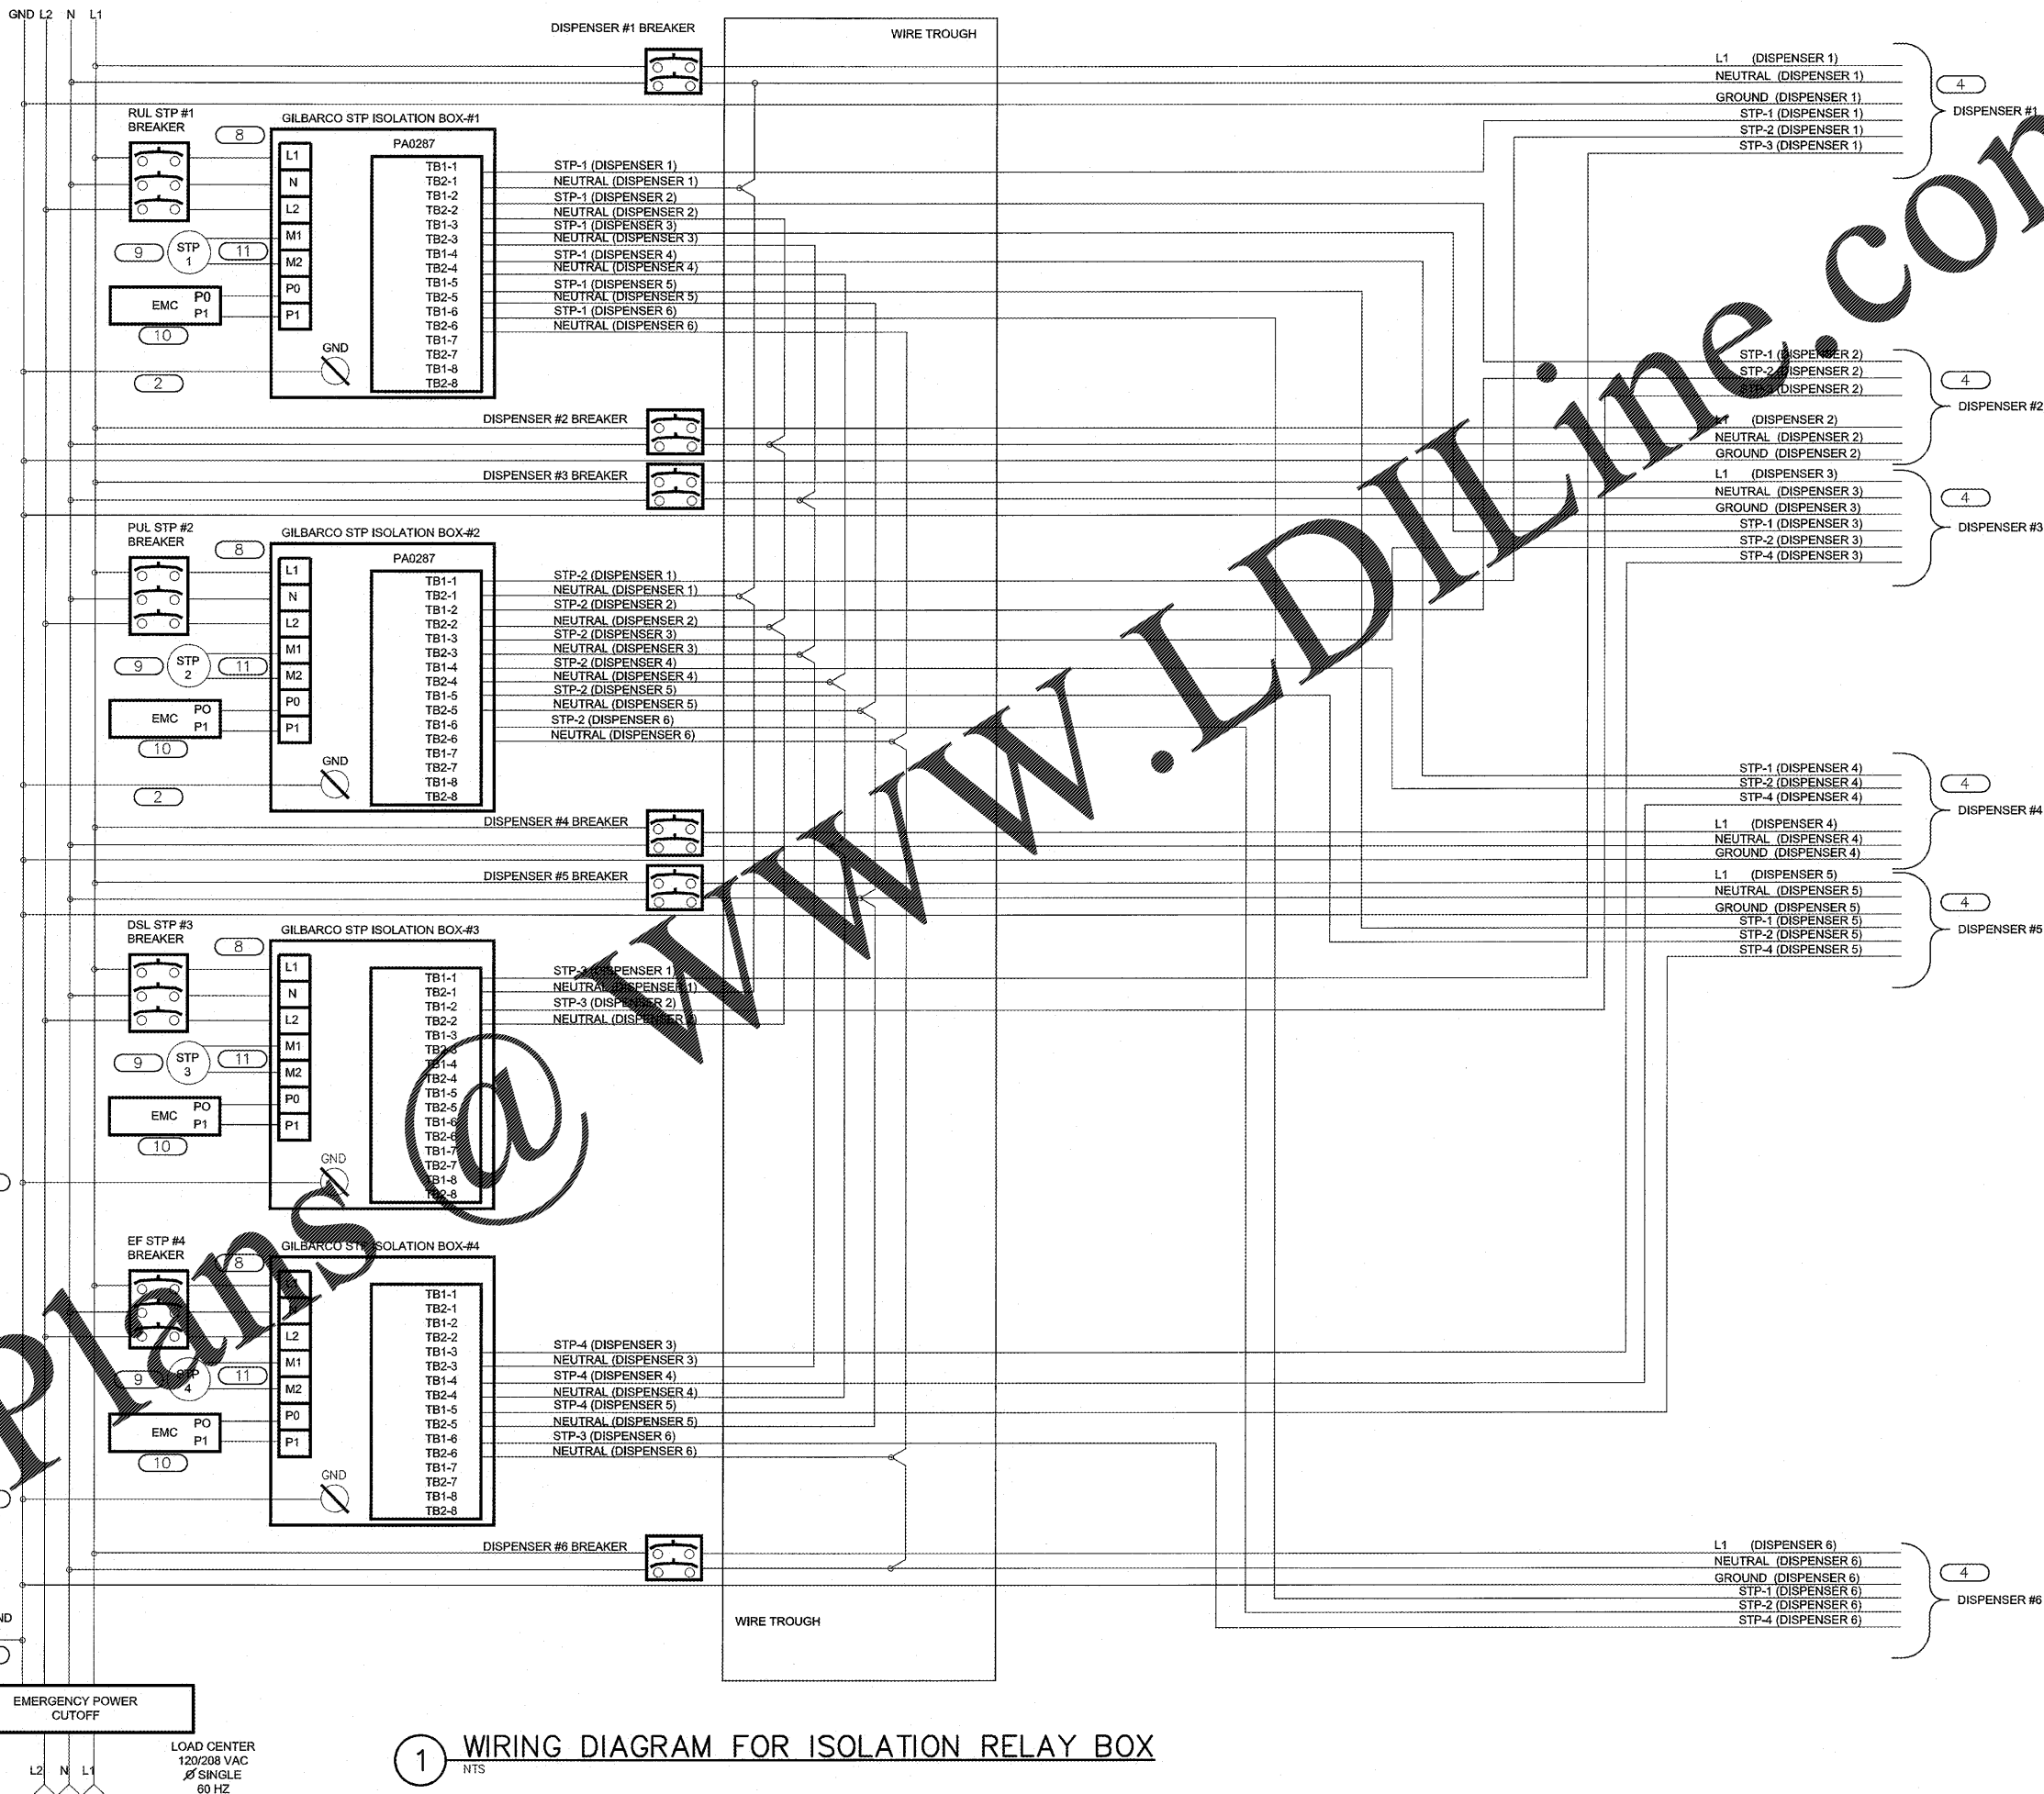

1 WIRING DIAGRAM FOR ISOLATION RELAY BOX

Order Plans @

HFA
ARCHITECTS
ENGINEERS
INTERIORS

HARRISON FRENCH & ASSOCIATES, PLLC
1705 S. ... Blvd, Suite 3
Bentonville, Arkansas 72712
927.273.7780
1.888.520.9685
www.hfa-ac.com

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT A PARTICULAR TIME AND DATE AND IS NOT INTENDED TO BE USED IN ANY OTHER PROJECT WITHOUT THE WRITTEN CONSENT OF HARRISON FRENCH & ASSOCIATES, PLLC. REPRODUCTION OF THIS DRAWING FOR ANY OTHER PROJECT WITHOUT THE WRITTEN CONSENT OF HARRISON FRENCH & ASSOCIATES, PLLC IS PROHIBITED AND MAY BE CONTRARY TO THE LAW.

SAM'S MART
US HY 74 & TECHNOLOGY BLVD
INDIAN TRAIL, NC 28079

JOB NUMBER: 07-16-80004

ISSUE BLOCK

NO.	DATE	DESCRIPTION

STORE NO.:
DOCUMENT DATE: 05-31-17
CHECKED BY: JAC
DRAWN BY: KRS
PROTO CYCLE MAY-2017

PROFESSIONAL SEAL
HARRISON FRENCH AND ASSOCIATES, PLLC
P-0402
5.31.17

ISOLATION RELAY BOX DETAIL

SHEET: **FSE7**