

**VEEDER-ROOT
GENERAL NOTES**

1. CHICO COMPOUND ALL EY SEAL OFFS PER NFPA SPECIFICATION.
2. RUN ONE CABLE FOR EACH TANK LEVEL MONITOR (TLM), LEAK SENSOR (LS), AND INTERSTITIAL SENSOR. NO SPLICES ARE ALLOWED IN CABLE RUN FROM MONITORING CONSOLE AND SENSOR JUNCTION BOX. IDENTIFY EACH CABLE WITH SENSOR TYPE AND LOCATION.
3. CONTACT FACTORY FOR CABLE RUNS GREATER THAN 100'.
4. THE VEEDER-ROOT LEAK MONITORING SYSTEM SHALL BE PROGRAMMED TO AUTOMATICALLY ALARM UPON DETECTION OF ANY TYPE OF LIQUID AT ANY SENSOR. ALL ALARMS WILL BE LOCAL AUDIBLE, VISIBLE AND VIBRATE ON SITE SENT TO OWNER'S OFF-SETTING OPERATIONS OFFICE. ALARMS WILL NOTIFY IMMEDIATELY 24 HOURS A DAY, 7 DAYS A WEEK AT LOCAL AND REMOTE LOCATIONS.
5. LIST ALL SENSOR LOCATIONS OF THE INSIDE OF THE VEEDER-ROOT PANEL DOOR IN THE AREA PROVIDED BY VEEDER-ROOT.
6. VEEDER-ROOT SYSTEM AND ALL SENSORS ARE SUPPLIED BY OTHERS AND INSTALLED BY GENERAL CONTRACTOR.
7. EPOXY SEAL SHALL BE INSTALLED AT ALL WIRE CONNECTIONS. A BARE GROUND MUST BE INSERTED IN THE EPOXY UP TO AND INCLUDING INSULATION AND CABLE JACKET. REF 7-FSE2.
8. INSTALLATION SHOULD BE BASED ON THE MANUFACTURER'S RECOMMENDATION AND INSTALLATION MANUAL OF THE VEEDER-ROOT SYSTEM. DEVIATION FROM THESE RECOMMENDATIONS, INCLUDING THE INSTALLATION OR USE OF NON-APPROVED COMPONENTS, COULD RESULT IN UNSAFE CONDITIONS OR UNRELIABLE OPERATION.
9. INSTALLATION SHALL COMPLY WITH THE NATIONAL ELECTRICAL CODE, FEDERAL, STATE, LOCAL CODES, AND ANY OTHER APPLICABLE SAFETY CODES.

HFA
ARCHITECTS
ENGINEERS
INTERIORS

HARRISON FRENCH & ASSOCIATES, PLLC
705 S. WALTON BLVD, SUITE 3
WINSTON-SALEM, ARKANSAS 72712
PHONE: 781.7780
FAX: 868.520.9685
www.hfa-ac.com

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT WINSTON-SALEM, NORTH CAROLINA. IT IS NOT TO BE REUSED FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF HARRISON FRENCH & ASSOCIATES, PLLC. REPRODUCTION OF THIS DRAWING FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF HARRISON FRENCH & ASSOCIATES, PLLC IS UNAUTHORIZED AND MAY BE CONTRARY TO THE LAW.

SAM'S MART
4965 UNIVERSITY PARKWAY
WINSTON-SALEM, NC 27106

JOB NUMBER: 07-17-80003

ISSUE BLOCK


STORE NO.:
DOCUMENT DATE: 06-08-17
CHECKED BY: JAC
DRAWN BY: KRS
PROTO CYCLE MAY-2017

NO. 1 PROFESSIONAL SEAL
037563
HARRISON FRENCH
AND ASSOCIATES, PLLC
P-0402
6.6.17


TANK
SENSOR
DETAILS

SHEET: FSE5

Order Plans @ WWW.LDILine.com

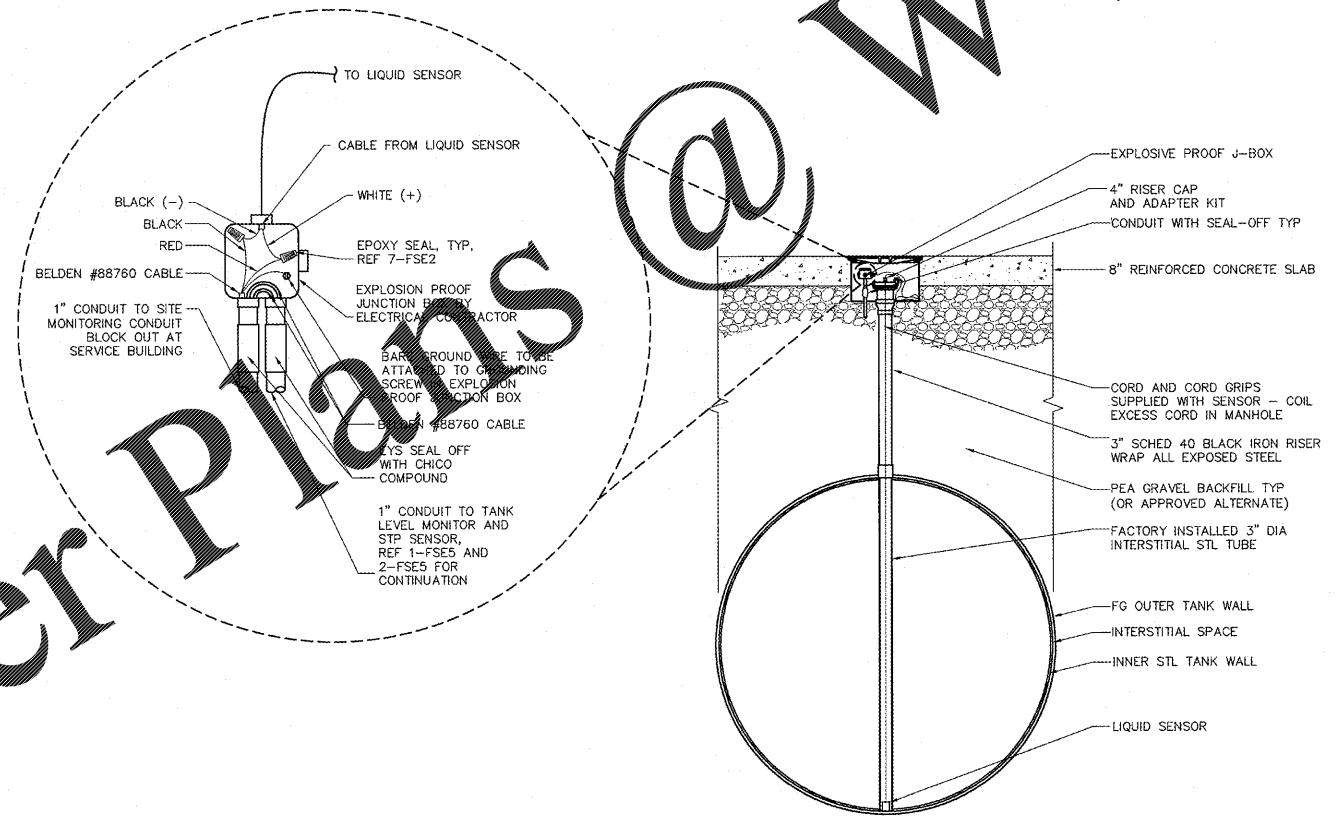

2 TANK INTERSTITIAL SENSOR MOUNTING DETAIL (TYPICAL)
NTS

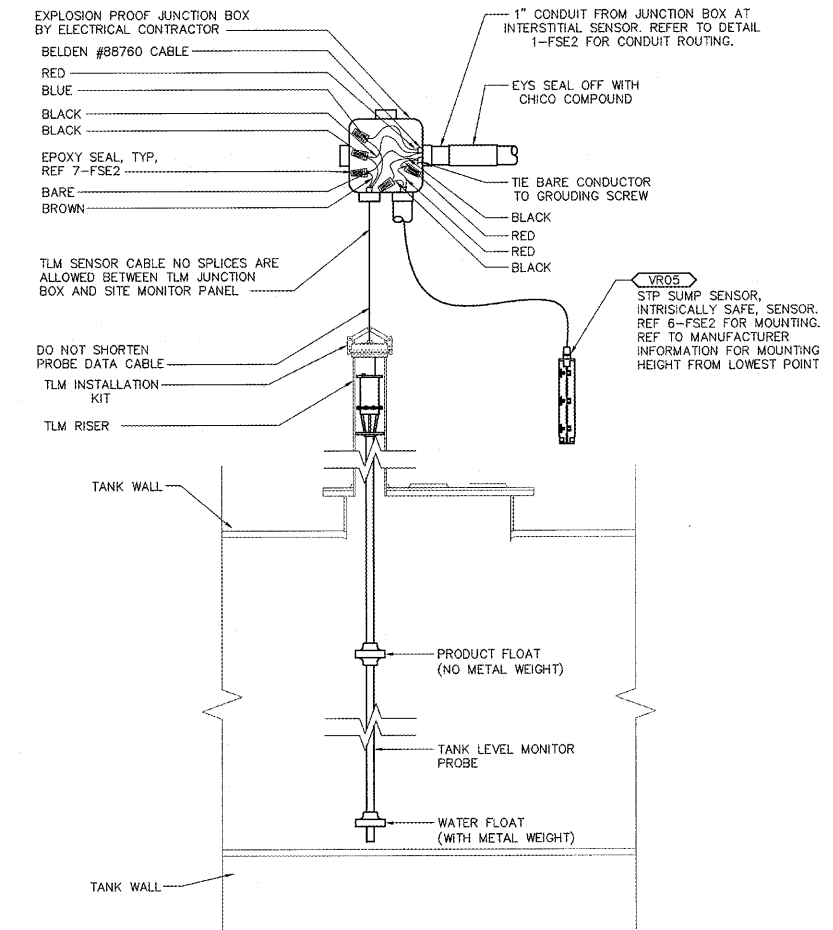

1 TANK LEVEL MONITOR (TLM) IN STP SUMP
NTS