


GENERAL NOTES

1. PIPING BEING DEMOLISHED SHALL BE REMOVED BACK TO ACTIVE MAIN OR BRANCH OF SYSTEM. NO ACTIVE PIPING OR DEAD LEGS ARE PERMITTED.

SHEET KEYNOTES

1. EXISTING RO PACKAGED UNIT TO BE REMOVED. PRESERVE SUPPLY PIPING FOR RECONNECTION TO NEW UNIT. SUPPLY AND RETURN PIPING TO BE REUSED.
2. INSTALL NEW UNIT IN PLACE OF PREVIOUS UNIT. RECONNECT SUPPLY FEED AND ROUTE WASTEWATER TO DRAIN. RECONNECT SUPPLY AND RETURN PIPING TO NEW UNIT.
3. REUSE EXISTING WASTE PIPING. PIPING TO BE REUSED. VERIFY SINK FIELD.

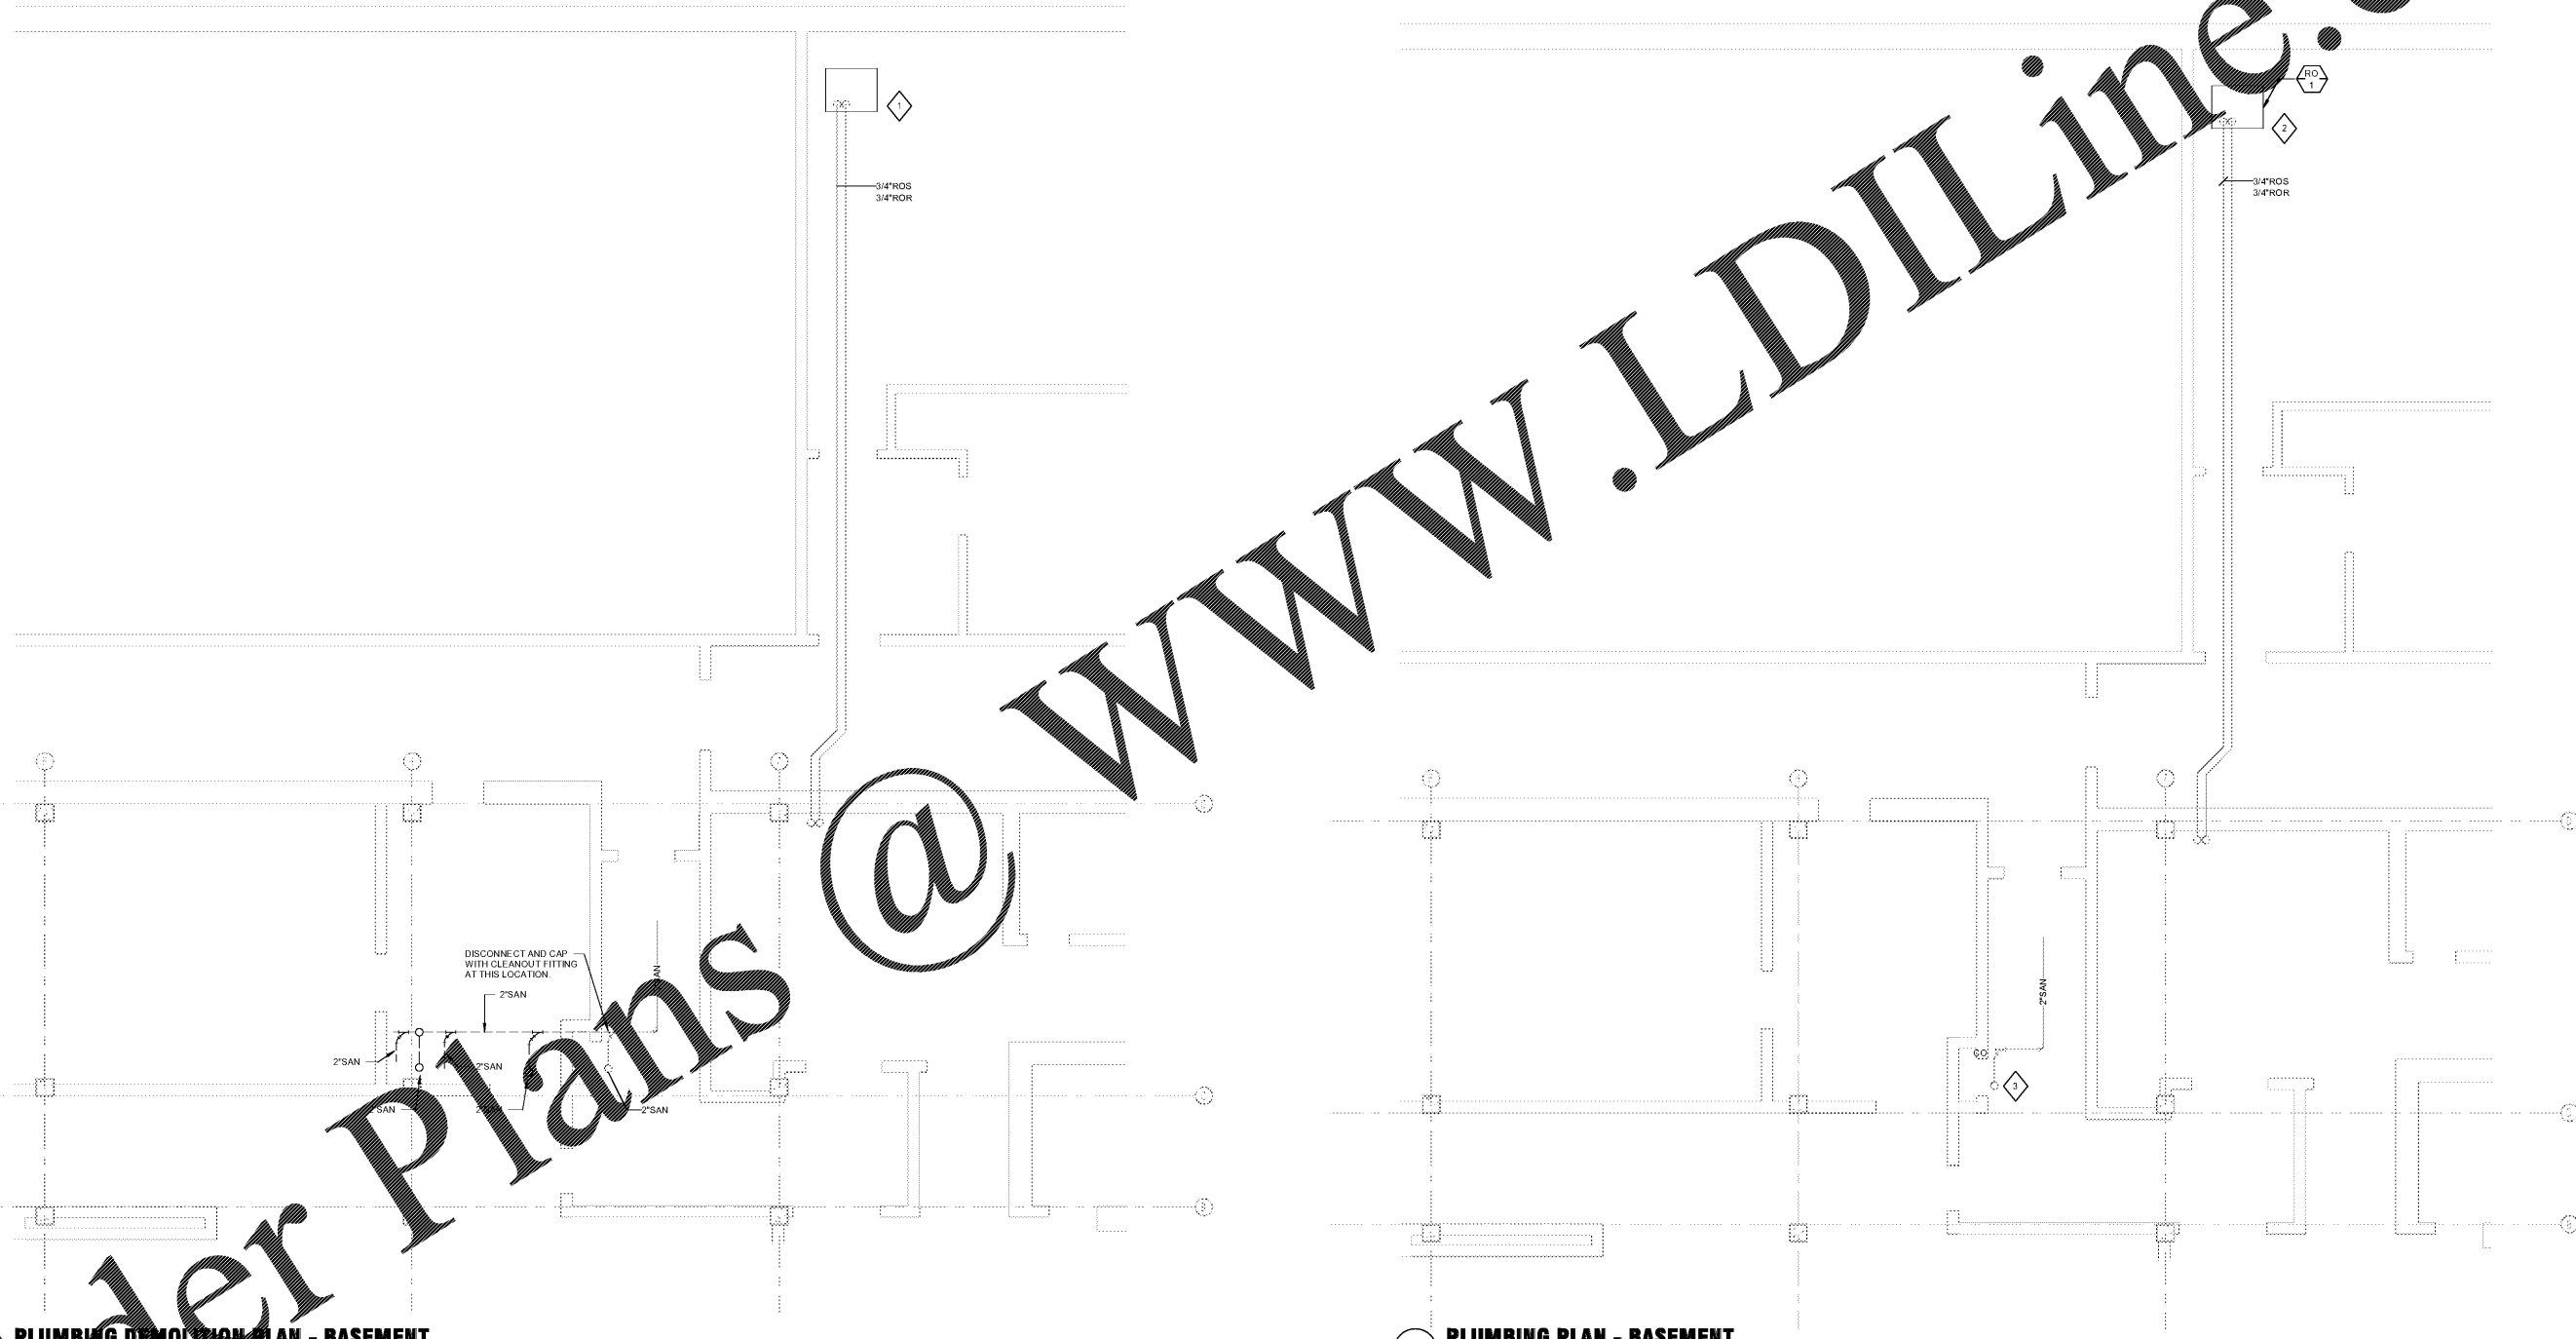

2 PLUMBING DEMOLITION PLAN - BASEMENT
1/4" = 1'-0"


1 PLUMBING PLAN - BASEMENT
1/4" = 1'-0"

Order Plans @ www.LDILine.com
 10/05/2017 11:32:18 AM
 C:\Users\bsw\Documents\2018 Local C\17540-00-00\NAME Pharmacy_bsw\bsw@aeieng.com

Revisions:	Date:

CONSULTANT
 Consultant:
AEI Affiliated Engineers
 5802 Research Park Boulevard
 Madison, WI 53719
 608.238.2616
 aeieing.com

ARCHITECT/ENGINEER OF RECORD
 A/E:
LA LACHIN Architects, apc
 Architecture . Planning . Project Management
 5190 Canal Boulevard, Suite 201
 New Orleans, LA 70124
 (504)835-8013



Office of Construction and Facilities Management
 VA U.S. Department of Veterans Affairs

Drawing Title
PLUMBING DEMO AND FLOOR PLAN - BASEMENT
 Approved:

Phase
CONSTRUCTION DOCUMENTS

Project Title
RENOVATE PHARMACY CLEAN ROOM (USP 797)
 Location
 510 E. Stoner Ave. Shreveport, LA 71101
 Issue Date
 10/05/2017
 Checked
 BSW
 Drawn
 BSW

Project Number
 667-17-108
 Building Number
 1
 Drawing Number
P100