


GENERAL NOTES

1. PIPING BEING DEMOLISHED SHALL BE REMOVED BACK TO ACTIVE MAIN OR BRANCH OF SYSTEM. NO ACTIVE PIPING OR DEAD LEGS ARE PERMITTED.

SHEET KEYNOTES

1. EXISTING RO PACKAGED UNIT TO BE REMOVED. PRESERVE SUPPLY PIPING FOR RECONNECTION TO NEW UNIT. SUPPLY AND RETURN PIPING TO BE REUSED.
2. INSTALL NEW UNIT IN PLACE OF PREVIOUS UNIT. RECONNECT SUPPLY FEED AND ROUTE WASTEWATER TO DRAIN. RECONNECT SUPPLY AND RETURN PIPING TO NEW UNIT.
3. REUSE EXISTING WASTE PIPING. PIPING PENETRATION. VERIFY SEWER FIELD.

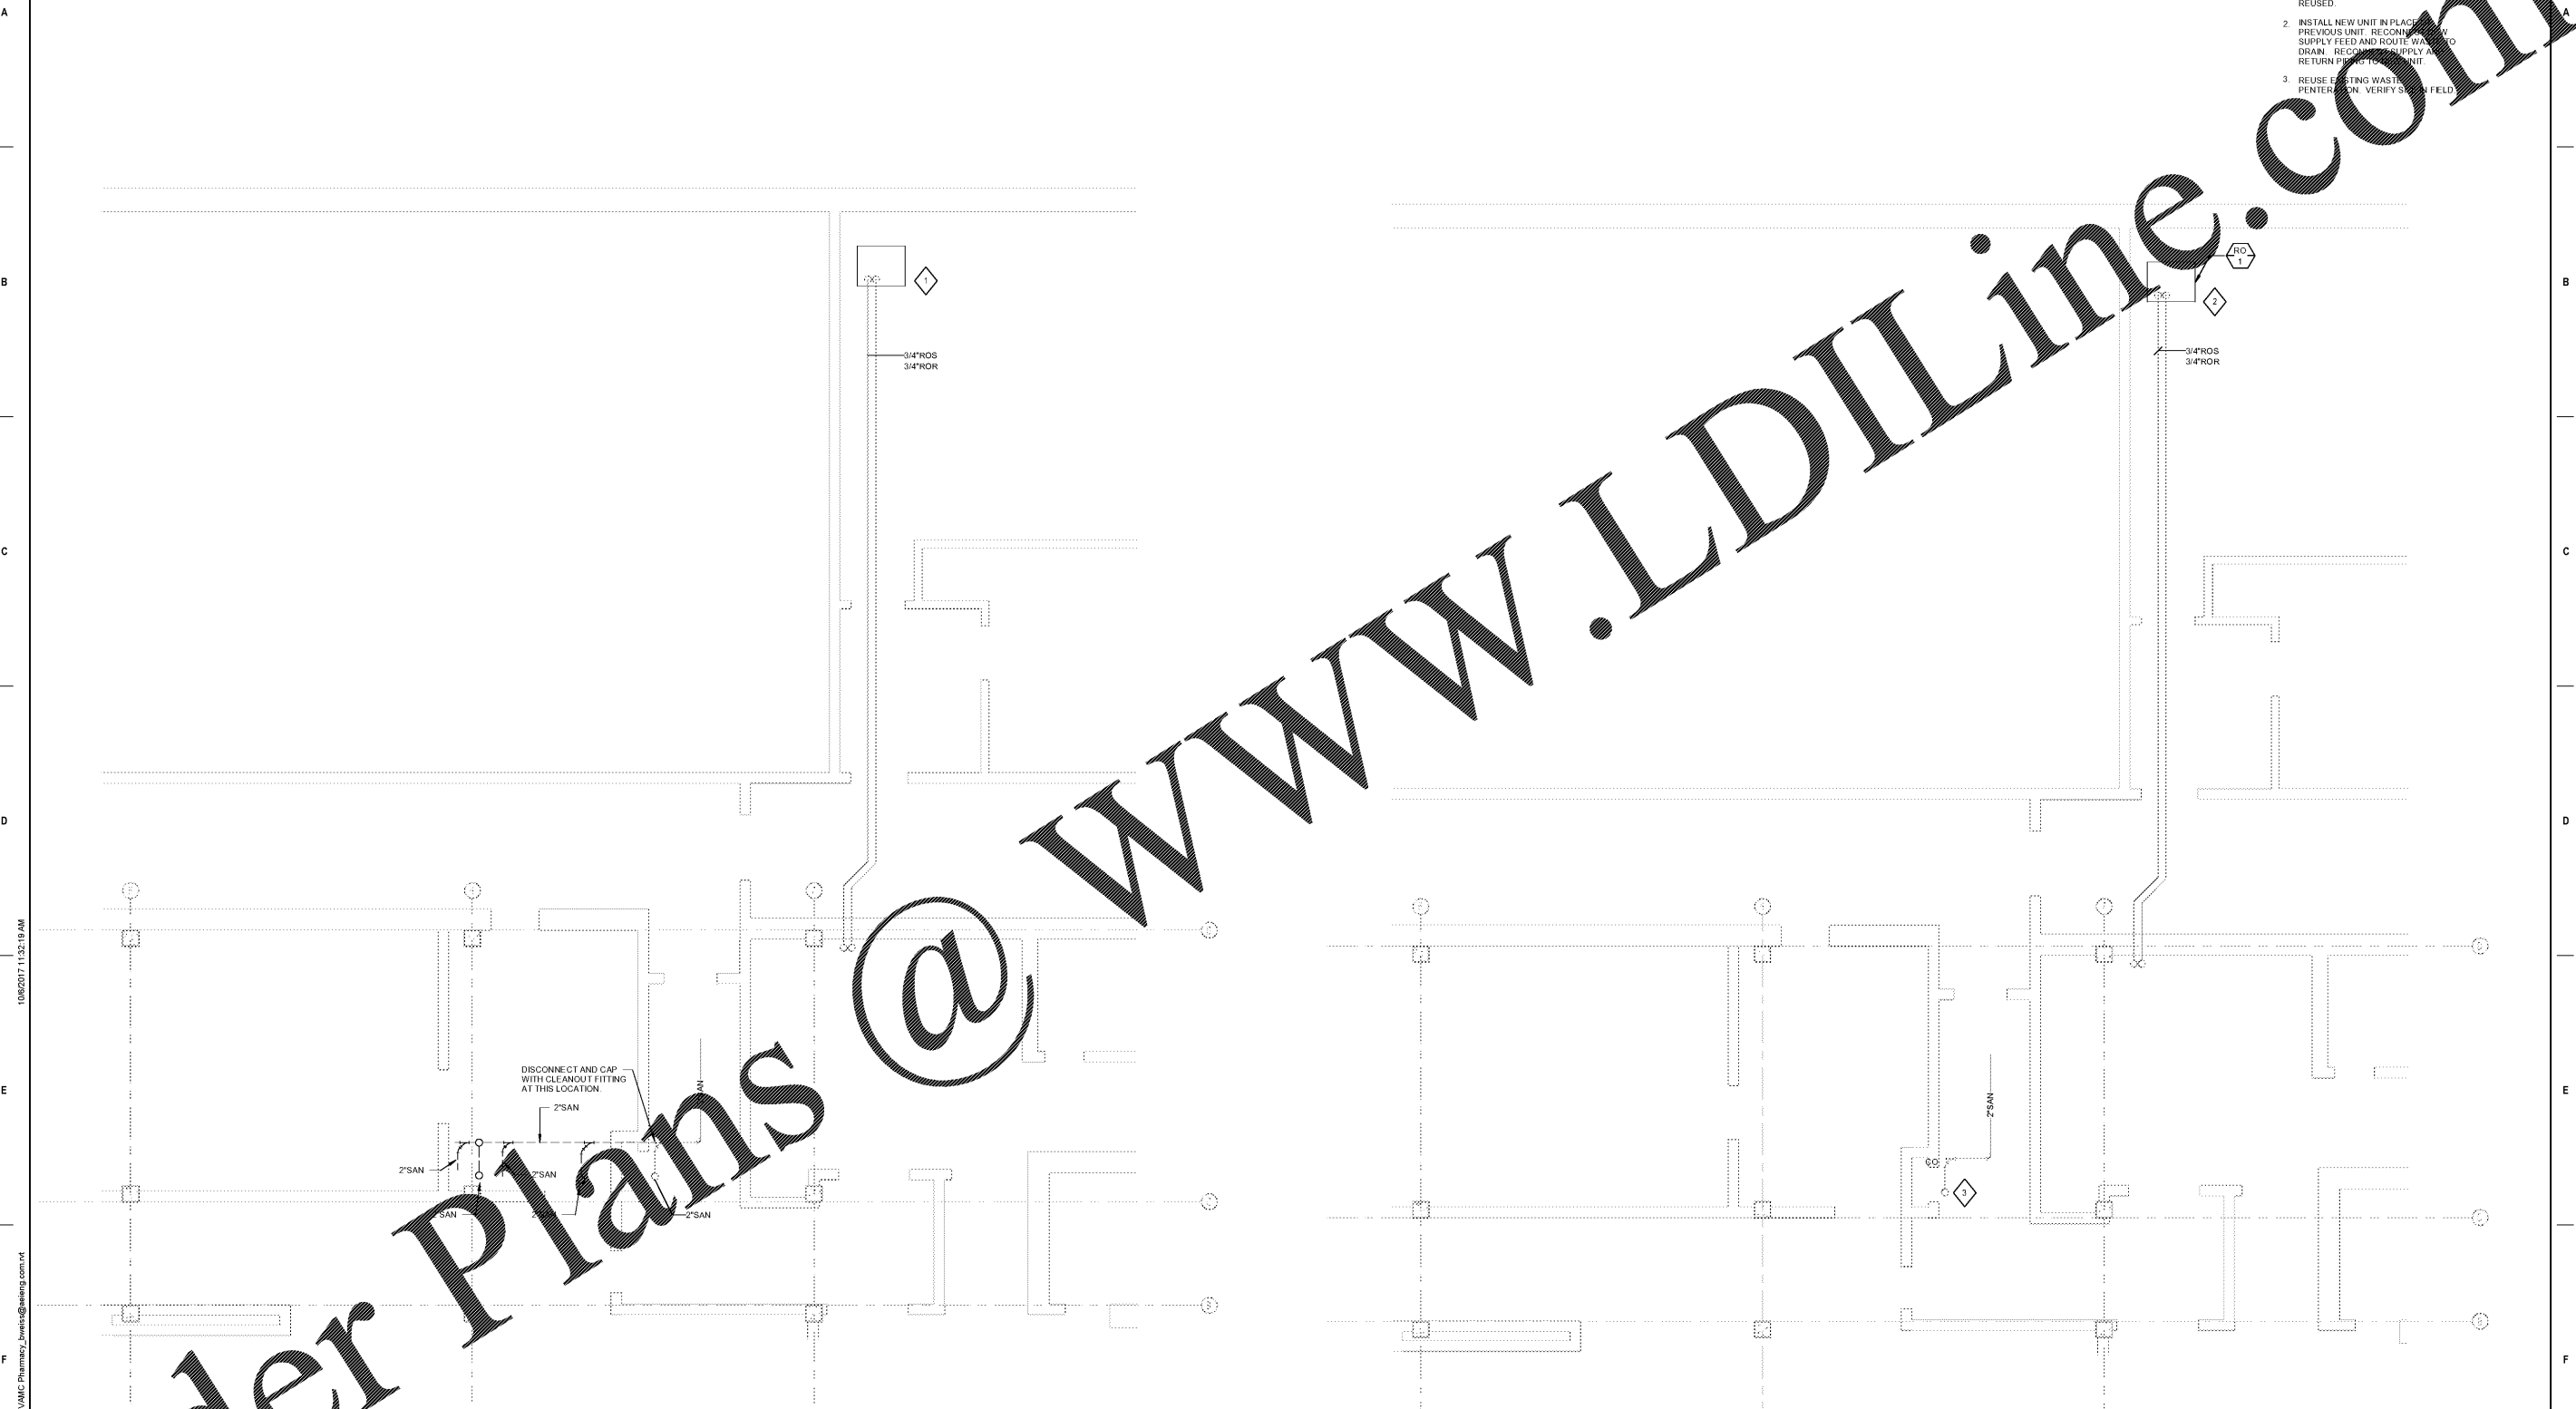

2 PLUMBING DEMOLITION PLAN - BASEMENT
1/4" = 1'-0"

1 PLUMBING PLAN - BASEMENT
1/4" = 1'-0"

Order Plans @ www.LDILine.com
 10/05/2017 11:32:19 AM
 C:\Users\bsw\Documents\2018 Local C\17540-00-00\NAME Pharmacy_bsw\bsw@aeieng.com.dwg


Revisions:	Date:

CONSULTANT

Consultant:
AEI Affiliated Engineers
 5802 Research Park Boulevard
 Madison, WI 53719
 608.238.2616
 aeieing.com

ARCHITECT/ENGINEER OF RECORD

A/E:
LA LACHIN Architects, apc
 Architecture . Planning . Project Management
 5190 Canal Boulevard, Suite 201
 New Orleans, LA 70124
 (504)835-8013



Office of Construction and Facilities Management

Drawing Title	Phase
PLUMBING DEMO AND FLOOR PLAN - BASEMENT	CONSTRUCTION DOCUMENTS
Approved:	

Project Title	Project Number
RENOVATE PHARMACY CLEAN ROOM (USP 797)	667-17-108
Location	Building Number
510 E. Stoner Ave. Shreveport, LA 71101	1
Issue Date	Checked
10/05/2017	BSW
Drawn	BSW

Drawing Number
P100