


TAG	LOCATION	DESCRIPTION	FIXTURE MANUFACTURER	MODEL NO.	DESCRIPTION	TRIM MANUFACTURER	MODEL NO.	WASTE (IN)	VENT (IN)	TRAP (IN)	COLD WATER (IN)	HOT WATER (IN)	NOTES	REMARKS
S-1	PHARMACY	WALL MTD EYEWASH - SNK MTD PULLDOWN	WHITEHALL	4101.MC.EYW.E171-LFN	ELECTRONIC FAUCET	WHITEHALL	SUPPLIED WITH SNK	2	1 1/2	-	3/4	3/4	1,2,3,4,5	SUPPLIED WITH EYEWASH AND TRIM VALVE MOUNT EYEWASH ON RIGHT
				EYW-ET71-1									5	MOUNTING CARRIER REQUIRED FOR SNK

- NOTES:
- 1- PROVIDE POINT OF USE TMV
 - 2- ALL 1" TRAPS TO BE HEAVY DUTY 170# WITH CLEAN-OUT PLUG
 - 3- PROVIDE HEAVY DUTY BALL VALVE STYLE STOPS
 - 4- PROVIDE FIXTURE CARRIER
 - 5- MOUNTING SPECIFIED WITH SNK

TAG	QTY	COMPONENT	PERFORMANCE DETAILS	BASIS OF DESIGN	POWER REQUIREMENTS	REMARKS
RO-1	1	RO UNIT - PACKAGED	4.8 GPM, 1321 GPD, 18.2 MEG OHM	ELGA CENTRA-R 200	SINGLE PHASE 230/208V, 1, 20 AMPS	MINIMUM INPUT FEED 5.3 GPM


TAG	BASIS OF DESIGN MANUFACTURER AND MODEL	DESCRIPTION
BFP-3	WATTS MODEL SD-3	BEVERAGE BACKFLOW PREVENTER, ASSE 1012
WB-1	QATEY 18642	WALL BOX WITH 2" WASTE AND 1/2" WATER CONNECTIONS WITH WATER HAMMER ARRESTOR

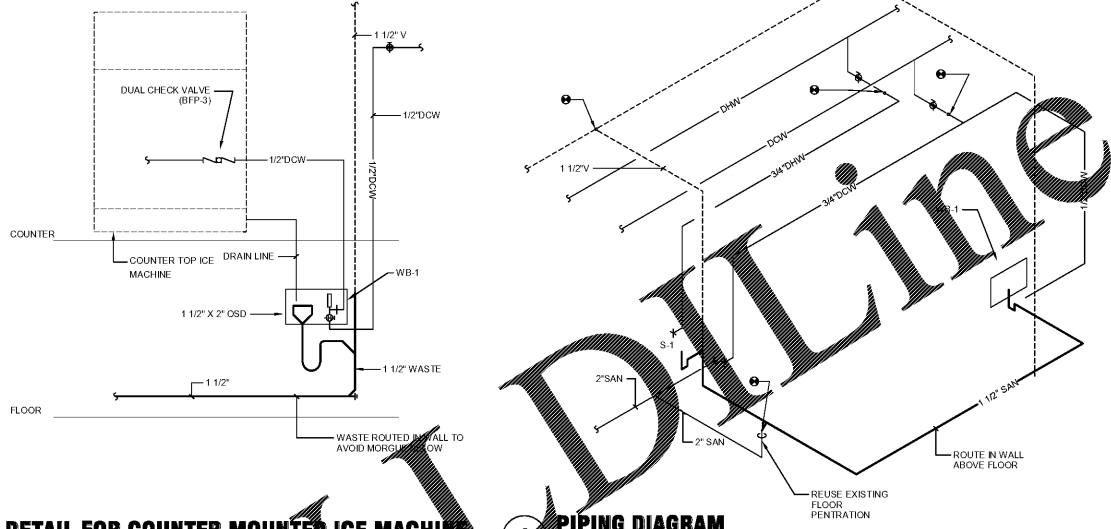

GENERAL NOTES

1. PIPING BEING DEMOLISHED SHALL BE REMOVED BACK TO ACTIVE MAIN OR BRANCH OF SYSTEM. NO ACTIVE OR DEAD ENDS ARE PERMITTED.
2. ALL PIPING ROUTES SHALL BE COORDINATED WITH OTHER EQUIPMENT.
3. LOCATE SERVICE MACHINE TO LOCATION ON PLAN.
4. REMOVE LAVATORY AND ALL RELATED TRIM AND PIPING. WASTE PIPING THRU FLOOR TO REMAIN FOR REUSE.
5. REMOVE WALL MOUNTED EYEWASH AND ALL RELATED TRIM AND PIPING.
6. FIRE HOSE CABINET AND CONTENTS TO REMAIN.
7. EXISTING DOMESTIC WATER PIPING TO BE RAISED IN THIS AREA TO ACCOMMODATE NEW DUCTWORK INSTALLATION.
8. INSTALL RELOCATED ICE MACHINE IN LOCATION NOTED ON PLAN. CONNECTED TO EXISTING WASTE AND WATER.
9. REMOVE 2" CONDENSATE DRAIN ORIGINATING AT ROOF TOP AHU AND TERMINATING AS NOTED ON PLANS. SEAL ABANDONED ROOF PENETRATION.
10. PROVIDE 2" SQ. ACCESS PANEL. COORDINATE LOCATION WITH ARCHITECTURAL PLANS. LOCATE SERVICE VALVES IN THIS AREA.

SHEET NOTES

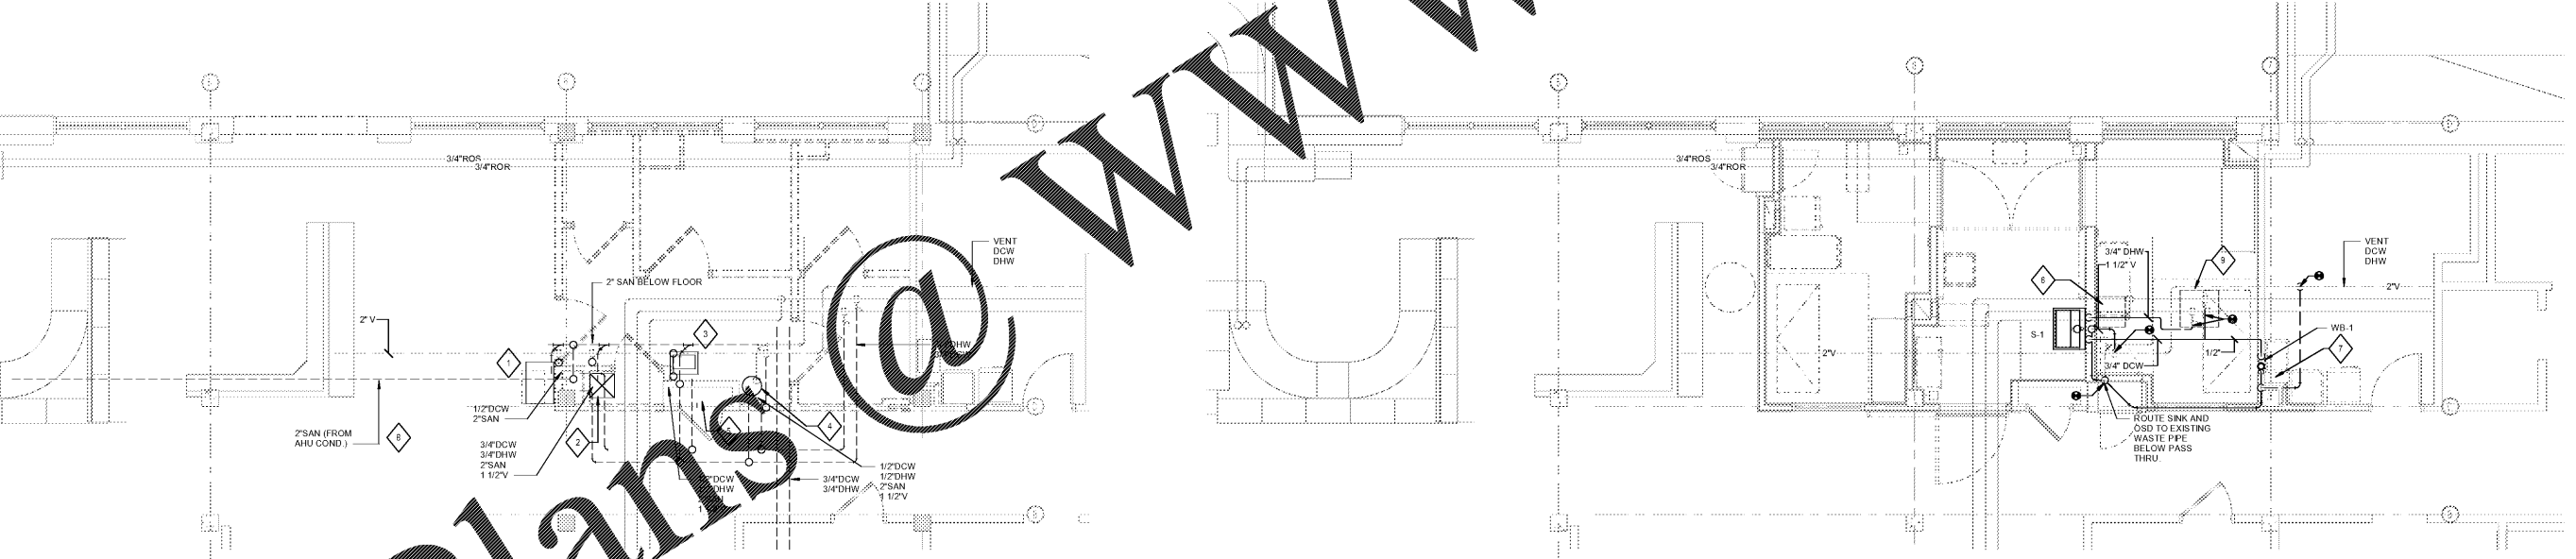

Revisions:	Date:

CONSULTANT

Consultant:

A/E/I Affiliated Engineers

5802 Research Park Boulevard
Madison, WI 53719
608.238.2616
aieing.com

ARCHITECT/ENGINEER OF RECORD

A/E:

LA LACHIN Architects, apc

Architecture, Planning, Project Management
5190 Canal Boulevard, Suite 201
New Orleans, LA 70124
(504)835-8013

STAMP

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title

PLUMBING DEMO AND FLOOR PLAN - FIRST FLOOR

Approved:

Phase

CONSTRUCTION DOCUMENTS

Project Title

RENOVATE PHARMACY CLEAN ROOM (USP 797)

Location

510 E. Stoner Ave. Shreveport, LA 71101

Issue Date

10/05/2017

Checked

BSW

Drawn

BSW

Project Number

667-17-108

Building Number

1

Drawing Number

P101

10/8/2017 11:32:21 AM
 C:\Users\brun... Documents\Rev 2018 Local C:\17540-00-CORVAMC Pharmacy_b...@aieing.com.dwg