

REFER TO SHEET P103 FOR CONTINUATION



11.22.17
Exp. 09.30.19



Prairville General Hospital
37358 Market Place Dr.
Prairieville, LA 70769

Shawn Kauter and Associates
Robert C. Murray AIA
Architects & Construction Services
13458 Barkley Rd., Ste. 202
Houston, TX 77033
Ph: 281.695.5716
Email: shawn.kauter@shawnkauter.com



Project No. 1607050

Drawn: AG

Checked: -

Date: November 22, 2017


No. Description Date

No.	Description	Date

P104
PLUMBING
FLOOR PLAN

KEYED NOTES - PLUMBING:

- PROVIDE PLUMBING ROUGH-IN, REDUCED PRESSURE TYPE BACKFLOW PREVENTER WITH IN-LINE FILTER AND MAKE FINAL CONNECTION TO ICE MAKER BY OTHERS. DRAIN TO 1" ABOVE RIM OF FLOOR SINK. PROVIDE BACKFLOW PREVENTER DRAIN TO ACCESSIBLE LOCATION ON WALL COORDINATE WITH LOCATION OF ICE MAKER WITH OWNER.
- PROVIDE 1/2" WATER LINE PLUMBING ROUGH-IN WITH 1/4" TURN ANGLE STOP INSTALLED IN COUNTRYSIDE ROUTE. FLEXIBLE SUPPLY LINE FROM ANGLE STOP TO DOUBLE CHECK VALVE. PROVIDE BACKFLOW PREVENTER INSTALLED ON WALL BELOW COUNTER TOP. MAKE COORDINATION WITH OWNER. COORDINATE FINAL LOCATION OF COUNTRYSIDE MAKER.
- PROVIDE ISOLATION VALVE FOR EACH VERTICAL WATER PIPE RISER COMING INTO BUILDING. PROVIDE ISOLATION VALVE FOR EACH RISER AND MANIFOLD TO ONE (1) 3" WATER LINE. TRAP PRIMER SHALL BE ACCESSIBLE. WHEN INSTALLED IN WALL, PROVIDE STAINLESS STEEL ACCESS PANEL PAINTED TO MATCH WALL FINISH. PROVIDE ISOLATION VALVE IN 2" CW DRAIN TO ALL IP-1 TYPE TRAP PRIMERS. IP-2 AND IP-3 DO NOT REQUIRE ISOLATION VALVES.
- ROUTE 3/4" WATER LINE DOWN TO LOCKABLE FREEZE-PROOF WALL HYDRANT WITH NON-REMOVABLE VACUUM BREAKER. PROVIDE ISOLATION VALVE ABOVE CEILING.
- INSTALL THERMOSTATIC MIXING VALVE ON WALL BELOW SINK/LAVATORY. ROUTE 105T TEMPERED WATER TO HOT WATER SIDE OF FAUCET.
- INSTALL THERMOSTATIC MIXING VALVE IN ACCESSIBLE LOCATION IN WALL FOR SHOWER. ROUTE 105T HOT WATER TO SHOWER VALVE. PROVIDE STAINLESS STEEL ACCESS PANEL AND PAINT TO MATCH WALL FINISH.
- FIRE SPRINKLER CONTRACTOR SHALL COORDINATE SPRINKLER PIPING/HEADS WITH PROPOSED CEILING DESIGN. RAISE OR OFFSET PIPING AND HEADS AS NECESSARY TO ROUTE SPRINKLER PIPING ABOVE CEILING.
- PRIOR TO INSTALLING SPRINKLER HEADS, SUBMIT A COMPLETE SET OF DRAWINGS INDICATING THE SPRINKLER HEAD LOCATION FOR OWNER AND ARCHITECT APPROVAL.

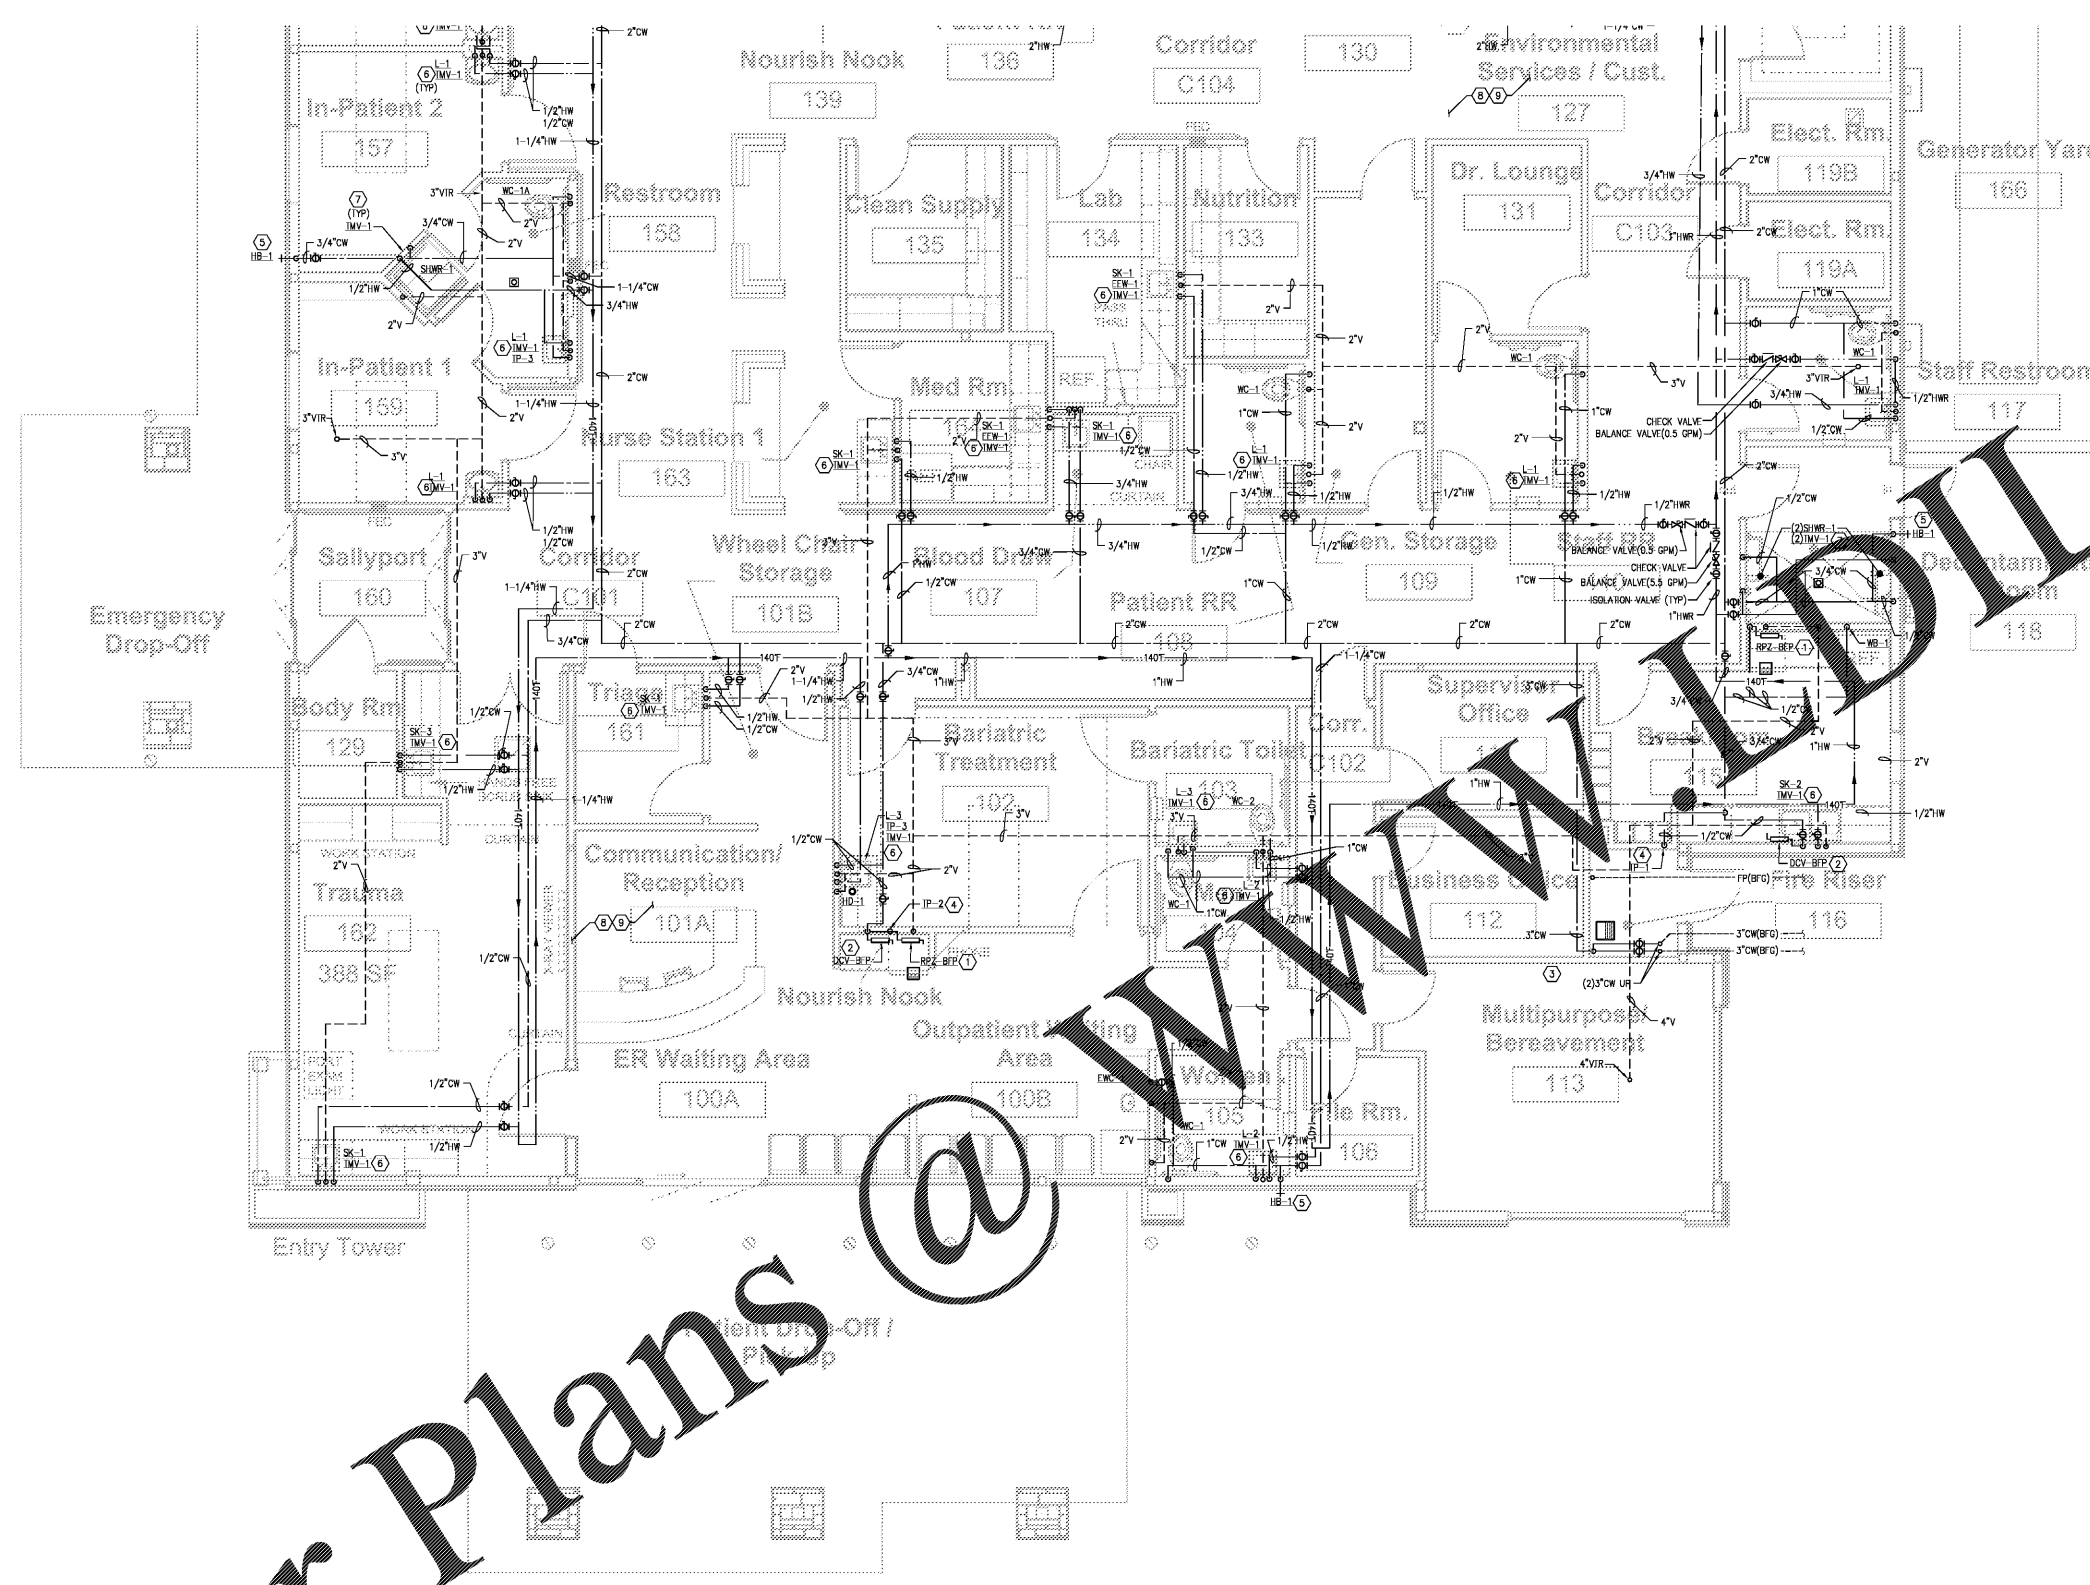

1 PLUMBING - FLOOR PLAN
SCALE: 1/4" = 1'-0"

Order Plans @