



9 GUTTER TAPER  
NOT TO SCALE


- NOTES:
1. A CONTROL JOINT 1" DEEP WITH 1/8" RADII SHALL BE REQUIRED IN THE CONCRETE SIDEWALK AT EQUAL SPACES AS DELINEATED ON SITE LAYOUT PLAN. ONE 1/2" EXPANSION JOINT WILL BE REQUIRED AT LOCATIONS SHOWN ON SITE LAYOUT PLAN. A 1/2" MAX EXPANSION JOINT WILL BE REQUIRED WHERE THE SIDEWALK JOINS ANY RIGID STRUCTURE. A SAWED SCORE JOINT MAY BE USED IN LIEU OF EXPANSION JOINT EXCEPT AGAINST RIGID STRUCTURES.
  2. ALL CONCRETE TO BE AT LEAST 3,000 P.S.I. IN 28 DAYS.
  3. 1/2" MAX EXPANSION MATERIAL WHERE SIDEWALK ABUTS CURB AND GUTTER.
  4. CROSS SLOPE SHALL NOT EXCEED 1.5% MAX.

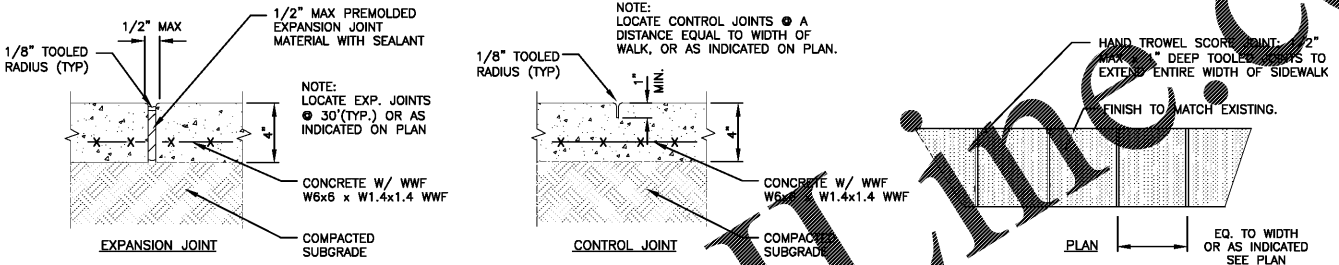

8 CONCRETE SIDEWALK  
NOT TO SCALE

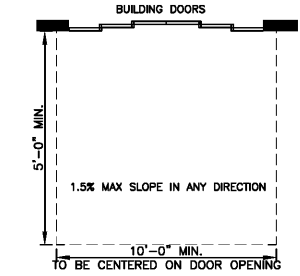

7 ACCESSIBLE EGRESS LANDING  
NOT TO SCALE

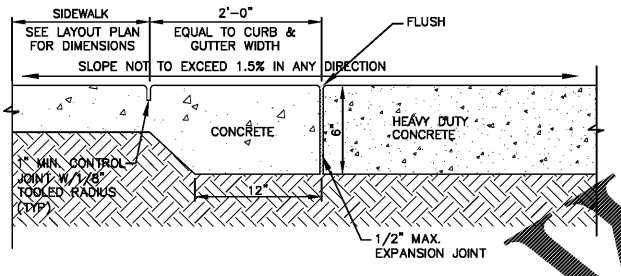


6 ACCESSIBLE FLUSH CURB SECTION  
NOT TO SCALE

- CONCRETE NOTES:
1. UNLESS NOTED OTHERWISE, ALL CONCRETE SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS.
  2. AGGREGATES SHALL BE NATURAL SAND AND ROCK CONFORMING TO ASTM C33.
  3. CEMENT SHALL BE PORTLAND CEMENT CONFORMING TO ASTM C-150, TYPE I OR II, LOW ALKALI OR AS REQUIRED TO MEET SITE SOIL CONDITIONS AS DETERMINED BY THE PROJECT SOILS ENGINEER.
  4. WATER SHALL BE POTABLE, CLEAN AND FREE FROM INJURIOUS AMOUNTS OF OIL, ACIDS, ALKALIS, SALTS, ORGANIC MATERIALS, OR OTHER SUBSTANCES THAT MAY BE DELETERIOUS TO CONCRETE OR REINFORCEMENT.
  5. ADMIXTURES TO BE USED IN CONCRETE SHALL BE SUBJECT TO PRIOR APPROVAL BY THE ENGINEER.
  6. MAXIMUM PERMISSIBLE WATER-CEMENT RATIOS FOR CONCRETE WHEN STRENGTH DATA FROM TRIAL BATCHES ARE NOT AVAILABLE SHALL CONFORM TO TABLE 4.5 OF ASTM STANDARD 318 OR BASED ON SULFATE CONTENT OF THE SITE SOILS, AS DETERMINED BY THE SOILS ENGINEER. THE LOWER WATER-CEMENT RATIO SHALL GOVERN.
  7. CONCRETE SHALL BE CURED WHILE IN A MOIST CONDITION FOR AT LEAST THE FIRST 7 DAYS AFTER PLACEMENT. METHODS FOR ACCELERATED CURING SHALL HAVE PRIOR APPROVAL OF THE ENGINEER.
- THE FOLLOWING MINIMUM CLEAR DISTANCES BETWEEN REINFORCING STEEL AND FACE OF CONCRETE SHALL BE MAINTAINED UNLESS NOTED OTHERWISE:
- |                                     |                |
|-------------------------------------|----------------|
| SLABS ON GRADE.....                 | CENTER OF SLAB |
| CONCRETE BELOW GRADE, FORMED.....   | 2"             |
| CONCRETE BELOW GRADE, UNFORMED..... | 3"             |
| CONCRETE EXPOSED TO WEATHER.....    | 1-1/2"         |


5 CONCRETE NOTES  
NOT TO SCALE

- NOTES:
1. A CONTROL JOINT 1" DEEP WITH 1/8" RADII SHALL BE REQUIRED IN THE CONCRETE PAVING AT 12' ON CENTER OR AS DELINEATED ON SITE LAYOUT PLAN. A 1/2" MAX EXPANSION JOINT WILL BE REQUIRED WHERE THE PAVING JOINS ANY RIGID STRUCTURE. A SAWED SCORE JOINT MAY BE USED IN LIEU OF EXPANSION JOINT EXCEPT AGAINST RIGID STRUCTURES.
  2. ALL CONCRETE TO BE AT LEAST 4,500 P.S.I. IN 28 DAYS.
  3. 1/2" MAX EXPANSION MATERIAL WHERE PAVING ABUTS CURB AND GUTTER.
  4. SLOPE SHALL NOT EXCEED 1.5% IN ANY DIRECTION.
  5. ALL NEW CONCRETE PARKING SPACES TO MEET FLUSH WITH ADJACENT ASPHALT PAVING AND CURB AND GUTTER UNLESS OTHERWISE NOTED.

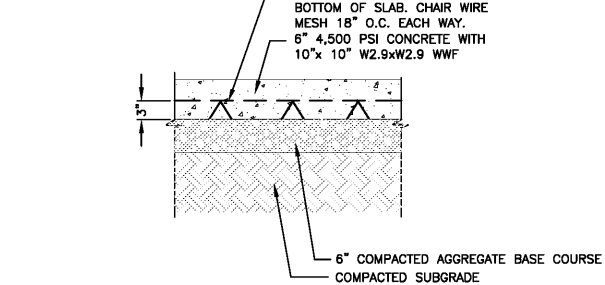

4 HEAVY-DUTY CONCRETE  
NOT TO SCALE


- NOTES:
1. ALL 12"x18" ACCESSIBLE SIGNS (R7-8 & R7-1) SHALL BE MOUNTED AT 84" FROM GRADE TO BOTTOM EDGE OF SIGN FACE (MUTCD).
  2. REFER TO MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES, (MUTCD) U.S. DEPARTMENT OF TRANSPORTATION AND SOUTH CAROLINA DEPARTMENT OF TRANSPORTATION SUPPLEMENT.
  3. IF ACCESSIBLE ROUTE IS A RAISED SIDEWALK AREA, THEN RAMPS ARE REQUIRED AT LOADING ZONE AREA.
  4. SEE LAYOUT PLAN C1.02 FOR SITE SPECIFIC LAYOUT OF ACCESSIBLE SPACES AND SIGNS. INFORMATION SHOWN BELOW IS FOR GENERAL LAYOUT OF SIGNAGE AND STRIPING.
  5. ALL DIMENSIONS FOR PARKING STRIPING ARE TO CENTER OF 4" STRIPE.

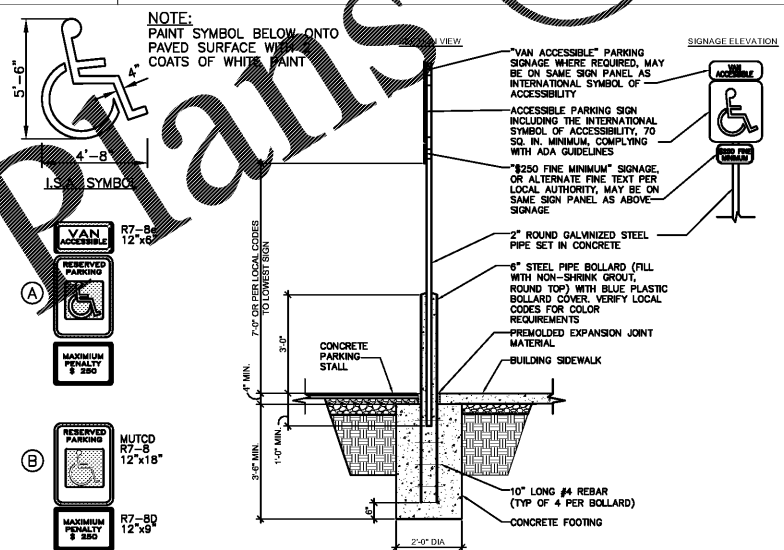

3 ACCESSIBLE STRIPING & SIGNAGE  
NOT TO SCALE

- NOTES:
1. CONTRACTION JOINTS SHALL BE SPACED AT 10 FOOT INTERVALS, EXCEPT THAT A 15 FOOT SPACING MAY BE USED WHEN A MACHINE IS USED OR WHEN SATISFACTORY SUPPORT FOR THE FACE OF THE FORM CAN BE OBTAINED WITHOUT THE USE OF TEMPLATES AT 10 FOOT INTERVALS. JOINT SPACING MAY BE ALTERED BY THE ENGINEER TO PREVENT UNCONTROLLED CRACKING.
  2. CONTRACTION JOINTS MAY BE INSTALLED BY THE USE OF TEMPLATES OR FORMED BY OTHER APPROVED METHODS. WHERE SUCH JOINTS ARE NOT FORMED BY TEMPLATES, A MINIMUM DEPTH OF 1-1/2" SHALL BE OBTAINED.
  3. ALL CONTRACTION JOINTS SHALL BE FILLED WITH JOINT SEALER.
  4. EXPANSION JOINTS SHALL BE SPACED AT 90 FOOT INTERVALS, AND ADJACENT TO ALL RIGID OBJECTS.
  5. JOINTS SHALL MATCH LOCATIONS WITH JOINT IN ABUTTING SIDEWALK.
  6. CONCRETE SHALL BE 3600 PSI IN 28 DAYS.
  7. TOP 6" OF SUBGRADE BENEATH CURB AND GUTTER SHALL BE COMPACTED TO 100% STANDARD PROCTOR DENSITY.
  8. ALL TAPERED CURBS TO BE PAINTED YELLOW.

2 1'-6" CONCRETE CURB & GUTTER  
NOT TO SCALE

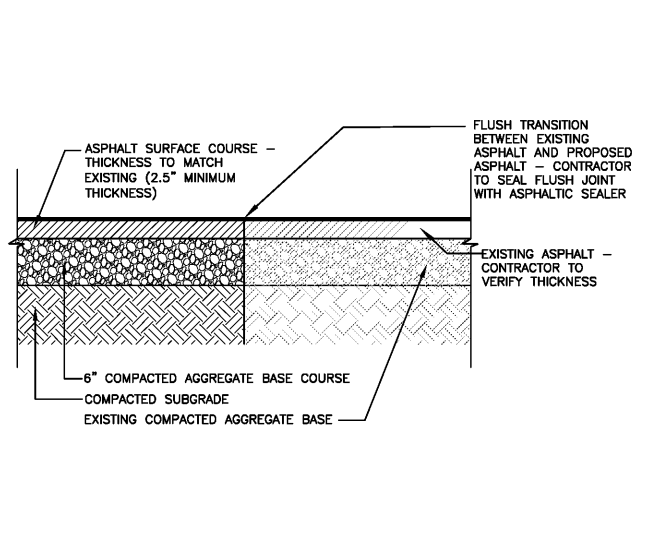


1 LIGHT-DUTY ASPHALT  
NOT TO SCALE




STORE NUMBER: 5553  
1401 BEN SAWYER BLVD  
MOUNT PLEASANT, SC 29464  
PROJECT TYPE ADA and THH  
DEAL TYPE:  
CS PROJECT NUMBER:



www.littleonline.com  
This drawing and the design shown are the property of Little Diversified Architectural Consulting. The reproduction, copying or other use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.  
© Little 2017



DEVELOPER:  
CVS pharmacy



REVISIONS:

CVS PROJECT MANAGER: CPM  
DRAWING BY: GSB  
DATE: 10-09-2017  
JOB NUMBER: 121-7815-08  
TITLE: SITE DETAILS  
SHEET NUMBER:

C2.00  
COMMENTS: